



PART – B (DETAILED TECHNICAL SPECIFICATION)

SUB-SECTION-II-E (ELECTRICAL SYSTEM)

**DCRTPP YAMUNA NAGAR (2X300 MW)
FLUE GAS DESULPHURISATION (FGD)
SYSTEM PACKAGE**

**TECHNICAL SPECIFICATION
SECTION-VI
BID DOCUMENT NO.:
32/CE/PLG/DCRTPP/FGD-251**





SUB-SECTION-II-E1


GENERAL ELECTRICAL SPECIFICATION


DCRTPP YAMUNA NAGAR (2X300 MW)
FLUE GAS DESULPHURISATION (FGD)
SYSTEM PACKAGE


TECHNICAL SPECIFICATION
SECTION-VI
BID DOCUMENT NO.:
32/CE/PLG/DCRTPP/FGD-251

CLAUSE NO.	 TECHNICAL REQUIREMENTS																		
1.00.00	General Requirements																		
1.01.00	For the purpose of design of equipment/systems, an ambient temperature of 50 deg. Centigrade and relative humidity of 95% shall be considered. The equipment shall operate in a highly polluted environment. However, for equipment in air conditioned areas, design ambient temperature shall be 35 deg.C, if 2x100% air conditioning system is provided unless specified specifically in relevant sub sections.																		
1.02.00	All equipment shall be suitable for rated frequency of 50Hz with a variation of +3% & -5%, and 10% combined variation of voltage and frequency unless specifically brought out in the specification.																		
1.03.00	Contractor shall provide fully compatible electrical system, equipment, accessories and services for the entire station/plant in his scope as well as those specifically required by the Employer.																		
1.04.00	All the equipment, material and systems shall, in general, conform to the latest edition of relevant National and International Codes & Standards, especially the Indian Statutory Regulations.																		
1.05.00	<p>The auxiliary AC voltage supply arrangement shall have 11 kV/3.3kV or 6.6 KV and 415V systems. It shall be designed to limit voltage variations as given below under worst operating condition:</p> <table border="0" data-bbox="341 1137 1114 1323"> <tr> <td>a)</td> <td>11KV/3.3KV/6.6 KV (MV)</td> <td>+/- 6%</td> </tr> <tr> <td>b)</td> <td>415 V/240 V</td> <td>+/- 10%</td> </tr> <tr> <td>c)</td> <td>220V/110V DC</td> <td>-15% to +10%</td> </tr> </table>			a)	11KV/3.3KV/6.6 KV (MV)	+/- 6%	b)	415 V/240 V	+/- 10%	c)	220V/110V DC	-15% to +10%							
a)	11KV/3.3KV/6.6 KV (MV)	+/- 6%																	
b)	415 V/240 V	+/- 10%																	
c)	220V/110V DC	-15% to +10%																	
1.06.00	<p>The voltage level for motors shall be as follows:</p> <table border="0" data-bbox="341 1429 1453 1765"> <tr> <td>a)</td> <td>Upto 0.2 KW</td> <td>:</td> <td>Single phase 240V AC / 3 phase 415V AC</td> </tr> <tr> <td>b)</td> <td>Above 0.2 KW and upto 200 KW</td> <td>:</td> <td>3 phase, 415V AC</td> </tr> <tr> <td>c)</td> <td>Above 200 KW and upto 1500 KW</td> <td>:</td> <td>3 phase, 3.3kV or 6.6kV AC</td> </tr> <tr> <td>d)</td> <td>Above 1500 KW</td> <td>:</td> <td>11 kV/6.6kV AC*</td> </tr> </table> <p>*Wherever only 6.6 kV & 415V is indicated in Electrical SLD, all motors above 200kW shall be 6.6 kV. Final selection of voltage levels shall be as per relevant tender SLD.</p>			a)	Upto 0.2 KW	:	Single phase 240V AC / 3 phase 415V AC	b)	Above 0.2 KW and upto 200 KW	:	3 phase, 415V AC	c)	Above 200 KW and upto 1500 KW	:	3 phase, 3.3kV or 6.6kV AC	d)	Above 1500 KW	:	11 kV/6.6kV AC*
a)	Upto 0.2 KW	:	Single phase 240V AC / 3 phase 415V AC																
b)	Above 0.2 KW and upto 200 KW	:	3 phase, 415V AC																
c)	Above 200 KW and upto 1500 KW	:	3 phase, 3.3kV or 6.6kV AC																
d)	Above 1500 KW	:	11 kV/6.6kV AC*																
DCRTPP YAMUNANAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E1 GENERAL ELECTRICAL SPECIFICATION	PAGE 1 OF 8																

CLAUSE NO.	 TECHNICAL REQUIREMENTS		
<p>1.07.00</p> <p>1.08.00</p> <p>1.09.00</p> <p>1.10.00</p> <p>1.11.00</p> <p>1.12.00</p> <p>1.13.00</p>	<p>The bidder may adopt 415V/3.3 KV or 6.6kV for the drives rated in the range of 160-210 KW.</p> <p>Voltage rating for special purpose motors viz, VFD shall be as per manufacturer's standard.</p> <p>The preferred AC control supply voltage shall be 110V for all 415 V non breaker controlled feeders. Control supply voltages other than above may be offered by bidder based on the bidder's standard proven practice.</p> <p>The designed fault levels for various voltage levels shall be restricted to the following values:</p> <p>11 kV- 40 kA rms for 1 sec</p> <p>3.3kV/6.6 kV- 40 kA rms for 1 sec</p> <p>415 V- 50kA rms for 1 sec</p> <p>Bidder shall submit suitable system studies and calculations to this effect during detailed engineering.</p> <p>The Contractor shall furnish calculations of maximum loading and fault levels under the most onerous conditions for the various equipment/systems as defined elsewhere in the specification to prove adequacy of their parameters. In case any equipment or system is found to be inadequate, it shall be changed/ modified without any additional liability to the Employer.</p> <p>Transformer voltage ratios, taps, impedances and tolerances thereon, shall be so optimized so that the auxiliary system voltages under various loading conditions are always within permissible limits and equipment are not subjected to unacceptable voltages during operation and starting of motors. The vector groups of the transformers shall be so selected that all the buses of particular voltage level have same vector within the plant.</p> <p>In fire hazardous areas like gas/ liquid fuel storage/ handling areas, lighting fixtures, switchgears shall be flame proof.</p> <p>The responsibility of coordination with electrical agencies /TAC/Pollution control board and obtaining all necessary clearances shall be of the contractor.</p> <p>Provenness Criteria</p> <p>Provenness of the Equipment, system, being offered by the bidder should satisfy the criteria Indicated in the "Provenness criteria" indicated elsewhere in the specification.</p>		
<p>DCRTPP YAMUNANAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251</p>	<p>SUB SECTION-II-E1 GENERAL ELECTRICAL SPECIFICATION</p>	<p>PAGE 2 OF 8</p>

CLAUSE NO.	 TECHNICAL REQUIREMENTS		
2.00.00	SIZING & DESIGN		
2.01.00	<p>Transformers</p> <p>All the transformers shall be sized based on the maximum load expected to be fed by them under most onerous conditions or as per the rating indicated in the Electrical Single Line Diagram.</p> <p>All Auxiliary transformers (unless their ratings have been indicated in Single line Diagram or for which sizing criteria has been indicated in the specification), shall be sized so as to have 10% margin at design ambient conditions after considering final load requirements, including owner's load (if applicable), at peak load conditions and the No Load Voltage Correction Factor.</p> <p>Transformer size = The calculated size X no load voltage correction factor (11.5/11, 3.45/3.3, 6.9/6.6, 0.433/0.415).</p> <p>No Load Voltage Correction Factor (= Transformer No Load voltage/ rated bus Voltage) shall be used for sizing of all transformers.</p> <p>2.01.01 Adequate number of auxiliary transformers shall be provided to meet the demand on 11kV and 3.3kV or 6.6kV and 415V systems under most onerous conditions, with the criteria that each 11kV / 3.3KV / 6.6KV/ 415 V switchgear / MCC / DB shall be fed by 2x100% or 3 X 50 % transformers / feeders, and these shall be rated to carry the maximum load expected to be imposed.</p> <p>2.01.02 The overall system shall be such that failure of any one unit auxiliary transformer, DC battery and Battery charger shall not reduce the capability or affect the safe shut down requirements of the FGD System.</p> <p>2.02.00 MV Switchgears</p> <p>Sizing of HT Switchgears (11kV/6.6kV/3.3 kV) shall be in accordance with Clause No. 1.00.00 of Sub-section E8 and its sub-clauses covering sizing criteria, standardization, etc.</p> <p>The switchgear boards shall have a single front, single tier, fully compartmentalized, metal enclosed construction complying with clause No. 3.102 of IEC 62271-200, comprising of a row of free standing floor mounted panels. The Service Class Continuity of Switchgears shall be LSC 2B-PM (as per IEC 62271-200). All busbars shall be provided with non-halogen based heat shrinkable polymer sleeves. The Circuit Breakers / Contactors / Bus VTs shall be mounted on withdraw able trucks which shall roll out horizontally from service position to isolated position. 11kV/6.6kV/3.3 kV Switchgear shall have an Internal Arc Classification of IAC FLR 40kA 1 sec. The Circuit Breakers / Contactors shall be of Vacuum type.</p>		
DCRTPP YAMUNANAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E1 GENERAL ELECTRICAL SPECIFICATION	PAGE 3 OF 8

CLAUSE NO.	 TECHNICAL REQUIREMENTS		
<p>2.03.00</p> <p>2.04.00</p> <p>2.05.00</p>	<p>All 11kV, 6.6kV and 3.3kV MV incomers from transformers or ties between switchgears shall be through bus ducts wherever switchgear rating is 1600Amp and above.</p> <p>LV Switchgears</p> <p>Sizing of LT Switchgears shall be in accordance with Clause No. 1.00.00 of Sub-section-II-E09 and its sub-clauses covering design considerations, layout criteria, standardization, etc.</p> <p>All switchboards shall be of double front, metal enclosed, indoor, floor-mounted, free-standing type of bolted design. Entire bus bar system shall be insulated with PVC sleeves. Cable terminations located in cable alley shall be designed to meet the Form IVb (as per IEC 61439) for safety purpose.</p> <p>All ACDBs, DCDBs, Solenoid Valve DBs and MCCs located on travelling trippers shall be of Fixed Module type. Other Switchboards having Air Circuit breaker modules and MCC modules shall be fully draw out type.</p> <p>The Circuit Breakers / Contactors shall be of air break type & should conform to the requirements of IS / IEC 60947. MCCB shall be provided for 100A, 125A, 160A, 250A & 400A supply feeders. Air circuit breaker shall be provided for supply feeders above 400A.</p> <p>Motor feeders below 110kW shall be contactor controlled. The motor feeders for 110kW & above shall be Air Circuit Breaker controlled.</p> <p>For 415V system, busduct assemblies shall be used for incoming connection from transformers to the switchboard and interconnecting sections between switchboards wherever transformer rating is 1000KVA or above. However, for transformers of 1000kVA rating, cable connection may also be acceptable in case of layout constraints.</p> <p>Control Philosophy</p> <p>The Control Philosophy shall be as follows:</p> <p>(a) All new switchgears and MCCs shall be controlled from PLC/DCS.</p> <p>(b) Wherever modification of owners HT switchgear is envisaged, Contractor shall make necessary provisions for owners's HT switchgear control from owners DDCMIS/Contractor's FGD DDCMIS/ PLC (as decided during detailed engineering). Necessary control wiring for this purpose also shall be in contractor's scope</p> <p>Cables and Bus Ducts</p> <p>The minimum rating of cable/ bus ducts shall meet the following criteria:</p>		
<p>DCRTPP YAMUNANAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251</p>	<p>SUB SECTION-II-E1 GENERAL ELECTRICAL SPECIFICATION</p>	<p>PAGE 4 OF 8</p>

CLAUSE NO.	 TECHNICAL REQUIREMENTS		
<p>2.06.00</p> <p>2.07.00</p>	<p>All the cables and bus ducts feeding switchboards from transformers shall be sized based on transformer ratings. All the cables and bus ducts feeding transformers shall be sized based on current ratings of transformer at the minimum voltage tap of the transformer. All other cables/bus-ducts shall be sized based on the load demand under most onerous conditions.</p> <p>Cables shall be selected to so as to limit maximum voltage drop at equipment terminals during normal operation and starting conditions well within permissible values. Cables shall be de-rated for the site ambient and ground temperatures, grouping and soil resistivity and cable laying configuration.</p> <p>All HT cables shall be of unearthed grade. The bidder shall furnish detailed cable selection/sizing criteria for Employer's approval.</p> <p>Earthing & Lightning Protection System</p> <p>The earthing system for plant shall be designed for a life expectancy of at least forty (40) years, for a system fault current of 50 kA for 1.0 sec. The minimum rate of corrosion of steel for selection of earthing conductor shall be 0.12mm per year.</p> <p>Grounding and lightning protection for the entire power plant, switchyard and other areas or buildings covered in the specification shall be provided in accordance with IS 3043, IEC-62305, IEEE 80.</p> <p>D.C. Systems</p> <p>Complete DC system, comprising of batteries, battery charges, relays, contactors, timers etc shall be suitable for continuous operation at the maximum continuous float voltage including suitable temperature correction factors.</p> <p>The battery sizing shall be done based on different types of continuous and intermittent loads including motor starting (wherever applicable) under complete blackout condition, for the duration specified so as to meet the system requirement (30 minutes minimum). All intermittent loads shall be considered with minimum 1 minute duration. The battery shall be sized considering a minimum electrolyte temperature of 15Deg C along with temperature correction factors as per relevant standard. An ageing factor of 1.25 shall be considered. The no. of cells and end cell voltage shall be considered based on the minimum and maximum voltage window and cable drop etc. as per system requirement.</p> <p>Each system shall comprise of two nos. of batteries and two nos. of float-cum-boost chargers each rated for 100% capacity. DC scheme shall ensure that each critical consumer is fed from two different bus sections. DCDBs shall provide adequate number of feeders on each section.</p>		
<p>DCRTPP YAMUNANAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251</p>	<p>SUB SECTION-II-E1 GENERAL ELECTRICAL SPECIFICATION</p>	<p>PAGE 5 OF 8</p>

CLAUSE NO.



TECHNICAL REQUIREMENTS

Boost/ fast charging time shall be as per worst operating condition and would satisfy technical requirements recommended by battery manufacturer. Each battery charger must be capable of supplying all the continuous D.C. loads (fed through both section of DCDB) plus the trickle charging current of both the batteries. In addition, each charger must have sufficient surplus capacity for running of the largest D.C auxiliary so that the battery is not drained during testing of the same. Battery charger should also be capable of boost/ fast charge the battery from completely discharged condition to fully charged condition without imposing any limitations under worse operating conditions. Battery size shall be as per the following:

Area	DC Voltage	Load	Minimum Battery Bank Rating
FGD	220 V	supply total DC load of the associated area at an acceptable voltage for at least 30 minutes including DC Lighting	150AH for lead acid Plante type /90 AH for Ni-Cd High Discharge (KPH) type batteries

2.08.00

Diesel Generator Set

Diesel Generating set(s) shall be provided as per system requirement for safe shut down of the FGD system/plant under emergency conditions and in case of total power failure. DG set(s) shall be capable of meeting 100 % of essential load requirements of FGD System including starting of the largest motor (DOL) with other loads connected without exceeding the permissible starting voltage drop.

2.09.00

PLC based control system wherever envisaged shall be provided with 100% redundancy i.e. hot standby.

3.00.00


NOT USED


4.00.00

INSULATION LEVEL

The insulation level for the transformer windings and bushings shall be as follows:

	WINDING		BUSHING	
Highest System Voltage	Rated Power	Rated lightning	Rated Power	Rated lightning
	Freq. withstand	impulse withstand	freq. withstand	impulse withstand
	Voltage (kVrms)	voltage (kVp)	voltage (kV rms)	voltage (kVp)

CLAUSE NO.	 TECHNICAL REQUIREMENTS				
	0.433 KV	3	-	3	-
	3.6 kV	10	40	11	40
	7.2 kV	20	60	22	60
	12 kV	28	75	30	75
	36 kV	70	170	77	170
	132 kV	275/38*	650	305	650
	245 kV	395/38*	950/1050**	505	1050/1050**
	* In case of non-uniformly insulated.		** Chopped wave BIL.		
5.00.00	NOT USED				
6.00.00	Neutral Grounding				
6.01.00	11KV/3.3KV/6.6KV system earthing shall be low resistance earthed type to limit earth fault current to 600A. The resistor shall be rated to carry this current at least for 10 seconds.				
6.02.00	Neutrals of all LT Transformers (415V) shall be solidly earthed through bolted links.				
6.03.00	6.04.00	220V DC/110V DC system shall be kept ungrounded.			
6.05.00	Diesel generator (if applicable) shall also be kept ungrounded (earthing through PT).				
7.00.00	FAULT LEVEL				
	Equipment through fault withstand capabilities under worst operating conditions duly taking into account negative tolerances on transformer and maximum fault levels of source etc. shall be as follows :				
	i)	All transformers	- 2 seconds		
	ii)	11 kV/3.3/6.6 KV busduct	- 1 second		
	iii)	All Switchgears	- 1 second		
	iv)	Cables to the feeders protected by breakers	Main protection fault clearing time with 0.12 seconds minimum		
DCRTPP YAMUNANAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E1 GENERAL ELECTRICAL SPECIFICATION	PAGE 7 OF 8		

CLAUSE NO.	 TECHNICAL REQUIREMENTS		
	v) Cables of all other feeders vi) 11KV & 3.3KV/6.6 KV cable screen	As per fuse operating time - 2 seconds for the adopted ground fault current (600A)	
DCRTPP YAMUNANAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E1 GENERAL ELECTRICAL SPECIFICATION	PAGE 8 OF 8





SUB-SECTION-II-E2


MOTORS


**DCRTPP YAMUNA NAGAR (2X300 MW)
FLUE GAS DESULPHURISATION (FGD)
SYSTEM PACKAGE**


**TECHNICAL SPECIFICATION
SECTION-VI
BID DOCUMENT NO.:
32/CE/PLG/DCRTPP/FGD-251**


CLAUSE NO.	 TECHNICAL REQUIREMENTS		
	MOTORS		
1.00.00	GENERAL REQUIREMENTS		
1.01.00	For the purpose of design of equipment/systems, an ambient temperature of 50 deg. Centigrade and relative humidity of 95% (at 40 deg C) shall be considered. The equipment shall operate in a highly polluted environment.		
1.02.00	All equipment shall be suitable for rated frequency of 50 Hz with a variation of +3% & -5%, and 10% combined variation of voltage and frequency unless specifically brought out in the specification.		
1.03.00	Contractor shall provide fully compatible electrical system, equipment, accessories and services.		
1.04.00	All the equipment, material and systems shall, in general, conform to the latest edition of relevant National and international Codes & Standards, especially the Indian Statutory Regulations.		
1.05.00	Paint shade shall be as per RAL 5012 (Blue) for indoor and outdoor equipment.		
1.06.00	The responsibility of coordination with electrical agencies and obtaining all necessary clearances for contractors equipment and systems shall be under the contractor scope.		
1.07.00	Degree of Protection Degree of protection for various enclosures as per IEC60034-05 shall be as follows:-		
	i) Motors	-	IP 55
	ii) Cable box	-	IP 55
	All outside motors shall be provided with canopy of adequate size to ensure no water ingress to motor.		
2.00.00	CODES AND STANDARDS		
	1) Three phase induction motors	:	IS/IEC:60034
	2) Single phase AC motors	:	IS/IEC:60034
	3) Crane duty motors	:	IS:3177, IS/IEC:60034
	4) DC motors/generators	:	IS/IEC:60034
	5) Energy Efficient motors	:	IS 12615, IEC: 60034-30
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI BID DOC.NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB-SECTION-II-E2 MOTORS	PAGE 1 OF 10

CLAUSE NO.	 TECHNICAL REQUIREMENTS		
	<p>80 deg. C over inlet cooling water temperature mentioned elsewhere, by resistance method for thermal class 130(B) & 155(F) insulation.</p> <p>6.00.00 OPERATIONAL REQUIREMENTS</p> <p>6.01.00 Starting Time</p> <p>6.01.01 For motors with starting time upto 20 secs. at minimum permissible voltage during starting, the locked rotor withstand time under hot condition at highest voltage limit shall be at least 2.5 secs. more than starting time.</p> <p>6.01.02 For motors with starting time more than 20 secs. and upto 45 secs. at minimum permissible voltage during starting, the locked rotor withstand time under hot condition at highest voltage limit shall be at least 5 secs. more than starting time.</p> <p>6.01.03 For motors with starting time more than 45 secs. at minimum permissible voltage during starting, the locked rotor withstand time under hot condition at highest voltage limit shall be more than starting time by at least 10% of the starting time.</p> <p>6.01.04 Speed switches mounted on the motor shaft shall be provided in cases where above requirements are not met.</p> <p>6.02.00 Torque Requirements</p> <p>6.02.01 Accelerating torque at any speed with the lowest permissible starting voltage shall be at least 10% of motor rated torque.</p> <p>6.02.02 Pull out torque at rated voltage shall not be less than 205% of rated torque. It shall be 275% for crane duty motors.</p> <p>6.03.00 Starting voltage requirement</p> <p>(a) Up to 85% of rated voltage for ratings below 110 KW</p> <p>(b) Up to 80% of rated voltage for ratings from 110 KW to 200 KW</p> <p>(c) Up to 85% of rated voltage for ratings from 201 KW to 1000 KW</p> <p>(d) Up to 80% of rated voltage for ratings from 1001 KW to 4000 KW</p> <p>(e) Up to 75 % of rated voltage for ratings above 4000KW</p> <p>Except AOP & JOP motors running on D.G emergency supply, starting voltage shall be 80%.</p>		
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI BID DOC.NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB-SECTION-II-E2 MOTORS	PAGE 3 OF 10

CLAUSE NO.	 TECHNICAL REQUIREMENTS		
7.00.00 7.01.00 7.02.00 7.03.00 7.04.00 7.05.00 7.06.00	DESIGN AND CONSTRUCTIONAL FEATURES Suitable single phase space heaters shall be provided on motors rated 30KW and above to maintain windings in dry condition when motor is standstill. Separate terminal box for space heaters & RTDs shall be provided. However for flame proof motors, space heater terminals inside the main terminal box may be acceptable. All motors shall be either Totally enclosed fan cooled (TEFC) or totally enclosed tube ventilated (TETV) or Closed air circuit air cooled (CACW) type. However, motors rated 3000KW or above can be Closed air circuit water cooled (CACW). The method of movement of primary and secondary coolant shall be self-circulated by fan or pump directly mounted on the rotor of the main motor as per IEC 60034-6. However VFD driven motors can be offered with forced cooling type with machine mounted fan or pump driven by separate electric motor. Winding and Insulation (a) Type : Non-hygroscopic, oil resistant, flame resistant (b) Starting duty : Two hot starts in succession, with motor initially at normal running temperature. (c) 11kV & 3.3 kV AC motors : Thermal class 155 (F) insulation. The winding insulation process shall be Global Vacuum Pressure Impregnated i.e. resin poor method. The lightning Impulse & inter-turn insulation surge withstand level shall be as per IEC-60034 part-15. (d) 240VAC, 415V AC : Thermal Class (F) or better (e) 220V DC motors : Thermal Class (H) or better Motors rated above 1000KW shall have insulated bearings/housing to prevent flow of shaft currents. Motors with heat exchangers shall have dial type thermometer with adjustable alarm contacts to indicate inlet and outlet primary air temperature. Noise level for all the motors shall be limited to 85dB (A). Vibration shall be limited within the limits prescribed in IS/IEC 60034-14. Motors shall withstand vibrations produced by driven equipment. HT motor bearing housings shall have flat surfaces, in both X and Y directions, suitable for mounting 80mmX80mm vibration pads.		
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI BID DOC.NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB-SECTION-II-E2 MOTORS	PAGE 4 OF 10

CLAUSE NO.	 TECHNICAL REQUIREMENTS														
7.07.00	In HT motors, at least four numbers simplex / two numbers duplex platinum resistance type temperature detectors shall be provided in each phase stator winding. Each bearing of HT motor shall be provided with dial type thermometer and 2 numbers duplex platinum resistance type temperature detectors.														
7.08.00	Motor body shall have two earthing points on opposite sides.														
7.09.00	11 KV motors shall be offered with Separable Insulated Connector (SIC) as per IEEE 386. The offered SIC terminations shall be provided with protective cover and trifurcating sleeves. SIC termination kit shall be suitable for fault level of 25 KA for 0.17 seconds.														
7.10.00	3.3 KV motors shall be offered with dust tight phase separated double walled (metallic as well as insulated barrier) Terminal box. Suitable termination kit shall be provided for the offered Terminal box. The offered Terminal Box shall be suitable for fault level of 250 MVA for 0.12 sec. Removable gland plates of thickness 3 mm (hot/cold rolled sheet steel) or 4 mm (non-magnetic material for single core cables) shall be provided.														
7.11.00	The spacing between gland plate & center of bottom terminal stud shall be as per Table-I.														
7.12.00	All motors shall be so designed that maximum inrush currents and locked rotor and pullout torque developed by them at extreme voltage and frequency variations do not endanger the motor and driven equipment.														
7.13.00	The motors shall be suitable for bus transfer schemes provided on the 11kV, 3.3 kV /415V systems without any injurious effect on its life.														
7.14.00	For motors rated 2000 KW & above, neutral current transformers of PS class shall be provided on each phase in a separate neutral terminal box.														
7.15.00	The size and number of cables (for HT and LT motors) to be intimated to the successful bidder during detailed engineering and the contractor shall provide terminal box suitable for the same.														
8.00.00	<p>The ratio of locked rotor KVA at rated voltage to rated KW shall not exceed the following (without any further tolerance).</p> <table data-bbox="379 1637 1118 1883"> <tbody> <tr> <td>(a) From 50KW & upto 110KW</td> <td>:</td> <td>11.0</td> </tr> <tr> <td>(b) From 110 KW & upto 200 KW</td> <td>:</td> <td>9.0</td> </tr> <tr> <td>(c) Above 200 KW & upto 1000KW</td> <td>:</td> <td>10.0</td> </tr> <tr> <td>(d) From 1001KW & upto 4000KW</td> <td>:</td> <td>9.0</td> </tr> </tbody> </table>			(a) From 50KW & upto 110KW	:	11.0	(b) From 110 KW & upto 200 KW	:	9.0	(c) Above 200 KW & upto 1000KW	:	10.0	(d) From 1001KW & upto 4000KW	:	9.0
(a) From 50KW & upto 110KW	:	11.0													
(b) From 110 KW & upto 200 KW	:	9.0													
(c) Above 200 KW & upto 1000KW	:	10.0													
(d) From 1001KW & upto 4000KW	:	9.0													
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI BID DOC.NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB-SECTION-II-E2 MOTORS	PAGE 5 OF 10												

CLAUSE NO.	 TECHNICAL REQUIREMENTS		
	(e) Above 4000KW : 6 to 6.5		
10.00.00	TYPE TEST		
10.01.00	HT MOTORS		
10.01.01	The contractor shall carry out the type tests as listed in this specification on the equipment to be supplied under this contract. The bidder shall indicate the charges for each of these type tests separately in the relevant schedule of Section - VII- (BPS) and the same shall be considered for the evaluation of the bids. The type tests charges shall be paid only for the test(s) actually conducted successfully under this contract and upon certification by the employer's engineer.		
10.01.02	The type tests shall be carried out in presence of the employer's representative, for which minimum 15 days notice shall be given by the contractor. The contractor shall obtain the employer's approval for the type test procedure before conducting the type test. The type test procedure shall clearly specify the test set-up, instruments to be used, procedure, acceptance norms, recording of different parameters, interval of recording, precautions to be taken etc. for the type test(s) to be carried out.		
10.01.03	In case the contractor has conducted such specified type test(s) within last ten years as on the date of bid opening, he may submit during detailed engineering the type test reports to the employer for waiver of conductance of such test(s). These reports should be for the tests conducted on the equipment similar to those proposed to be supplied under this contract and test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client. The employer reserves the right to waive conducting of any or all the specified type test(s) under this contract. In case type tests are waived, the type test charges shall not be payable to the contractor.		
10.01.04	Further the Contractor shall only submit the reports of the type tests as listed in "LIST OF TESTS FOR WHICH REPORTS HAVE TO BE SUBMITTED "and carried out within last ten years from the date of bid opening. These reports should be for the test conducted on the equipment similar to those proposed to be supplied under this contract and the test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client. However if the contractor is not able to submit report of the type test(s) conducted within last ten years from the date of bid opening, or in the case of type test report(s) are not found to be meeting the specification requirements, the contractor shall conduct all such tests under this contract at no additional cost to the employer either at third party lab or in presence of client/ employer's representative and submit the reports for approval.		
10.01.05	LIST OF TYPE TESTS TO BE CONDUCTED		
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI BID DOC.NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB-SECTION-II-E2 MOTORS	PAGE 6 OF 10

CLAUSE NO.	 TECHNICAL REQUIREMENTS		
	<p>The following type tests shall be conducted on each type and rating of HT motor</p> <ul style="list-style-type: none"> (a) No load saturation and loss curves upto approximately 115% of rated voltage (b) Measurement of noise at no load. (c) Momentary excess torque test (subject to test bed constraint). (d) Full load test (subject to test bed constraint) (e) Temperature rise test at rated conditions. During heat run test, bearing temp., winding temp., coolant flow and its temp. shall also be measured. In case the temperature rise test is carried at load other than rated load, specific approval for the test method and procedure is required to be obtained. Wherever ETD's are provided, the temperature shall be measured by ETD's also for the record purpose. <p>10.01.06 LIST OF TESTS FOR WHICH REPORTS HAVE TO BE SUBMITTED</p> <p>The following type test reports shall be submitted for each type and rating of HT motor</p> <ul style="list-style-type: none"> (a) Degree of protection test for the enclosure followed by IR, HV and no load run test. (b) Terminal box-fault level withstand test for each type of terminal box of HT motors only. (c) Lightning Impulse withstand test on the sample coil shall be as per clause no. 4.3 IEC-60034, part-15 (d) Surge-withstand test on interturn insulation shall be as per clause no. 4.2 of IEC 60034, part-15 <p>10.02.00 LT Motors</p> <p>10.02.01 LT Motors supplied shall be of type tested design. During detailed engineering, the contractor shall submit for employer's approval the reports of all the type tests as listed in this specification and carried out within last <i>ten</i> years from the date of bid opening. These reports should be for the test conducted on the equipment similar to those proposed to be supplied under this contract and the test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client.</p>		
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI BID DOC.NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB-SECTION-II-E2 MOTORS	PAGE 7 OF 10


CLAUSE NO.	 TECHNICAL REQUIREMENTS		
10.02.02	<p>However if the contractor is not able to submit report of the type test(s) conducted within last ten years from the date of bid opening, or in the case of type test report(s) are not found to be meeting the specification requirements, the contractor shall conduct all such tests under this contract at no additional cost to the employer either at third party lab or in presence of client/ employer's representative and submit the reports for approval.</p>		
10.02.03	<p>LIST OF TESTS FOR WHICH REPORTS HAVE TO BE SUBMITTED</p> <p>The following type test reports shall be submitted for each type and rating of LT motor of above 100 KW only</p> <ol style="list-style-type: none"> 1. Measurement of resistance of windings of stator and wound rotor. 2. No load test at rated voltage to determine input current power and speed 3. Open circuit voltage ratio of wound rotor motors (in case of Slip ring motors) 4. Full load test to determine efficiency power factor and slip. 5. Temperature rise test. 6. Momentary excess torque test. 7. High voltage test. 8. Test for vibration severity of motor. 9. Test for noise levels of motor(Shall be limited as per clause no 7.06.00 of this section) 10. Test for degree of protection and 11. Over speed test. 12. Type test reports for motors located in fuel oil area having flame proof enclosures as per IS 2148 / IEC 60079-1 		
10.03.00	<p>All acceptance and routine tests as per the specification and relevant standards shall be carried out. Charges for these shall be deemed to be included in the equipment price.</p>		
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI BID DOC.NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB-SECTION-II-E2 MOTORS	PAGE 8 OF 10



TABLE - I

DIMENSIONS OF TERMINAL BOXES FOR LV MOTORS

Motor MCR in KW	Minimum distance between centre of bottom terminal stud and gland plate in mm
UP to 3 KW	As per manufacturer's practice.
Above 3 KW - upto 7 KW	85
Above 7 KW - upto 13 KW	115
Above 13 KW - upto 24 KW	167
Above 24 KW - upto 37 KW	196
Above 37 KW - upto 55 KW	249
Above 55 KW - upto 90 KW	277
Above 90 KW - upto 125 KW	331
Above 125 KW-upto 200 KW	385/203 (For Single core cables only)

For HT motors the distance between gland plate and the terminal studs shall not be less than 500 mm.

CLAUSE NO.



TECHNICAL REQUIREMENTS

PHASE TO PHASE/ PHASE TO EARTH AIR CLEARANCE:

Minimum inter-phase and phase-earth air clearances for LT motors with lugs installed shall be as follows:

Motor MCR in KW	Clearance
UP to 110 KW	10mm
Above 110 KW and up to 150 KW	12.5mm
Above 150 KW	19mm



SUB-SECTION-II-E3

MEDIUM VOLTAGE BUS DUCTS

**DCRTPP YAMUNA NAGAR (2X300 MW)
FLUE GAS DESULPHURISATION (FGD)
SYSTEM PACKAGE**

**TECHNICAL SPECIFICATION
SECTION-VI
BID DOCUMENT NO.:
32/CE/PLG/DCRTPP/FGD-251**



MEDIUM VOLTAGE BUSDUCTS (Rating & Type clause as applicable)

1.01.00

CODES & STANDARDS


1.02.00


All standards, specifications and codes of practice referred to herein shall be the latest editions including all applicable official amendments and revisions as on date of opening of bid. In case of conflict between this specification and those (IS codes, standards etc.) referred to herein, the former shall prevail. All work shall be carried out as per the following standards and codes.


STANDARD	DESCRIPTION
IS:2062	Steel for General Purpose specification.
IS:737	Specification for wrought aluminum and aluminum alloys, sheet and strip (for engineering purpose).
IS:800	Code of practice for use of structural steel in general building construction.
IS:1367 PART-13	Hot dip galvanised coatings on threaded fasteners.
IS:2099	Bushing for A.C. voltage above 1000 volts.
IS:13947 PART-1	Low voltage switchgear & controlgear
IS:2544	Porcelain post Insulators for system with normal voltage greater than 1000 volts.
IS:2633	Methods of testing uniformity of coating on zinc coated articles
IS:4759	Hot dip zinc coating on structural steel and allied products.
IS:5082	Specification for wrought Aluminum alloys bars, rods, tubes and sections for electrical purposes.
IS:8084 Updated upto:1992	Interconnecting bus bars for A.C. voltage above 1KV upto and including 36KV.
ANSI C37:20	Switchgear Assemblies including Metal enclosed Bus.


1.03.00


Equipment complying with other internationally accepted standards such as IEC, BS, ANSI, VDE etc. will also be considered if they ensure performance and constructional features equivalent or superior to standards listed above. In such a case, the Bidder shall clearly indicate the standards adopted, furnish a copy in English of the latest revision of the standards alongwith copies of all official amendments and revisions in force as on date of opening of bid and shall clearly bring out the salient features for comparison.


CLAUSE NO.	 TECHNICAL REQUIREMENTS		
1.04.00	Installation work shall also conform to Indian Electricity Act and Indian Electricity Rules as amended upto date.		
2.00.00	GENERAL TECHNICAL REQUIREMENTS		
2.01.00	The busduct will serve as interconnections between transformers and switchgears, and between switchgears. The technical parameters of busduct (11KV, 6.6 KV & 3.3 KV) are enclosed at Annexure-A to this section.		
2.02.00	The busduct will be installed partially indoors and partially outdoors in a hot, humid and tropical atmosphere.		
2.03.00	The maximum temperature of the bus conductor and enclosure shall be as defined in the technical parameters when operating at maximum ambient temperature and carrying rated current continuously. For outdoor portions the effect of solar radiation shall also be considered. The bidder shall furnish calculation for temperature rise taking effect of solar radiation into consideration.		
2.04.00	The busduct shall be capable of withstanding the mechanical forces and thermal effects of three phase short circuit currents, mentioned in the technical parameters at ANNEXURE-A, without any damage, deformation or deterioration of material.		
3.00.00	EQUIPMENT DESCRIPTION		
3.01.00	Bus Conductor		
3.01.01	The bus conductor shall be of high conductivity aluminum alloy, adequately supported on insulators to withstand dynamic stress due to the specified short circuit current, without permanent deformation.		
3.01.02	Flexible joints shall be provided between busduct sections to take care of expansion and contraction, wherever deemed necessary by the Bidder, for temperature variations between 0 Deg. C. and that achieved during a short circuit after full load operation at 50 Deg. C. ambient. Flexible connection shall also be provided for termination at each transformer and switchgear end. Details of transformer bushings and switchgear terminals for owners scope (if any) shall be intimated to the successful bidder during the detailed engineering stage. Clearances provided by removable connections shall be adequate for independently testing the equipment being connected by these.		
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E3 Medium Voltage Busducts	PAGE 2 OF 9

CLAUSE NO.	 TECHNICAL REQUIREMENTS		
3.01.03	<p>Adjacent sections of bus conductors shall be welded or bolted. Welded joints shall be preferred. Welding procedure shall be subject to Employer's approval. Bolted joints shall preferably be silver plated. Non-silver plated joints shall be thoroughly cleaned and applied with non-oxide grease immediately prior to making the joints.</p>		
3.01.04	<p>All bus joints and connections whether welded or bolted shall be so made that their resistance does not exceed the resistance of an equivalent length of bus of same size and the temperature rise on them shall be within the guaranteed values.</p>		
3.02.00	Enclosure		
3.02.01	<p>The three phases of bus conductors shall be enclosed in weather and vermin proof, dust-tight enclosure made of Aluminum alloy. The shape of the enclosure shall preferably be rectangular. All horizontal runs of the busduct shall have a suitably sloped enclosure top to prevent retention of water. The busduct enclosure shall be phase segregated type.</p>		
3.02.02	<p>Busduct enclosure shall have a degree of protection of IP-5X in accordance with IS:13947, pt.- I. Busduct shall also meet the requirements for water tightness test & air leakage test.</p>		
3.02.03	<p>The busduct enclosure shall have expansion bellows to take care of temperature changes and vibrations. Flexible joints shall be provided in enclosures at all points where the busduct terminates at equipment to withstand vibration expansion/contraction and at suitable intervals in any straight run of busduct where expansion and contraction would otherwise result in stresses in the supporting structures.</p>		
3.02.04	<p>Inspection openings/split covers shall be provided to allow easy access for installation, inspection, replacement or repairs of the insulators, bus connection and terminations. The inspection openings/split covers, enclosure joints, termination etc. shall have reliable sealing arrangement with neoprene/rubber gaskets to prevent dust & water entry.</p>		
3.02.05	<p>At each enclosure joint in the outdoor portion of the busduct run, a suitable rain hood shall be provided for additional protection against water ingress. The gaskets shall preferably of the jointless type, in case of a joint, the same shall be at bottom.</p>		
3.02.06	<p>Seal-off bushings complete with wall frames and support plates shall be provided where the busduct crosses from indoor to outdoor portion. The seals are to prevent exchange of air between indoor and out-door portions of the busducts. Seal off bushings shall also be provided on each busduct</p>		
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E3 Medium Voltage Busducts	PAGE 3 OF 9

CLAUSE NO.	 TECHNICAL REQUIREMENTS		
	<p>termination on a switchgear. Where busduct cross building internal wall only wall frame assemblies shall be provided.</p>		
3.02.07	<p>The busduct enclosure shall be adequately rigid and stiffeners shall be provided wherever necessary. Minimum enclosure thickness shall be 3 mm.</p>		
3.02.08	<p>Phase barriers made of aluminum alloy shall be provided in the busduct for phase segregation. Minimum thickness shall be 3 mm.</p>		
3.02.09	<p>Opening covered with louvers backed up with removable dust filters and silica gel breather shall be provided at indoor & outdoor portion of busduct to enable the busduct enclosure to breathe in a manner so that possibility of condensation and ingress of dust is minimised.</p>		
3.02.10	<p>Filtered drain plugs for drainage of condensate and seepage water if any shall be provided at the lowest points and at such location where accumulation of condensate can be expected. These drain plugs shall be located at a suitable place convenient to operate.</p>		
3.03.00	Insulators		
3.03.01	<p>Bus support insulators shall be interchangeable, high creep, high strength and made of fine glazed solid porcelain manufactured by wet process or high strength cast resin insulators.</p>		
3.03.02	<p>The insulators shall be designed and mounted in such a manner so as to facilitate easy inspection, removal and replacement without disturbing the conductor.</p>		
3.03.03	<p>The conductors shall be fixed to the insulator so to permit differential expansion and contraction with the enclosure without overstressing the insulators. The insulators shall be designed to safely withstand the maximum possible short circuit forces.</p>		
3.03.04	<p>All bolts, nuts and lock washers used in the bus assembly shall be high tensile steel, plated for corrosion resistance. Spring washers or equivalent means shall be used for ensuring good contact pressure under all operating conditions. All bolts shall be tightened using properly calibrated torque spanner by applying the recommended torque.</p>		
3.04.00	Space Heaters		
3.04.01	<p>The busduct shall be provided with adequate number of thermostatically controlled space heaters of adequate capacity to maintain the internal</p>		
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E3 Medium Voltage Busducts	PAGE 4 OF 9

CLAUSE NO.	 TECHNICAL REQUIREMENTS		
	<p>temperature above the dew point to prevent moisture condensation within the busduct. Space heaters shall be rated for 240V, single phase, 50Hz AC supply.</p> <p>3.04.02 The space heaters and thermostats shall be wired upto terminals in suitably located terminal boxes to be provided by the contractor. The space heater wiring inside the busduct enclosure shall be done with high temperature resistant cables as the ambient temperature existing inside the busduct enclosure may vary from 80 deg.C to 90 deg.C. The minimum conductor size of space heater wiring shall be 2.5 sq.mm. A separate ON/OFF switch shall be provided for controlling the space heaters of each busduct in the marshalling box located at convenient height. One number single phase 240V power supply at the marshalling box for complete run of every busduct shall be provided by employer. All cabling between space heaters/thermostats and marshalling box in the run of busduct shall be supplied and erected by the contractor. Cable entry points to the busduct shall be sealed properly by providing suitable glands.</p> <p>3.05.00 Busduct Support</p> <p>3.05.01 Bidder shall provided necessary support structures and all hardware structures to support the busduct all along its route.</p> <p>3.05.02 The design of the support structure shall conform to IS:800. Suitable members shall be provided along the outdoor support structure for supporting cable trays (if any).</p> <p>3.05.03 In the indoor portions, the busduct shall be supported from floor / roof beams or steel inserts in upper floors. In the outdoor potions, they shall be supported from the ground, by means of steel structures, unless indicated otherwise in the specification drawings.</p> <p>3.05.04 All steel structures required for busduct support shall be hot dip galvanised and shall be strong enough to cater for various static and dynamic loading such as weight of busduct, short circuit forces, wind load, thermal expansion and contraction etc.</p> <p>3.05.05 All hardware shall be galvanised or cadmium plated.</p> <p>3.06.00 Earthing</p> <p>3.06.01 Adequately sized galvanised mild steel or aluminium earth bar shall be provided along the entire run of each busduct. Each section of the busduct enclosure shall be bonded to this earth bar at least at both ends</p>		
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E3 Medium Voltage Busducts	PAGE 5 OF 9

CLAUSE NO.	 TECHNICAL REQUIREMENTS		
	<p>of the enclosure. The earth bar shall be connected to the main earthing system at its two ends by the contractor.</p> <p>3.07.00 Connection and Termination</p> <p>3.07.01 All matching flanges, flexible connections, adopter boxes, gaskets, fittings, hardware and support required for termination of the busduct at transformer and switchgear ends, shall be provided by the Bidder.</p> <p>3.08.00 The bidder shall co-ordinate, through the Employer/Project Manager, with the suppliers of the transformers and switchgears (if any), regarding the termination details.</p> <p>3.08.01 Flexible connections at equipment termination shall be able to take care of misalignment upto 25 mm in all directions.</p> <p>3.08.02 The equipment terminal connections shall be easily accessible and shall provide sufficient air gap for safe isolation of equipment during testing.</p> <p>3.08.03 All hardware used in the MV Busduct shall be non-magnetic.</p> <p>3.08.04 Suitable bi-metallic connectors shall be provided wherever the material of bus conductor and equipment terminals are different.</p> <p>3.09.00 Paint and Finish</p> <p>3.09.01 All surfaces shall be thoroughly cleaned and cleared of all blemishes. De-rusting, degreasing etc. shall be done before painting or galvanising. Paints shall be carefully selected to withstand heat and weather conditions. The paints shall not scale off or crinkle or get removed by abrasion due to normal handling.</p> <p>3.09.02 The paints shall consist of one coat of primer followed by one anti-corrosive coat for steel structures. Finally two coast of finishing paint shall be given. The final colour shade shall be BLUE RAL: 5012.</p> <p>3.09.03 The bus conductor and the inside surface of the enclosure shall be treated with matt black paint for efficient heat dissipation.</p> <p>3.09.04 Sufficient quantity of all paints required for touching up at site, shall be provided.</p>		
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E3 Medium Voltage Busducts	PAGE 6 OF 9

CLAUSE NO.	 TECHNICAL REQUIREMENTS				
<p>4.00.00</p> <p>4.01.01</p> <p>4.01.02</p> <p>4.01.03</p> <p>4.01.04</p> <p>4.01.01</p> <p>4.02.00</p>	<p>TYPE & ROUTINE TESTS</p> <p>All equipments to be supplied shall be of type tested design. During detailed engineering, the contractor shall submit for Employer’s approval the reports of all the type tests as listed in this specification and carried out within last ten years from the date of bid opening. These reports should be for the test conducted on the equipment similar to those proposed to be supplied under this contract and the test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client.</p> <p>However if the contractor is not able to submit report of the type test(s) conducted within last ten years from the date of bid opening, or in the case of type test report(s) are not found to be meeting the specification requirements, the contractor shall conduct all such tests under this contract at no additional cost to the Employer either at third party lab or in presence of client /Employers representative and submit the reports for approval.</p> <p>All acceptance and routine tests as per the specification and relevant standards shall be carried out. Charges for these shall be deemed to be included in the equipment price.</p> <p>LIST OF TYPE TESTS</p> <p>Medium voltage Busduct</p> <p>The following type tests reports to be submitted on each rating of bus ducts:</p> <ul style="list-style-type: none"> (a.) Heat run test (the set up shall include 3 phase straight run, 90 deg. bend, set of flexible connection of each type, and necessary inspection covers). (b.) Short circuit withstand test (set up same as for heat run). (c.) Impulse withstand test (set up shall include typical X-section with flexible connections, 90 degree bend, seal off bushing and inspection cover. (d.) Air leakage rate and Water tightness test (set up shall include inspection cover, flanged joint and bellow). <p>ROUTINE TESTS</p> <p>Routine tests shall be conducted at manufactures works on each busduct and all other components as per relevant Indian Standards & Quality Assurance Sub-section.</p>	<p>DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251</p>	<p>SUB SECTION-II-E3 Medium Voltage Busducts</p>	<p>PAGE 7 OF 9</p>



ANNEXURE-A

S.No.	PARAMETER	11KV BUSDUCT	6.6KV BUSDUCT	3.3KV BUSDUCT
(1.)	Number of phase	3	3	3
(2.)	Frequency	50 Hz	50 Hz	50 Hz
(3.)	Nominal voltage	11KV	6.6KV	3.3 KV
(4.)	Highest system voltage	12KV	7.2KV	3.6 KV
(5.)	One minute power Frequency Withstand voltage (Dry & wet)	35KV	27KV	21KV
(6.)	Impulse voltage withstand value with 1.2/50 microsecond wave shape	75KV	60KV	40 KV
(7.)	Continuous current rating at 50 ⁰ C ambient	As per system requirement	As per system requirement	As per system requirement.
(8.)	Short time current rating for 1 second	40KA (rms)	40KA (rms)	40KA (rms)
(9.)	Dynamic current withstand rating.	100 KA(peak)		
(10.)	Type of Cooling	Natural		
(11.)	Type of Bus enclosure	Phase segregated		
(12.)	Service	Indoor/Outdoor		
(13.)	Minimum clearance of live parts in Air	Shall be as per type tested set up piece		
	a)Phase to phase	-do-		
	b)Phase to earth	-do-		
(14.)	Busbar Material	Aluminum alloy		
(15.)	Enclosure & Partition Material	Aluminum alloy		
(16.)	Minimum thickness of enclosure	3 mm		




TECHNICAL REQUIREMENTS

S.No.	PARAMETER	11KV BUSDUCT	6.6KV BUSDUCT	3.3KV BUSDUCT
(17.)	Minimum thickness of partition	3 mm		
(18.)	Insulators & bushings			
	a) Rated Voltage	12 KV	7.2KV	3.6 KV
	b) One min power frequency withstand Voltage			
	(i) Dry	35 KV (rms)	27KV (rms)	21KV(rms)
	(ii) Wet	35 KV (rms)	27KV (rms)	21KV(rms)
	c) Impulse Voltage withstand Value with 1.2/50 micro sec wave shape.	75 KV	60KV	40KV
	d) Minimum Creepage Distance	240 mm	180KV	130 mm
	e) Material of Insulator/Bushing	Porcelain/Cast Resin		
(19.)	Material of earthing conductor	Galvanized mild steel/ Aluminium		
(20.)	Design ambient Temperature	50°C		
(21.)	Maximum temperature rise over an ambient of 50 ⁰ C when carrying the rated current continuously (with effect of solar radiation)			
	a) Bus Conductor			
		For Indoor Portion	For Outdoor Portion	
	(i) Bolted Joints (Plain or tinned)	40°C	32.5°C	
	(ii) Bolted Joints (silver plated)	55°C	47.5°C	
	b) Busduct Enclosure	30°C	22.5°C	


ANNEXURE A

CONTINUOUS MEMBER FOR SUPPORTING CABLE TRAYS (IF ANY)
(MIN. ISMB 150)

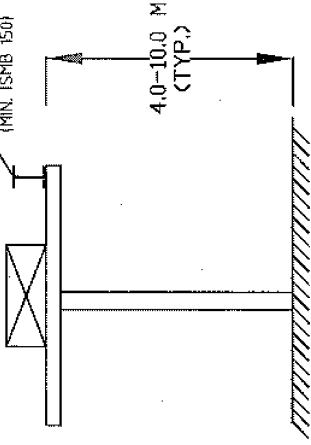


TYPE II

CONTINUOUS MEMBER FOR SUPPORTING CABLE TRAYS (IF ANY)
(MIN. ISMB 150)

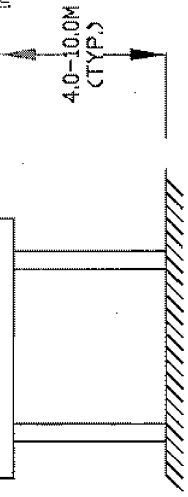


TYPE - I


BOTTOM OF BEAM

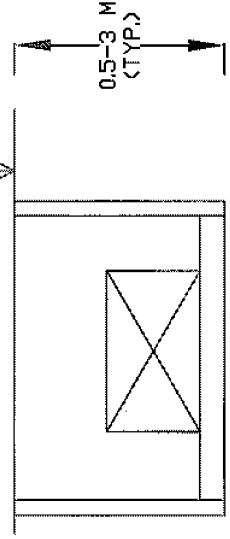

TYPE III

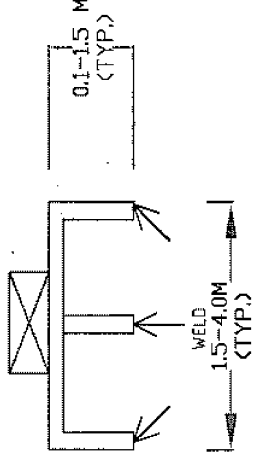

TYPE IV

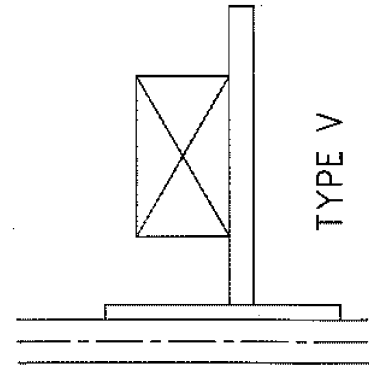

TYPE V

C/A COLUMN

FOR TENDER PURPOSE ONLY
NITPD (A GOVERNMENT OF INDIA ENTERPRISE)
NTPC Ltd.
POWER DIVISION

TITLE	MV BUSDUCT SUPPORT STRUCTURE TYPES
SCALE	AS SHOWN
DRG. NO.	0000 -000 -207-E-002
REV. NO.	0

REVNO.	DESCRIPTION	DATE	DESIGN	DRAWN	CHECKED	APPROVED	CLEAR BY
0	FOR TENDER PURPOSE						





SUB-SECTION-II-E4


LT POWER CABLES


**DCRTPP YAMUNA NAGAR (2X300 MW)
FLUE GAS DESULPHURISATION (FGD)
SYSTEM PACKAGE**


**TECHNICAL SPECIFICATION
SECTION-VI
BID DOCUMENT NO.:
32/CE/PLG/DCRTPP/FGD-251**


CLAUSE NO.	 TECHNICAL REQUIREMENTS		
1.00.00 1.01.00	CODES & STANDARDS All standards, specifications and codes of practice referred to herein shall be the latest editions including all applicable official amendments and revisions as on date of opening of bid. In case of conflict between this specification and those (IS: codes, standards, etc.) referred to herein, the former shall prevail. All the cables shall conform to the requirements of the following standards and codes: IS :1554 - I PVC insulated (heavy duty) electric cables for working voltages upto and including 1100V. IS : 3961 Recommended current ratings for cables IS : 3975 Low carbon galvanised steel wires, formed wires and tapes for armouring of cables. IS : 5831 PVC insulation and sheath of electrical cables. IS:7098 (Part -I) Cross linked polyethylene insulated PVC sheathed cables for working voltages upto and including 1100V. IS : 8130 Conductors for insulated electrical cables and flexible cords. IS : 10418 Specification for drums for electric cables. IS : 10810 Methods of tests for cables. ASTM-D -2843 Standard test method for density of smoke from the burning or decomposition of plastics. IEC-754 (Part-I) Tests on gases evolved during combustion of electric cables. IEC-332 Tests on electric cables under fire conditions. Part-3: Tests on bunched wires or cables (Category-B). 2.00.00 TECHNICAL REQUIREMENTS 2.01.00 The cables shall be suitable for laying on racks, in ducts, trenches, conduits and under ground buried installation with chances of flooding by water.		
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E4 LT POWER CABLES	PAGE 1 OF 6

CLAUSE NO.	 TECHNICAL REQUIREMENTS																
2.02.00	All cables including EPR cables shall be flame retardant, low smoke (FRLS) type designed to withstand all mechanical, electrical and thermal stresses developed under steady state and transient operating conditions as specified elsewhere in this specification.																
2.03.00	Aluminium conductor used in power cables shall have tensile strength of more than 100 N/sq.mm. Conductors shall be stranded.																
2.04.00	XLPE insulation shall be suitable for a continuous conductor temperature of 90 deg. C and short circuit conductor temperature of 250 deg C. PVC insulation shall be suitable for continuous conductor temperature of 70 deg C and short circuit conductor temperature of 160 deg. C.																
2.05.00	The cable cores shall be laid up with fillers between the cores wherever necessary. It shall not stick to insulation and inner sheath. All the cables shall have distinct extruded PVC inner sheath of black colour as per IS: 5831.																
2.06.00	<p>For single core armoured cables, armouring shall be of aluminium wires/ formed wires. For multicore armoured cables, armouring shall be of galvanised steel as follows :</p> <table border="0" data-bbox="347 797 1342 1249"> <thead> <tr> <th data-bbox="347 797 638 857">Calculated nominal dia. of cable under armour</th> <th data-bbox="927 797 1225 831">Size and Type of armour</th> </tr> </thead> <tbody> <tr> <td data-bbox="347 898 501 931">Upto 13 mm</td> <td data-bbox="735 898 963 931">1.4mm dia GS wire</td> </tr> <tr> <td data-bbox="347 958 635 992">Above 13 & upto 25mm</td> <td data-bbox="735 958 1337 992">0.8 mm thick GS formed wire / 1.6 mm dia GS wire</td> </tr> <tr> <td data-bbox="347 1019 644 1052">Above 25 & upto 40 mm</td> <td data-bbox="735 1019 1326 1052">0.8mm thick GS formed wire / 2.0mm dia GS wire</td> </tr> <tr> <td data-bbox="347 1079 635 1113">Above 40 & upto 55mm</td> <td data-bbox="735 1079 1326 1113">1.4 mm thick GS formed wire /2.5mm dia GS wire</td> </tr> <tr> <td data-bbox="347 1140 644 1173">Above 55 & upto 70 mm</td> <td data-bbox="735 1140 1337 1173">1.4mm thick GS formed wire / 3.15mm dia GS wire</td> </tr> <tr> <td data-bbox="347 1200 512 1234">Above 70mm</td> <td data-bbox="735 1200 1337 1234">1.4 mm thick GS formed wire / 4.0 mm dia GS wire</td> </tr> </tbody> </table>			Calculated nominal dia. of cable under armour	Size and Type of armour	Upto 13 mm	1.4mm dia GS wire	Above 13 & upto 25mm	0.8 mm thick GS formed wire / 1.6 mm dia GS wire	Above 25 & upto 40 mm	0.8mm thick GS formed wire / 2.0mm dia GS wire	Above 40 & upto 55mm	1.4 mm thick GS formed wire /2.5mm dia GS wire	Above 55 & upto 70 mm	1.4mm thick GS formed wire / 3.15mm dia GS wire	Above 70mm	1.4 mm thick GS formed wire / 4.0 mm dia GS wire
Calculated nominal dia. of cable under armour	Size and Type of armour																
Upto 13 mm	1.4mm dia GS wire																
Above 13 & upto 25mm	0.8 mm thick GS formed wire / 1.6 mm dia GS wire																
Above 25 & upto 40 mm	0.8mm thick GS formed wire / 2.0mm dia GS wire																
Above 40 & upto 55mm	1.4 mm thick GS formed wire /2.5mm dia GS wire																
Above 55 & upto 70 mm	1.4mm thick GS formed wire / 3.15mm dia GS wire																
Above 70mm	1.4 mm thick GS formed wire / 4.0 mm dia GS wire																
2.06.01	The aluminium used for armouring shall be of H4 grade as per IS: 8130 with maximum resistivity of 0.028264 ohm mm ² per meter at 20 deg C. The sizes of aluminium armouring shall be same as indicated above for galvanized steel.																
2.06.02	The gap between armour wires / formed wires shall not exceed one armour wire / formed wire space and there shall be no cross over / over-riding of armour wire / formed wire. The minimum area of coverage of armouring shall be 90%. The breaking load of armour joint shall not be less than 95% of that of armour wire / formed wire. Zinc rich paint shall be applied on armour joint surface of G.S.wire/ formed wire.																
2.07.00	<p>Outer sheath shall be of PVC as per IS: 5831 & black in colour. In addition to meeting all the requirements of Indian standards referred to, outer sheath of all the cables shall have the following FRLS properties.</p> <p>(a.) Oxygen index of min. 29 (as per IS 10810 Part-58).</p> <p>(b.) Acid gas emission of max. 20% (as per IEC-754-I).</p> <p>(c.) Smoke density rating shall not be more than 60 % (as per ASTM D-2843).</p>																
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E4 LT POWER CABLES	PAGE 2 OF 6														

CLAUSE NO.	 TECHNICAL REQUIREMENTS		
2.08.00	<p>Cores of the cables shall be identified by colouring of insulation. Following colour scheme shall be adopted:</p> <p>1 core - Red, Black, Yellow or Blue</p> <p>2 core - Red & Black</p> <p>3 core - Red, Yellow & Blue</p> <p>4 core - Red, Yellow, Blue and Black</p>		
2.09.00	<p>For reduced neutral conductors, the core shall be black.</p>		
2.10.00	<p>In addition to manufacturer's identification on cables as per IS, following marking shall also be provided over outer sheath.</p> <p>(a.) Cable size and voltage grade - To be embossed</p> <p>(b.) Word 'FRLS' at every 5 metre - To be embossed</p> <p>(c.) Sequential marking of length of the cable in metres at every one metre -To be embossed / printed</p> <p>The embossing shall be progressive, automatic, in line and marking shall be legible and indelible. For EPR cables identification shall be printed on outer sheath.</p>		
2.11.00	<p>All cables shall meet the fire resistance requirement as per Category-B of IEC 332 Part-3.</p>		
2.12.00	<p>Allowable tolerances on the overall diameter of the cables shall be ± 2 mm maximum, over the declared value in the technical data sheets.</p>		
2.13.00	<p>In plant repairs to the cables shall not be accepted. Pimples, fish eye, blow holes etc. are not acceptable.</p>		
2.14.00	<p>Cable selection & sizing</p>		
2.14.01	<p>Cables shall be sized based on the following considerations:</p> <p>(a) Rated current of the equipment</p> <p>(b) The voltage drop in the cable, during motor starting condition, shall be limited to 10% and during full load running condition, shall be limited to 3% of the rated voltage</p> <p>(c) Short circuit withstand capability</p> <p>This will depend on the feeder type. For a fuse protected circuit, cable should be sized to withstand the letout energy of the fuse. For breaker controlled feeder, cable shall be capable of withstanding the system fault current level for total breaker tripping time inclusive of relay pickup time.</p>		
2.14.02	<p>Derating Factors</p> <p>Derating factors for various conditions of installations including the following shall be considered while selecting the cable sizes:</p>		
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E4 LT POWER CABLES	PAGE 3 OF 6

CLAUSE NO.	 TECHNICAL REQUIREMENTS		
2.14.03 2.14.04 2.14.05 2.14.16	<p>a) Variation in ambient temperature for cables laid in air</p> <p>b) Grouping of cables</p> <p>c) Variation in ground temperature and soil resistivity for buried cables.</p> <p>Cable lengths shall be considered in such a way that straight through cable joints are avoided.</p> <p>All Cables shall be armoured type.</p> <p>All LT power cables of sizes more than 120 sq.mm. shall be XLPE insulated and sizes shall be 1Cx150, 1Cx300, 1Cx630, 3Cx150 & 3Cx240 sq.mm. However for cable sizes upto 120 sq.mm. both XLPE insulated & PVC insulated LT power cables are acceptable.</p> <p>Same cable sizes to be used for same type of application & rating of motor i.e if there are three pumps for one application, all three pumps motor should be provided with same cable sizes.</p>		
3.00.00	CONSTRUCTIONAL FEATURES		
3.01.00	1.1 KV Grade Power Cables <p>(a) 1.1 KV grade XLPE power cables shall have compacted aluminium conductor, XLPE insulated, PVC inner-sheathed (as applicable), armoured, PVC outer-sheathed conforming to IS:7098. (Part-I).</p> <p>(b) 1.1KV grade PVC power cables shall have aluminium conductor (compacted type for sizes above 10 sq.mm), PVC Insulated, PVC inner sheathed (as applicable) armoured, PVC outer-sheathed conforming to IS:1554 (Part-I).</p> <p>(c) 1.1 KV grade Trailing cables shall have tinned copper (class 5) conductor, insulated with heat resistant elastomeric compound based on Ethylene Propylene Rubber (EPR) suitable for withstanding 90 deg.C continuous conductor temperature and 250deg C during short circuit, inner-sheathed with heat resistant elastomeric compound, nylon cord reinforced, outer-sheathed with heat resistant, oil resistant and flame retardant heavy duty elastomeric compound conforming to IS 9968.</p>		
4.00.00	CABLE DRUMS <p>(a) Cables shall be supplied in non returnable wooden or steel drums of heavy construction. The surface of the drum and the outer most cable layer shall be covered with water proof cover. Both the ends of the cables shall be properly sealed with heat shrinkable PVC/ rubber caps secured by 'U' nails so as to eliminate ingress of water during transportation, storage and erection. Wood preservative anti-termite treatment shall be applied to the entire drum. Wooden drums shall comply with IS: 10418.</p> <p>(b) Each drum shall carry manufacturer's name, purchaser's name, address and contract number, item number and type, size and length of cable and net gross weight stencilled on both sides of the drum. A tag containing same information shall be attached to the leading end of the cable. An arrow and suitable accompanying wording shall be marked on one end of the reel indicating the direction in which it should be rolled.</p> <p>(c.) The standard drum length of LT power cable with a maximum tolerance of +/- 5% may be decided by the bidder subject to condition that there shall not be any joint in cable,</p>		
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E4 LT POWER CABLES	PAGE 4 OF 6

CLAUSE NO.	 TECHNICAL REQUIREMENTS																																							
<p>5.00.00</p> <p>TESTS</p> <p>1.0 All equipments to be supplied shall be of type tested design. During detailed engineering, the contractor shall submit for Employer's approval the reports of all the type tests as listed in this specification and carried out within last ten years from the date of bid opening. These reports should be for the test conducted on the equipment similar to those proposed to be supplied under this contract and the test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client.</p> <p>2.0 However if the contractor is not able to submit report of the type test(s) conducted within last ten years from the date of bid opening, or in the case of type test report(s) are not found to be meeting the specification requirements, the contractor shall conduct all such tests under this contract at no additional cost to the Employer either at third party lab or in presence of client /Employers representative and submit the reports for approval.</p> <p>3.0 All acceptance and routine tests as per the specification and relevant standards shall be carried out. Charges for these shall be deemed to be included in the equipment price.</p> <p>5.01.00 Type Tests</p> <p>5.01.01 The reports for the following type tests shall be submitted for one size each of LT XLPE and LT PVC Power cables. Size shall be decided by the employer during detailed engineering:</p> <table border="1" data-bbox="343 1149 1457 1944"> <thead> <tr> <th>S.No.</th> <th>Type test</th> <th>Remarks</th> </tr> </thead> <tbody> <tr> <td colspan="3" style="text-align: center;">For Conductor</td> </tr> <tr> <td>1.</td> <td>Resistance test</td> <td></td> </tr> <tr> <td>2.</td> <td>Tensile test</td> <td>For circular non-compacted conductors only</td> </tr> <tr> <td>3.</td> <td>Wrapping test</td> <td>For circular non-compacted only</td> </tr> <tr> <td colspan="3" style="text-align: center;">For Armour Wires/ Formed Wires</td> </tr> <tr> <td>4.</td> <td>Measurement of Dimensions</td> <td></td> </tr> <tr> <td>5.</td> <td>Tensile Test</td> <td></td> </tr> <tr> <td>6.</td> <td>Elongation test</td> <td></td> </tr> <tr> <td>7.</td> <td>Torsion test</td> <td>For round wires only</td> </tr> <tr> <td>8.</td> <td>Wrapping test</td> <td>For aluminium wires / formed wires only.</td> </tr> <tr> <td>9.</td> <td>Resistance test</td> <td></td> </tr> <tr> <td>10(a)</td> <td>Mass of zinc coating test</td> <td>For GS Formed wires/wires only</td> </tr> </tbody> </table>	S.No.	Type test	Remarks	For Conductor			1.	Resistance test		2.	Tensile test	For circular non-compacted conductors only	3.	Wrapping test	For circular non-compacted only	For Armour Wires/ Formed Wires			4.	Measurement of Dimensions		5.	Tensile Test		6.	Elongation test		7.	Torsion test	For round wires only	8.	Wrapping test	For aluminium wires / formed wires only.	9.	Resistance test		10(a)	Mass of zinc coating test	For GS Formed wires/wires only	<p>where application length of cable is up to & including 1000 meter for single core cable excluding 630 sq.mm size, and 750 meter for multicore cable & single core 630 sq.mm</p>
S.No.	Type test	Remarks																																						
For Conductor																																								
1.	Resistance test																																							
2.	Tensile test	For circular non-compacted conductors only																																						
3.	Wrapping test	For circular non-compacted only																																						
For Armour Wires/ Formed Wires																																								
4.	Measurement of Dimensions																																							
5.	Tensile Test																																							
6.	Elongation test																																							
7.	Torsion test	For round wires only																																						
8.	Wrapping test	For aluminium wires / formed wires only.																																						
9.	Resistance test																																							
10(a)	Mass of zinc coating test	For GS Formed wires/wires only																																						
<p>DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251</p>	<p>SUB SECTION-II-E4 LT POWER CABLES</p>	<p>PAGE 5 OF 6</p>																																					

CLAUSE NO.	 TECHNICAL REQUIREMENTS		
10(b)	Uniformity of zinc coating		For GS Formed wires /wires only
11.	Adhesion test		For GS Formed wires/wires only
For PVC/XLPE insulation & PVC Sheath			
12.	Test for thickness		
13.	Tensile strength & elongation tests	before ageing and after ageing	
14.	Ageing in air oven		
15.	Loss of mass test		For PVC insulation and sheath only
16.	Hot deformation test		For PVC insulation and sheath only
17.	Heat shock test		For PVC insulation and sheath only
18.	Shrinkage test		
19.	Thermal stability test		For PVC insulation and sheath only
20.	Hot set test		For XLPE insulation only
21.	Water absorption test		For XLPE insulation only
22.	Oxygen index test		For outer sheath only
23.	Smoke density test		For outer sheath only
24.	Acid gas generation test		For outer sheath only
For completed cables			
25.	Insulation resistance test (Volume resistivity method)		
26.	High voltage test		
27.	Flammability test as per IEC-332 Part-3 (Category-B)		
<p>Indicative list of tests/checks, Routine and Acceptance tests shall be as per Quality Assurance & Inspection table of LT power cables enclosed.</p>			
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E4 LT POWER CABLES	PAGE 6 OF 6





SUB-SECTION-II-E5


LT CONTROL CABLES


**DCRTPP YAMUNA NAGAR (2X300 MW)
FLUE GAS DESULPHURISATION (FGD)
SYSTEM PACKAGE**


**TECHNICAL SPECIFICATION
SECTION-VI
BID DOCUMENT NO.:
32/CE/PLG/DCRTPP/FGD-251**


CLAUSE NO.	 TECHNICAL REQUIREMENTS		
1.00.00 1.01.00	CODES & STANDARDS All standards, specifications and codes of practice referred to herein shall be the latest editions including all applicable official amendments and revisions as on date of opening of bid. In case of conflict between this specification and those (IS: codes, standards, etc.) referred to herein, the former shall prevail. All the cables shall conform to the requirements of the following standards and codes: <p style="margin-left: 40px;">IS :1554 - I PVC insulated (heavy duty) electric cables for working voltages upto and including 1100V.</p> <p style="margin-left: 40px;">IS : 3961 Recommended current ratings for cables</p> <p style="margin-left: 40px;">IS : 3975 Low carbon galvanised steel wires, formed wires and tapes for armouring of cables.</p> <p style="margin-left: 40px;">IS : 5831 PVC insulation and sheath of electrical cables.</p> <p style="margin-left: 40px;">IS : 8130 Conductors for insulated electrical cables and flexible cords.</p> <p style="margin-left: 40px;">IS : 10418 Specification for drums for electric cables.</p> <p style="margin-left: 40px;">IS : 10810 Methods of tests for cables.</p> <p style="margin-left: 40px;">ASTM-D –2843 Standard test method for density of smoke from the burning or decomposition of plastics.</p> <p style="margin-left: 40px;">IEC-754 (Part-I) Tests on gases evolved during combustion of electric cables.</p> <p style="margin-left: 40px;">IEC-332 Tests on electric cables under fire conditions. Part-3: Tests on bunched wires or cables (Category-B).</p> 2.00.00 2.01.00 2.02.00 2.03.00 2.04.00 2.05.00		
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E5 LT CONTROL CABLES	PAGE 1 OF 6

CLAUSE NO.	 TECHNICAL REQUIREMENTS																
2.06.00	<p>For multicore armoured cables, the armouring shall be of galvanised steel as follows:</p> <table border="0" data-bbox="347 309 1300 750"> <tr> <td>Calculated nominal dia of cable under armour</td> <td>Size and Type of armour</td> </tr> <tr> <td>Upto 13 mm</td> <td>1.4mm dia GS wire</td> </tr> <tr> <td>Above 13 upto 25 mm</td> <td>0.8 mm thick GS formed wire / 1.6 mm dia GS wire</td> </tr> <tr> <td>Above 25 upto 40 mm</td> <td>0.8mm thick GS formed wire / 2.0mm dia GS wire</td> </tr> <tr> <td>Above 40 upto 55mm</td> <td>1.4 mm thick GS formed wire/2.5mm dia GS wire</td> </tr> <tr> <td>Above 55 upto 70 mm</td> <td>1.4mm thick GS formed wire / 3.15mm dia GS wire</td> </tr> <tr> <td>Above 70mm</td> <td>1.4 mm thick GS formed wire / 4.0 mm dia GS wire</td> </tr> </table> <p>The gap between armour wires / formed wires shall not exceed one armour wire / formed wire space and there shall be no cross over / over-riding of armour wire / formed wire. The minimum area of coverage of armouring shall be 90%. The breaking load of armour joint shall not be less than 95% of that of armour wire / formed wire. Zinc rich paint shall be applied on armour joint surface.</p>			Calculated nominal dia of cable under armour	Size and Type of armour	Upto 13 mm	1.4mm dia GS wire	Above 13 upto 25 mm	0.8 mm thick GS formed wire / 1.6 mm dia GS wire	Above 25 upto 40 mm	0.8mm thick GS formed wire / 2.0mm dia GS wire	Above 40 upto 55mm	1.4 mm thick GS formed wire/2.5mm dia GS wire	Above 55 upto 70 mm	1.4mm thick GS formed wire / 3.15mm dia GS wire	Above 70mm	1.4 mm thick GS formed wire / 4.0 mm dia GS wire
Calculated nominal dia of cable under armour	Size and Type of armour																
Upto 13 mm	1.4mm dia GS wire																
Above 13 upto 25 mm	0.8 mm thick GS formed wire / 1.6 mm dia GS wire																
Above 25 upto 40 mm	0.8mm thick GS formed wire / 2.0mm dia GS wire																
Above 40 upto 55mm	1.4 mm thick GS formed wire/2.5mm dia GS wire																
Above 55 upto 70 mm	1.4mm thick GS formed wire / 3.15mm dia GS wire																
Above 70mm	1.4 mm thick GS formed wire / 4.0 mm dia GS wire																
2.07.00	<p>Outer sheath shall be of PVC as per IS: 5831 and grey in colour. In addition to meeting all the requirements of Indian Standards referred to, outer sheath of all the cables shall have the following FRLS properties.</p> <ul style="list-style-type: none"> (a.) Oxygen index of min. 29. (As per IS 10810 Part-58) (b.) Acid gas emission of max. 20% (As per IEC-754-I) (c.) Smoke density rating shall not be more than 60% during Smoke Density Test as per ASTM-D-2843. 																
2.08.00	<p>Cores of the cables of upto 5 cores shall be identified by colouring of insulation. Following colour scheme shall be adopted.</p> <ul style="list-style-type: none"> 1 core - Red, Black, Yellow or Blue 2 core - Red & Black 3 core - Red, Yellow & Blue 4 core - Red, Yellow, Blue and Black 5 core - Red, Yellow, Blue, Black and Grey 																
2.09.00	<p>For cables having more than 5 cores, core identification shall be done by numbering the insulation of cores sequentially, starting by number 1 in the inner layer (e.g. say for 10 core cable, core numbering shall be from 1 to 10). The number shall be printed in Hindu-Arabic numerals on the outer surfaces of the cores. All the numbers shall be of the same colour, which shall contrast with the colour of insulation. The colour of insulation for all the cores shall be grey only. The numerals shall be legible and indelible. The numbers shall</p>																
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E5 LT CONTROL CABLES	PAGE 2 OF 6														

CLAUSE NO.	 TECHNICAL REQUIREMENTS		
2.10.00	<p>be repeated at regular intervals along the core, consecutive numbers being inverted in relation to each other. When the number is a single numeral, a dash shall be placed underneath it. If the number consists of two numerals, these shall be disposed one below the other and a dash placed below the lower numeral. The spacing between consecutive numbers shall not exceed 50 mm.</p> <p>In addition to manufacturer's identification on cables as per IS, following marking shall also be provided over outer sheath:</p> <p>(a.) Cable size and voltage grade - To be embossed</p> <p>(b.) Word 'FRLS' at every 5 metre - To be embossed</p> <p>(c.) Sequential marking of length of the cable in metres at every one metre - To be embossed / printed.</p> <p>The embossing / printing shall be progressive, automatic, in line and marking shall be legible and indelible. For EPR cables identification shall be printed on outer sheath.</p>		
2.11.00	All cables shall meet the fire resistance requirement as per Category-B of IEC-332 Part-3.		
2.12.00	Allowable tolerances on the overall diameter of the cables shall be ± 2 mm maximum over the declared value in the technical data sheets.		
2.13.00	In plant repairs to the cables shall not be accepted. Pimples, fish eye, blow holes etc. are not acceptable.		
2.14.00	Cable selection & sizing		
	Control cables shall be sized based on the following considerations:		
	(a) The minimum conductor cross-section shall be 1.5 sq.mm.		
	(b) The minimum number of spare cores in control cables shall be as follows:		
	No. of cores in cable	Min. No. of spare cores	
	2C, 3C	NIL	
	5C	1	
	7C-12C	2	
	14C & above	3	
2.14.01	Cable lengths shall be considered in such a way that straight through cable joints are avoided.		
2.14.02	All Cables shall be armoured type.		
3.00.00	CONSTRUCTIONAL FEATURES		
3.01.00	1.1 KV Grade Control Cables shall have stranded copper conductor and shall be multicore PVC insulated, PVC inner sheathed, armoured FRLS PVC outer sheathed conforming to IS: 1554. (Part-I).		
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E5 LT CONTROL CABLES	PAGE 3 OF 6

CLAUSE NO.	 TECHNICAL REQUIREMENTS		
3.02.00	<p>1.1 KV grade Trailing control cables shall have tinned copper (class 5) conductor, insulated with heat resistant elastomeric compound based on Ethylene Propylene Rubber(EPR) suitable for withstanding 90 deg.C continuous conductor temperature and 250deg C during short circuit, inner-sheathed with heat resistant elastomeric compound, nylon cord reinforced, outer-sheathed with heat resistant, oil resistant and flame retardant heavy duty elastomeric compound conforming to IS 9968. Minimum conductor size shall be 2.5 sqmm.</p>		
4.00.00	<p>CABLE DRUMS</p> <p>(a.) Cables shall be supplied in non returnable wooden or steel drums of heavy construction. The surface of the drum and the outer most cable layer shall be covered with water proof cover. Both the ends of the cables shall be properly sealed with heat shrinkable PVC/ rubber caps secured by 'U' nails so as to eliminate ingress of water during transportation, storage and erection. Wood preservative anti-termite treatment shall be applied to the entire drum. Wooden drums shall comply with IS: 10418.</p> <p>(b.) Each drum shall carry manufacturer's name, purchaser's name, address and contract number, item number and type, size and length of cable and net gross weight stenciled on both the sides of the drum. A tag containing same information shall be attached to the leading end of the cable. An arrow and suitable accompanying wording shall be marked on one end of the reel indicating the direction in which it should be rolled.</p> <p>(c.) The standard drum length for control cables with a maximum tolerance of +/- 5% may be decided by the bidder subject to condition that there shall not be any joint in cable, where application length of cable is up to & including 1000 meter.</p>		
5.00.00	<p>TESTS</p> <p>All equipments to be supplied shall be of type tested design. During detailed engineering, the contractor shall submit for Employer's approval the reports of all the type tests as listed in this specification and carried out within last ten years from the date of bid opening. These reports should be for the test conducted on the equipment similar to those proposed to be supplied under this contract and the test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client.</p> <p>However if the contractor is not able to submit report of the type test(s) conducted within last ten years from the date of bid opening, or in the case of type test report(s) are not found to be meeting the specification requirements, the contractor shall conduct all such tests under this contract at no additional cost to the Employer either at third party lab or in presence of client /Employers representative and submit the reports for approval.</p> <p>All acceptance and routine tests as per the specification and relevant standards shall be carried out. Charges for these shall be deemed to be included in the equipment price</p>		
5.01.00	<p>TYPE TESTS</p>		
5.01.01	<p>The reports for the following type tests shall be submitted for one size of control cables. Size shall be decided by the employer during detailed engineering</p>		
<p>DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251</p>	<p>SUB SECTION-II-E5 LT CONTROL CABLES</p>	<p>PAGE 4 OF 6</p>

CLAUSE NO.	 TECHNICAL REQUIREMENTS																																																															
	<table border="1"> <thead> <tr> <th data-bbox="335 371 502 405">S. No.</th> <th data-bbox="502 371 965 405">Type Test</th> <th data-bbox="965 371 1453 405">Remarks</th> </tr> </thead> <tbody> <tr> <td colspan="3" data-bbox="335 439 1453 472">For Conductor</td> </tr> <tr> <td data-bbox="335 506 502 539">1.</td> <td data-bbox="502 506 965 539">Resistance test</td> <td data-bbox="965 506 1453 539"></td> </tr> <tr> <td colspan="3" data-bbox="335 562 1453 595">For Armour Wires / Formed Wires (If applicable)</td> </tr> <tr> <td data-bbox="335 629 502 663">2.</td> <td data-bbox="502 629 965 663">Measurement of Dimensions</td> <td data-bbox="965 629 1453 663"></td> </tr> <tr> <td data-bbox="335 685 502 719">3.</td> <td data-bbox="502 685 965 719">Tensile Test</td> <td data-bbox="965 685 1453 719"></td> </tr> <tr> <td data-bbox="335 741 502 775">4.</td> <td data-bbox="502 741 965 775">Elongation test</td> <td data-bbox="965 741 1453 775"></td> </tr> <tr> <td data-bbox="335 797 502 831">5.</td> <td data-bbox="502 797 965 831">Torsion test</td> <td data-bbox="965 797 1453 831">For round wire only</td> </tr> <tr> <td data-bbox="335 853 502 887">6.</td> <td data-bbox="502 853 965 887">Wrapping test</td> <td data-bbox="965 853 1453 887">For aluminium wires / formed wires only.</td> </tr> <tr> <td data-bbox="335 909 502 943">7.</td> <td data-bbox="502 909 965 943">Resistance test</td> <td data-bbox="965 909 1453 943"></td> </tr> <tr> <td data-bbox="335 965 502 999">8(a).</td> <td data-bbox="502 965 965 999">Mass of zinc Coating test</td> <td data-bbox="965 965 1453 999">For GS wires/formed wires only</td> </tr> <tr> <td data-bbox="335 1021 502 1055">8(b).</td> <td data-bbox="502 1021 965 1055">Uniformity of zinc coating</td> <td data-bbox="965 1021 1453 1055">For GS wires/formed wires only</td> </tr> <tr> <td data-bbox="335 1077 502 1111">9.</td> <td data-bbox="502 1077 965 1111">Adhesion test</td> <td data-bbox="965 1077 1453 1111">For GS wires/formed wires only</td> </tr> <tr> <td colspan="3" data-bbox="335 1133 1453 1167">For PVC insulation & PVC Sheath</td> </tr> <tr> <td data-bbox="335 1189 502 1223">10.</td> <td data-bbox="502 1189 965 1223">Test for thickness</td> <td data-bbox="965 1189 1453 1223"></td> </tr> <tr> <td data-bbox="335 1245 502 1279">11.</td> <td data-bbox="502 1245 965 1279">Tensile strength and elongation test</td> <td data-bbox="965 1245 1453 1279">before ageing and after ageing</td> </tr> <tr> <td data-bbox="335 1301 502 1335">12.</td> <td data-bbox="502 1301 965 1335">Ageing in air oven</td> <td data-bbox="965 1301 1453 1335"></td> </tr> <tr> <td data-bbox="335 1357 502 1391">13.</td> <td data-bbox="502 1357 965 1391">Loss of mass test</td> <td data-bbox="965 1357 1453 1391">For PVC insulation and sheath only</td> </tr> <tr> <td data-bbox="335 1413 502 1447">14.</td> <td data-bbox="502 1413 965 1447">Hot deformation test</td> <td data-bbox="965 1413 1453 1447">For PVC insulation and sheath only</td> </tr> <tr> <td data-bbox="335 1469 502 1503">15.</td> <td data-bbox="502 1469 965 1503">Heat shock test</td> <td data-bbox="965 1469 1453 1503">For PVC insulation and sheath only</td> </tr> <tr> <td data-bbox="335 1525 502 1559">16.</td> <td data-bbox="502 1525 965 1559">Shrinkage test</td> <td data-bbox="965 1525 1453 1559"></td> </tr> </tbody> </table>	S. No.	Type Test	Remarks	For Conductor			1.	Resistance test		For Armour Wires / Formed Wires (If applicable)			2.	Measurement of Dimensions		3.	Tensile Test		4.	Elongation test		5.	Torsion test	For round wire only	6.	Wrapping test	For aluminium wires / formed wires only.	7.	Resistance test		8(a).	Mass of zinc Coating test	For GS wires/formed wires only	8(b).	Uniformity of zinc coating	For GS wires/formed wires only	9.	Adhesion test	For GS wires/formed wires only	For PVC insulation & PVC Sheath			10.	Test for thickness		11.	Tensile strength and elongation test	before ageing and after ageing	12.	Ageing in air oven		13.	Loss of mass test	For PVC insulation and sheath only	14.	Hot deformation test	For PVC insulation and sheath only	15.	Heat shock test	For PVC insulation and sheath only	16.	Shrinkage test	
S. No.	Type Test	Remarks																																																														
For Conductor																																																																
1.	Resistance test																																																															
For Armour Wires / Formed Wires (If applicable)																																																																
2.	Measurement of Dimensions																																																															
3.	Tensile Test																																																															
4.	Elongation test																																																															
5.	Torsion test	For round wire only																																																														
6.	Wrapping test	For aluminium wires / formed wires only.																																																														
7.	Resistance test																																																															
8(a).	Mass of zinc Coating test	For GS wires/formed wires only																																																														
8(b).	Uniformity of zinc coating	For GS wires/formed wires only																																																														
9.	Adhesion test	For GS wires/formed wires only																																																														
For PVC insulation & PVC Sheath																																																																
10.	Test for thickness																																																															
11.	Tensile strength and elongation test	before ageing and after ageing																																																														
12.	Ageing in air oven																																																															
13.	Loss of mass test	For PVC insulation and sheath only																																																														
14.	Hot deformation test	For PVC insulation and sheath only																																																														
15.	Heat shock test	For PVC insulation and sheath only																																																														
16.	Shrinkage test																																																															
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E5 LT CONTROL CABLES	PAGE 5 OF 6																																																													

CLAUSE NO.	 TECHNICAL REQUIREMENTS																											
5.02.00	<table border="1"> <thead> <tr> <th data-bbox="335 264 502 293">S. No.</th> <th data-bbox="502 264 981 293">Type Test</th> <th data-bbox="981 264 1457 293">Remarks</th> </tr> </thead> <tbody> <tr> <td data-bbox="335 331 502 360">17.</td> <td data-bbox="502 331 981 360">Thermal stability test</td> <td data-bbox="981 331 1457 389">For PVC insulation and sheath only</td> </tr> <tr> <td data-bbox="335 421 502 450">18.</td> <td data-bbox="502 421 981 450">Oxygen index test</td> <td data-bbox="981 421 1457 450">For outer sheath only</td> </tr> <tr> <td data-bbox="335 488 502 517">19.</td> <td data-bbox="502 488 981 517">Smoke density test</td> <td data-bbox="981 488 1457 517">For outer sheath only</td> </tr> <tr> <td data-bbox="335 555 502 584">20.</td> <td data-bbox="502 555 981 584">Acid gas generation test</td> <td data-bbox="981 555 1457 584">For outer sheath only</td> </tr> <tr> <td colspan="3" data-bbox="335 613 1457 642">For completed cables</td> </tr> <tr> <td data-bbox="335 674 502 703">21.</td> <td colspan="2" data-bbox="502 674 1457 703">Insulation resistance test(Volume resistivity method)</td> </tr> <tr> <td data-bbox="335 734 502 763">22.</td> <td colspan="2" data-bbox="502 734 1457 763">High voltage test</td> </tr> <tr> <td data-bbox="335 795 502 824">23.</td> <td colspan="2" data-bbox="502 795 1457 824">Flammability test as per IEC-332 Part-3 (Category-B)</td> </tr> </tbody> </table> <p data-bbox="347 875 1457 934">Indicative list of tests/checks, Routine and Acceptance tests shall be as per Quality Assurance & Inspection table of Control Cables enclosed.</p>	S. No.	Type Test	Remarks	17.	Thermal stability test	For PVC insulation and sheath only	18.	Oxygen index test	For outer sheath only	19.	Smoke density test	For outer sheath only	20.	Acid gas generation test	For outer sheath only	For completed cables			21.	Insulation resistance test(Volume resistivity method)		22.	High voltage test		23.	Flammability test as per IEC-332 Part-3 (Category-B)	
S. No.	Type Test	Remarks																										
17.	Thermal stability test	For PVC insulation and sheath only																										
18.	Oxygen index test	For outer sheath only																										
19.	Smoke density test	For outer sheath only																										
20.	Acid gas generation test	For outer sheath only																										
For completed cables																												
21.	Insulation resistance test(Volume resistivity method)																											
22.	High voltage test																											
23.	Flammability test as per IEC-332 Part-3 (Category-B)																											
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E5 LT CONTROL CABLES	PAGE 6 OF 6																									





SUB-SECTION-II-E6


CABLING EARTHING & LIGHTNING PROTECTION


**DCRTPP YAMUNA NAGAR (2X300 MW)
FLUE GAS DESULPHURISATION (FGD)
SYSTEM PACKAGE**


**TECHNICAL SPECIFICATION
SECTION-VI
BID DOCUMENT NO.:
32/CE/PLG/DCRTPP/FGD-251**


CLAUSE NO.	 TECHNICAL REQUIREMENTS		
	<p>IEEE:142</p> <p>DIN 46267 (Part-II)</p> <p>DIN 46329</p> <p>BS:6121</p>	<p>Grounding of Industrial & commercial power systems</p> <p>Non tension proof compression joints for Aluminium conductors.</p> <p>Cable lugs for compression connections, ring type ,for Aluminium conductors</p> <p>Specification for mechanical Cable glands for elastomers and plastic insulated cables.</p> <p>Indian Electricity Act.</p> <p>Indian Electricity Rules.</p>	<p>Equipment complying with other internationally accepted standards such as IEC, BS, DIN, USA, VDE, NEMA etc. will also be considered if they ensure performance and constructional features equivalent or superior to standards listed above. In such a case, the Bidder shall clearly indicate the standard(s) adopted, furnish a copy in English of the latest revision of the standards alongwith copies of all official amendments and revisions in force as on date of opening of bid and shall clearly bring out the salient features for comparison.</p>
1.02.00	<p>Equipment complying with other internationally accepted standards such as IEC, BS, DIN, USA, VDE, NEMA etc. will also be considered if they ensure performance and constructional features equivalent or superior to standards listed above. In such a case, the Bidder shall clearly indicate the standard(s) adopted, furnish a copy in English of the latest revision of the standards alongwith copies of all official amendments and revisions in force as on date of opening of bid and shall clearly bring out the salient features for comparison.</p>		
2.00.00	<p>DESIGN AND CONSTRUCTIONAL FEATURE</p>		
2.01.00	<p>Inter Plant Cabling</p>		
2.01.01	<p>Interplant cabling for main routes shall be laid along overhead trestles/duct banks. Cables from main plant to switchyard control room shall be laid in overhead trestles or duct bank. In case of Duct banks, pull-pits shall be filled with sand and provided with a PCC covering. Directly buried cables, if essential, shall not have concentration of more than 4 cables in one route. Cables crossing Railway line (if applicable) shall be laid underground through nearest culvert. Necessary statutory clearance if required shall be taken by Bidder. All HT,LT and control cable shall be armoured.</p>		
2.01.02	<p>Transformer yard (as Applicable)</p> <p>In transformer yard cables shall be laid in overhead trestle. The main cable routes coming out from Main plant building and crossing the Transformer yard shall be laid in overhead trestles. In transformer yard, trestle height for rail/road crossing shall be suitable for movement of Generator Transformer with bushing.</p>		
2.01.03	<p>Trenches</p> <p>PCC flooring of built up trenches shall be sloped for effective drainage with sump pits and sump pumps.</p>		
2.01.04	<p>No sub zero level cable vault/trenches shall be provided below control building/ switchgear rooms in main plant. In other area, if no. of trays are more than four in a single trench, the bidder has to consider cable vault.</p>		
2.01.05	<p>Cable Vault (as Applicable)</p> <p>The cable vault/ / cable spreader room space below the HT / LT switchgear room, Control Rooms, unit control equipment room, Programmer room, UPS, Charger & Battery Rooms, shall have 800 mm wide and 2.1 m high movement passage all around the cable trays in the cable vault/ cable spreader room for easy laying/maintenance of cables</p>		
<p>DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251</p>	<p>SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION</p>	<p>Page 2 of 23</p>


CLAUSE NO.	 TECHNICAL REQUIREMENTS		
2.01.06	<p>Cable vaults shall be provided with adequate drainage facilities for drainage of fire water.</p> <p>Each cable vault should have at least two doors.</p> <p>Exit signs shall be provided near doors for personnel escape in case of emergency</p> <p>Boiler Area (as Applicable)</p> <p>Cable trays in boiler & ESP area shall be supported from the boiler and ESP structures. The same shall be coordinated with SG/ESP contractor.</p> <p>Cable trays in these areas shall be in vertical formation to avoid dust accumulation. No cable trenches shall be provided in boiler/ESP area.</p>		
2.01.07	<p>Two separate cable routes shall be provided for cable routing of working and standby drives or different set/group (say 50% capacity) of auxiliaries.</p>		
2.01.08	<p>OffSite Area (FGD)</p> <p>For feeder in bidder's scope for offsite areas, overhead cable tray arrangement shall be followed. However cable trenches/slit may also be acceptable, for some areas, if found to be required during detailed engineering.</p> <p>Cable trenches provided shall be separated from fuel oil area to avoid oil accumulation.</p>		
2.01.09	<p>The cable slits to be used for motor/equipment power/control supply shall be sand filled & covered with PCC after cabling.</p>		
2.01.10	<p>Sizing criteria, derating factors for the cables shall be met as per respective chapters. However for the power cables, the minimum conductor size shall be 6 sq.mm. for aluminium conductor and 2.5 sq.mm. for copper conductor cable.</p>		
2.01.11	<p>Conscious exceptions to the above guidelines may be accepted under special conditions but suitable measures should be taken at such location to:</p> <ul style="list-style-type: none"> • Meet all safety requirements • Safeguard against fire hazards, mechanical damage, flooding of water, oil accumulation, electrical faults/interferences, etc 		
3.00.00	<p>EQUIPMENT DESCRIPTION</p>		
3.01.00	<p>Cable trays, Fittings & Accessories</p>		
3.01.01	<p>Cable trays shall be ladder/perforated type as specified complete with matching fittings (like brackets, elbows, bends, reducers, tees, crosses, etc.) accessories (like side coupler plates, etc. and hardware (like bolts, nuts, washers, G.I. strap, hook etc.) as required. Cable tray shall be ladder type for power & control cables and perforated for instrumentation cables. Top cable tray shall be provided with tray cover in outdoor area.</p>		
3.01.02	<p>Cable trays, fittings and accessories shall be fabricated out of rolled mild steel sheets free from flaws such as laminations, rolling marks, pitting etc. These (including hardware) shall be hot dip galvanized as per Clause No. 3.12.00 of this chapter.</p>		
3.01.03	<p>Cable trays shall have standard width of 150 mm, 300 mm & 600 mm and standard lengths of 2.5 metre. Thickness of mild steel sheets used for fabrication of cable trays and fittings shall be 2 mm. The thickness of side coupler plates shall be 3 mm.</p>		
<p>DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251</p>	<p>SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION</p>	<p>Page 3 of 23</p>


CLAUSE NO.	 TECHNICAL REQUIREMENTS		
3.01.04	<p>Cable troughs shall be required for branching out few cables from main cable route. These shall be U-shaped, fabricated of mild steel sheets of thickness 2 mm and shall be hot dip galvanised as per Clause No. 3.12.00 of this chapter. Troughs shall be standard width of 50 mm & 75 mm with depth of 25 mm.</p>		
3.01.05	<p>The tolerance for cable tray and accessories shall be as per IS 2102 (Part-1). Tolerance Class: - Coarse</p>		
3.02.00	<p>Support System for Cable Trays</p>		
3.02.01	<p>Cable tray support system shall be pre-fabricated out of single sheet as per enclosed tender drawings.</p>		
3.02.02	<p>Support system for cable trays shall essentially comprise of the two components i.e. main support channel and cantilever arms. The main support channel shall be of two types: (i) C1:- having provision of supporting cable trays on one side and (ii) C2:-having provision of supporting cable trays on both sides. The support system shall be the type described hereunder</p> <ol style="list-style-type: none"> a. Cable supporting steel work for cable racks/cables shall comprise of various channel sections, cantilever arms, various brackets, clamps, floor plates, all hardwares such as lock washers, hexagon nuts, hexagon head bolt, support hooks, stud nuts, hexagon head screw, channel nut, channel nut with springs, fixing studs, etc. b. The system shall be designed such that it allows easy assembly at site by using bolting. All cable supporting steel work, hardwares fittings and accessories shall be prefabricated factory galvanised. c. The main support and cantilever arms shall be fixed at site using necessary brackets, clamps, fittings, bolts, nuts and other hardware etc. to form various arrangements required to support the cable trays. Welding of the components shall not be allowed. However, welding of the bracket (to which the main support channel is bolted) to the overhead beams, structural steel, insert plates or reinforcement bars will be permitted. Any cutting or welding of the galvanised surface shall be brushed and red lead primer, oil primer & aluminium paint shall be applied d. All steel components, accessories, fittings and hardware shall be hot dip galvanised after completing welding, cutting, drilling and other machining operation. e. The typical arrangement of flexible support system is shown in the enclosed drawings and described briefly below: The main support channel and cantilever arms shall be fabricated out of 2.5 thick rolled steel sheet conforming to IS 1079. f. Cantilever arms of 320 mm, 620mm and 750 mm in length are required, and shall be as shown in the enclosed drawing. The arm portion shall be suitable for assembling the complete arm assembly on to component constructed of standard channel section. The back plate shall allow sufficient clearance for fixing bolt to be tightened with tray in position. g. Support system shall be able to withstand <ul style="list-style-type: none"> • weight of the cable trays • weight of the cables (75 Kg/Metre run of each cable tray) 		
<p>DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251</p>	<p>SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION</p>	<p>Page 4 of 23</p>


CLAUSE NO.	 TECHNICAL REQUIREMENTS		
<p>3.02.03</p> <p>3.02.04</p> <p>3.02.05</p> <p>3.03.00</p> <p>3.03.01</p> <p>3.03.02</p> <p>3.03.03</p> <p>3.03.04</p> <p>3.03.05</p>	<ul style="list-style-type: none"> • Concentrated load of 75 Kg between every support span. • Factor of safety of minimum 1.5 shall be considered. <p>The size of structural steel members or thickness of sheet steel of main support channel and cantilever arms and other accessories as indicated above or in the enclosed drawings are indicative only. Nevertheless, the support system shall be designed by the bidder to fully meet the requirements of type tests as specified. In case the system fails in the tests, the components design modification shall be done by the Bidder without any additional cost to the Employer. The bidder shall submit the detailed drawings of the system offered by him alongwith the bid.</p> <p>Four legged structure shall be provided wherever there is change in elevation and change in direction</p> <p>FOR COAL HANDLING PLANT/FGD PLANT AREA THE FOLLOWING SHALL ALSO BE APPLICABLE:</p> <ol style="list-style-type: none"> a) All overhead cable routes shall be along the route of the conveyor gallery on separate supporting structures and cables shall be laid in vertical trays. The bottom of the steel shall be such that the existing facilities, movement of trucks/human beings etc. does not get affected. The cable trestle shall have a minimum 600mm clear walk way and shall have maintenance platforms as required. The bottom of the steel supporting structure shall be generally at 3.0M above the grade level except for rail/road crossings where it shall be at 8.0M above grade level. Tap offs from the overhead cable trestle can be through shallow trenches with prior approval of the Employer. Directly buried cable, if essential, shall not have concentration of more than 4 cables on one route. b) Cable trenches shall be provided only in Switchgear/MCC rooms. c) Cables shall not be routed through the conveyor galleries except for the equipment located in the conveyor galleries for a particular conveyor i.e. protection switches, receptacles etc. d) Cables for PCS and BSS shall be routed along the conveyors through GI conduits. <p>Pipes, Fittings & Accessories</p> <p>Pipes offered shall be complete with fittings and accessories (like tees, elbows, bends, check nuts, bushings, reducers, enlargers, coupling caps, nipples etc.) The size of the pipe shall be selected on the basis of maximum 40% fill criteria</p> <p>GI Pipes shall be of medium duty as per IS: 1239</p> <p>Duct banks shall be High Density PE pipes encased in PCC (10% spare of each size, subject to minimum one) with suitable water-proof manholes.</p> <p>Hume pipes shall be NP3 type as per IS 458.</p> <p>TERNE Coated Flexible Steel Conduits shall be water proof and rust proof made of heat resistant lead coated steel. Conduit diameter shall be uniform throughout its length. Internal surface of the conduit shall be free from burrs and sharp edges.</p>		
<p>DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251</p>	<p>SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION</p>	<p>Page 5 of 23</p>


CLAUSE NO.	 TECHNICAL REQUIREMENTS		
	<p>Conduits shall be complete with necessary accessories for proper termination of the conduit with junction boxes and lighting fixtures</p> <p>3.03.06 HDPE pipes and conduits shall be PE-80, PN-10 type as per IS 4984/IS 8008 part-I.</p> <p>3.04.00 Junction Boxes</p> <p>3.04.01 Junction box shall be made of Fire retardant material. Material of JB shall be Thermoplastic or thermosetting or FRP type. The box shall be provided with the terminal blocks, mounting bracket and screws etc. The cable entry shall be through galvanized steel conduits of suitable diameter. The JB shall have suitable for installing glands of suitable size on the bottom of the box. The JB shall be suitable for surface mounting on ceiling/structures. The JB shall be of grey color RAL 7035. All the metal parts shall be corrosion protected. Junction box surface should be such that it is free from crazings, blisterings, wrinkling, colour blots/striations. There should not be any mending or repair of surface. JB's will be provided with captive screws so that screws don't fall off when cover is opened. JB's mounting brackets should be of powder coated MS. Type test reports for the following tests shall be furnished:-</p> <p>(a) Impact resistance for impact energy of 2 Joules (IK07) as per BS EN50102</p> <p>(b) Thermal ageing at 70deg C for 96 hours as per IEC60068-2-2Bb.</p> <p>(c) Class of protection shall be IP 55.</p> <p>(d) HV test.</p> <p>3.04.02 Terminal blocks shall be 1100V grade, of suitable current rating, made up of unbreakable polyamide 6.6 grade. The terminals shall be screw type or screw-less (spring loaded) / cage clamp type with lugs. Marking on terminal strips shall correspond to the terminal numbering in wiring diagrams. All metal parts shall be of non-ferrous material. In case of screw type terminals the screw shall be captive, preferably with screw locking design. All terminal blocks shall be suitable for terminating on each side the required cables/wire size. All internal wiring shall be of cu. Conductor PVC wire.</p> <p>3.05.00 Terminations & Straight Through Joints</p> <p>3.05.01 Termination and jointing kits for 33kV, 11 kV, 6.6 KV and 3.3 kV grade XLPE insulated cables shall be of proven design and make which have already been extensively used and type tested. Termination kits and jointing kits shall be Pre-moulded type or heat shrinkable type. Further Cold shrinkable type termination and jointing kits are also acceptable. The Cold shrinkable type kits shall be type tested as per relevant standards. Calculation to withstand the required fault level shall also be furnished in case of cold shrinkable type kits. 33 kV, 11 kV, 6.6 KV and 3.3kV grade joints and terminations shall be type tested and Type test reports as per IS:13573 Part-II and IEC60502 shall be furnished. Also, heat shrink material shall comply with requirements of ESI 09-13 (external tests). Critical components used in cable accessories shall be of tested and proven quality as per relevant product specification/ESI specification. Cable joints and terminations should be with FRLS properties as per IEC 60754-1&2. Kit contents shall be supplied from the same source as were used for type testing. The kit shall be complete with the tinned copper solderless crimping type cable lugs & ferrule or mechanical connectors (wherein bolts are tightened that shear off at an appropriate torque) as per DIN standard suitable for aluminium compacted conductor cables.</p> <p>3.05.02 Straight through joint and termination shall be capable of withstanding the fault level of 21 KA for 0.12 Sec. with dynamic peak of 52 KA for 33 KV system & of 40 kA for 0.12 sec with</p>		
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION	Page 6 of 23


CLAUSE NO.	 TECHNICAL REQUIREMENTS		
3.05.03	<p>a dynamic peak of 100 kA for 11 kV, 6.6 KV & 3.3 KV system. Straight through joints shall have provisions for shield connection and earthing wherever required and complete with all accessories and consumables suitable for storage without deterioration at a temperature of 50 deg. C with shelf life of more than five years. 1.1 kV grade straight through joints shall also be of proven design</p> <p>1.1 KV grade Straight Through Joint shall be of proven design.</p>		
3.06.00	<p>Cable glands</p>		
3.06.01	<p>Cable shall be terminated using double compression type cable glands. Testing requirements of Cable glands shall conform to BS:6121 and gland shall be of robust construction capable of clamping cable and cable armour (for armoured cables) firmly without injury to insulation. Cable glands shall be made of heavy duty brass machine finished and nickel chrome plated. Thickness of plating shall not be less than 10 micron. All washers and hardware shall also be made of brass with nickel chrome plating Rubber components shall be of neoprene or better synthetic material and of tested quality. Cable glands shall be suitable for the sizes of cable supplied/erected.</p>		
3.07.00	<p>Cable lugs/ferrules</p>		
3.07.01	<p>Cable lugs/ferrules for power cables shall be tinned copper solderless crimping type suitable for aluminium compacted conductor cables. Cable lugs and ferrules for control cables shall be tinned copper type. The cable lugs for control cables shall be provided with insulating sleeve and shall suit the type of terminals provided on the equipments. Cable lugs and ferrule shall conform to IS/DIN standards.</p>		
3.08.00	<p>Trefoil clamps</p>		
3.08.01	<p>Trefoil clamps for single core cables shall be pressure die cast aluminum or fibre glass or nylon and shall include necessary fixing accessories like G.I. nuts, bolts, washers, etc. Trefoil clamps shall have adequate mechanical strength, when installed at 1 mtr intervals, to withstand the forces generated by the peak value of maximum system short circuit current.</p>		
3.09.00	<p>Cable Clamps & Ties</p>		
3.09.01	<p>The cable clamps/ties required to clamp multicore cables shall be of SS-316 material, 12mm wide, polyester coated ladder lock type. The clamps/ties shall have self locking arrangement & shall have sufficient strength. The cable clamps/ties shall be supplied in finished individual pieces of suitable length to meet the site requirements.</p>		
3.10.00	<p>Receptacles</p>		
3.10.01	<p>Receptacles boxes shall be fabricated out of MS sheet of 2mm thickness and hot dipped galvanised or of die-cast aluminium alloy of thickness not less than 2.5 mm. The boxes shall be provided with two nos. earthing terminals, gasket to achieve IP55 degree of protection, terminal blocks for loop-in loop-out for cable of specified sizes, mounting brackets suitable for surface mounting on wall/column/structure, gland plate etc. The ON-OFF switch shall be rotary type heavy duty, double break, AC23 category, suitable for AC supply. Plug and Socket shall be shrouded Die-cast aluminium. Socket shall be provided with lid safety cover. Robust mechanical interlock shall be provided such that the switch can be put ON only when the plug is fully engaged and plug can be withdrawn only when the switch is in OFF position. Also cover can be opened only when the switch is in OFF position. Wiring shall be carried out with 1100 V grade PVC insulated stranded aluminium/copper wire of adequate size. The Terminal blocks shall be of 1100 V grade. The Terminal blocks shall be of 1100 V grade made up of unbreakable polyamide 6.6 grade with adequate current rating and size. The welding receptacles shall be provided with RCCB/RCD of 30mA sensitivity having facility for manual testing/checking of operation of RCCB/RCD.</p>		
<p>DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251</p>	<p>SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION</p>	<p>Page 7 of 23</p>


CLAUSE NO.	 TECHNICAL REQUIREMENTS		
3.11.00	<p>Cable Drum Lifting Jack</p> <p>The jack for cable drum lifting shall be of screw type with 10 ton capacity. The cable drum jacks shall be manufactured from fabricated steel. The spindles supplied with the cable drum jack shall be manufactured using BSEN-24 grade steel bar with locking collars. Jack nests shall be of SG cast steel. Cable drum jack supplied shall have undergone load testing and reports for the same shall be submitted. At least Two Nos. of jacks shall be supplied for owner's use. Contractor has to make arrangements for his own jacks for cable reeling/unreeling under his scope of installation.</p>		
3.12.00	<p>Galvanising</p>		
3.12.01	<p>Galvanising of steel components and accessories shall conform to IS:2629 , IS4759 & IS:2633. Additionally galvanising shall be uniform, clean smooth, continuous and free from acid spots.</p>		
3.12.02	<p>The amount of zinc deposit over threaded portion of bolts, nuts, screws and washers shall be as per IS:1367 . The removal of extra zinc on threaded portion of components shall be carefully done to ensure that the threads shall have the required zinc coating on them as specified</p>		
3.13.00	<p>Welding</p>		
3.13.01	<p>The welding shall be carried out in accordance with IS:9595. All welding procedures and welders qualification shall also be followed strictly in line with IS:9595</p>		
4.00.00	<p>INSTALLATION</p>		
4.01.00	<p>Cable tray and Support System Installation</p>		
4.01.01	<p>Cables shall run in cable trays mounted horizontally or vertically on cable tray support system which in turn shall be supported from floor, ceiling, overhead structures, trestles, pipe racks, trenches or other building structures.</p>		
4.01.02	<p>Horizontally running cable trays shall be clamped by bolting to cantilever arms and vertically running cable trays shall be bolted to main support channel by suitable bracket/clamps on both top and bottom side rails at an interval of 2000 mm in general. For vertical cable risers/shafts cable trays shall be supported at an interval of 1000mm in general. Fixing of cable trays to cantilever arms or main support channel by welding shall not be accepted. Cable tray installation shall generally be carried out as per the approved guidelines/ drawings. Vendor shall design the support system along with tray, spacing etc in line with tray loadings/drawings.</p>		
4.01.03	<p>The cantilever arms shall be positioned on the main support channel with a minimum vertical spacing of 300 mm unless otherwise indicated.</p>		
4.01.04	<p>The contractor shall fix the brackets/ clamps/ insert plates using anchor fasteners. Minimum size of anchor fasteners shall be M 8 X 50 and material shall be stainless steel grade 316 or better. Anchor fastener shall be fixed as recommended by manufacturer and as approved by site engineer. For brick wall suitable anchor fasteners shall be used as per the recommendations of manufacturer. Make of anchor fasteners subject to QA approval and the same shall be finalized at pre-award stage.</p>		
4.01.05	<p>All cable way sections shall have identification, designations as per cable way layout drawings and painted/stenciled at each end of cable way and where there is a branch connection to another cable way. Minimum height of letter shall be not less than 75 mm. For</p>		
<p>DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251</p>	<p>SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION</p>	<p>Page 8 of 23</p>


CLAUSE NO.	 TECHNICAL REQUIREMENTS												
4.01.06	<p>long lengths of trays, the identification shall be painted at every 10 meter. Risers shall additionally be painted/stenciled with identification numbers at every floor.</p>												
4.01.06	<p>In certain cases it may be necessary to site fabricate portions of trays, supports and other non standard bends where the normal prefabricated trays, supports and accessories may not be suitable. Fabricated sections of trays, supports and accessories to make the installation complete at site shall be neat in appearance and shall match with the prefabricated sections in the dimensions. They shall be applied with one coat of red lead primer, one coat of oil primer followed by two finishing coats of aluminium paint.</p>												
4.02.00	<p>Conduits/Pipes/Ducts Installation</p>												
4.02.01	<p>The Contractor shall ensure for properly embedding conduit pipe sleeves wherever necessary for cabling work. All openings in the floor/roof/wall / cable tunnel/cable trenches made for conduit installation shall be sealed and made water proof by the Contractor.</p>												
4.02.02	<p>GI pull wire of adequate size shall be laid in all conduits before installation. Metallic conduit runs at termination shall have two lock nuts wherever required for junction boxes etc.</p>												
4.02.03	<p>Conduit runs/sleeves shall be provided with PVC bushings having round edge at each end. All conduits/pipes shall have their ends closed by caps until cables are pulled. After cables are pulled, the ends of conduits/pipes shall be sealed with Glass wool/Cement Mortar/Putty to prevent entrance of moisture and foreign material</p>												
4.02.04	<p>Exposed conduit/pipe shall be adequately supported by racks, clamps, straps or by other approved means. Conduits /pipe support shall be installed square and true to line and grade with an average spacing between the supports as given below, unless specified otherwise</p>												
	<table border="0" style="width: 100%;"> <thead> <tr> <th style="text-align: left;">Conduit /pipe size (dia).</th> <th style="text-align: left;">Spacing</th> </tr> </thead> <tbody> <tr> <td>Upto 40 mm</td> <td>1 M</td> </tr> <tr> <td>50 mm</td> <td>2.0 M</td> </tr> <tr> <td>65-85 mm</td> <td>2.5 M</td> </tr> <tr> <td>100 mm and above</td> <td>3.0 M</td> </tr> </tbody> </table>			Conduit /pipe size (dia).	Spacing	Upto 40 mm	1 M	50 mm	2.0 M	65-85 mm	2.5 M	100 mm and above	3.0 M
Conduit /pipe size (dia).	Spacing												
Upto 40 mm	1 M												
50 mm	2.0 M												
65-85 mm	2.5 M												
100 mm and above	3.0 M												
4.02.05	<p>For bending of conduits, bending machine shall be arranged at site by the contractor to facilitate cold bending. The bends formed shall be smooth.</p>												
4.03.00	<p>Junction Boxes Installation</p>												
4.03.01	<p>Junction boxes shall be mounted at a height of 1200mm above floor level or as specified in the drawings and shall be adequately supported/mounted on masonry wall by means of anchor fasteners/ expandable bolts or shall be mounted on an angle, plate or other structural supports fixed to floor, wall, ceiling or equipment foundations.</p>												
4.04.00	<p>Cable Installation</p>												
4.04.01	<p>Cable installation shall be carried out as per IS:1255 and other applicable standards.</p>												
4.04.02	<p>For Cable unloading, pulling etc following guidelines shall be followed in general:</p> <p>a) Cable drums shall be unloaded, handled and stored in an approved manner on hard and well drained surface so that they may not sink. In no case shall be drum be stored flat i.e. with flange horizontal. Rolling of drums shall be avoided as far as</p>												
<p>DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251</p>	<p>SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION</p>	<p>Page 9 of 23</p>										


CLAUSE NO.	 TECHNICAL REQUIREMENTS		
	<p>possible. For short distances, the drums may be rolled provided they are rolled slowly and in proper direction as marked on the drum. In absence of any indication, the drums may be rolled in the same direction as it was rolled during taking up the cables. For unreeling the cable, the drum shall be mounted on suitable jacks or on cable wheels and shall be rolled slowly so that cable comes out over the drum and not from below. All possible care shall be taken during unreeling and laying to avoid damage due to twist, kink or sharp bends. Cable ends shall be provided with sealed plastic caps to prevent damage and ingress of moisture.</p> <p>b) While laying cable, ground rollers shall be used at every 2 meter interval to avoid cable touching ground. The cables shall be pushed over the rollers by a gang of people positioned in between the rollers. Cables shall not be pulled from the end without having intermediate pushing arrangements. Pulling tension shall not exceed the values recommended by cable manufacturer. Selection of cable drums for each run shall be so planned so as to avoid using straight through joints. Care should be taken while laying the cables so as to avoid damage to cables. If any particular cable is damaged, the same shall be repaired or changed to the satisfaction of Project Manager.</p>		
4.04.03	Cables shall be laid on cable trays strictly in line with cable schedule		
4.04.04	<p>Power and control cables shall be laid on separate tiers inline with the approved guidelines/drawings. The laying of different voltage grade cables shall be on different tiers according to the voltage grade of the cables. In horizontal tray stacks, H.T. cables shall be laid on top most tier and cables of subsequent lower voltage grades on lower tiers of trays. Single core cable in trefoil formation shall be laid with a distance of four times the diameter of cable between trefoil center lines and clamped at every two metre. All multicore cables shall be laid in touching formation. Power and control cables shall be secured fixed to trays/support with cable clamps/ties with self locking arrangement. For horizontal trays arrangements, multicore power cables and control cables shall be secured at every five meter interval. For vertical tray arrangement, individual multicore power cables and control cables shall be secured at every one meter. After completion of cable laying work in the particular vertical tray, all the control cables shall be binded to trays/supports by cable clamps/ties with self locking arrangement at every five meter interval and at every bend. Fibre Optical cable shall be laid in trenches/trays or as decided by Employer.</p>		
4.04.05	Bending radii for cables shall be as per manufacturer's recommendations and IS:1255.		
4.04.06	Where cables cross roads/rail tracks, the cables shall be laid in hume pipe/ HDPE pipe.		
4.04.07	No joints shall be allowed in trip circuits, protection circuits and CT/PT circuits. Also joints in critical equipment in main plant area shall not be permitted. Vendor shall identify and accordingly procure the cable drum length.		
4.04.08	In each cable run some extra length shall be kept at suitable point to enable one LT/two HT straight through joints to made, should the cable develop fault at a later stage. Control cable termination inside equipment enclosure shall have sufficient lengths so that shifting of termination in terminal blocks can be done without requiring any splicing.		
4.04.09	Wherever few cables are branching out from main trunk route troughs shall be used.		
4.04.10	Wind loading shall be considered for designing support as well Cable trays wherever required.		
4.04.11	Where there is a considerable risk of steam, hot oil or mechanical damage cable routes shall be protected by barriers or enclosures.		
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION	Page 10 of 23


CLAUSE NO.	 TECHNICAL REQUIREMENTS												
4.04.12	<p>The installation work shall be carried out in a neat workman like manner & areas of work shall be cleaned of all scraps, water, etc. after the completion of work in each area every day. Contractor shall replace RCC/Steel trench covers after the Installation work in that particular area is completed or when further work is not likely to be taken up for some time.</p>												
4.04.13	<p>Separation</p> <p>At least 300mm clearance shall be provided between:</p> <ul style="list-style-type: none"> - HT power & LT power cables, - LT power & LT control/instrumentation cables, 												
4.04.14	<p>Segregation</p> <ol style="list-style-type: none"> 1) Segregation means physical isolation to prevent fire jumping. 2) All cables associated with the unit shall be segregated from cables of other units. 3) Interplant cables of station auxiliaries and unit critical drives shall be segregated in such a way that not more than half of the drives are lost in case of single incident of fire. Power and control cables for AC drives and corresponding emergency AC or DC drives shall be laid in segregated routes. Cable routes for one set of auxiliaries of same unit shall be segregated from the other set. 4) In switchyard, control cables of each bay shall be laid on separate racks/trays. 												
4.04.15	<p>Minimum number of spare cores required to be left for interconnection in control cables shall be as follows:</p> <p>Minimum number of spare cores required to be left for interconnection in control cables shall be as follows:</p> <table border="1" data-bbox="459 1272 1098 1503"> <thead> <tr> <th>No. of cores in cable</th> <th>No. of spare cores</th> </tr> </thead> <tbody> <tr> <td>2C, 3C</td> <td>NIL</td> </tr> <tr> <td>5C</td> <td>1</td> </tr> <tr> <td>7C-10C</td> <td>2</td> </tr> <tr> <td>14C and above</td> <td>3</td> </tr> </tbody> </table>			No. of cores in cable	No. of spare cores	2C, 3C	NIL	5C	1	7C-10C	2	14C and above	3
No. of cores in cable	No. of spare cores												
2C, 3C	NIL												
5C	1												
7C-10C	2												
14C and above	3												
4.04.16	<p>Directly Buried Cables</p> <ol style="list-style-type: none"> a) Cable trenches shall be constructed for directly buried cables. Construction of cable trench for cables shall include excavation, preparation of sieved sand bedding, riddled soil cover, supply and installation of brick or concrete protective covers, back filling and compacting, supply and installation of route markers and joint markers. Laying of cables and providing protective covering shall be as per IS:1255 and the enclosed drawings showing cabling details. b) RCC cable route and RCC joint markers shall be provided wherever required. The voltage grade of the higher voltage cables in route shall be engraved on the marker. Location of underground cable joints shall be indicated with cable marker with an 												
<p>DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251</p>	<p>SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION</p>	<p>Page 11 of 23</p>										


CLAUSE NO.	 TECHNICAL REQUIREMENTS		
4.04.17	<p>additional inscription "Cable Joint". The marker shall project 150 mm above ground and shall be spaced at an interval of 30 meters and at every change in direction. They shall be located on both sides of road crossings and drain crossings. Top of cable marker/joint marker shall be sloped to avoid accumulation of water/dust on marker.</p>		
4.04.17	<p>Cable tags shall be provided on all cables at each end (just before entering the equipment enclosure), on both sides of a wall or floor crossing, on each duct/conduit entry, and at every 20 meters in cable tray/trench runs. Cable tags shall also be provided inside the switchgear, motor control centers, control and relay panels etc. where a number of cables enter together through a gland plate. Cable tag shall be of rectangular shape for power cables and control cables. Cable tag shall be of 2 mm thick aluminum with number punched on it and securely attached to the cable by not less than two turns of 20 SWG GI wire conforming to IS:280. Alternatively, the Contractor may also provide cable tags made of nylon, cable marking ties with cable number heat stamped on the cable tags. The cable tag requirements mentioned above shall prevail over Tag requirements mentioned elsewhere in this document for HT power, LT power & control cables.</p>		
4.04.18	<p>While crossing the floors, unarmoured cables shall be protected in conduits upto a height of 500 mm from floor level if not laid in tray.</p>		
4.05.00	<p>Cable Terminations & Connections</p>		
4.05.01	<p>The termination and connection of cables shall be done strictly in accordance with cable termination kit manufacturer" instructions, drawings and/or as directed by Project Manager. Cable jointer shall be qualified to carryout satisfactory cable jointing/termination. Contractor shall furnish for review documentary evidence/experience reports of the jointers to be deployed at site.</p>		
4.05.02	<p>Work shall include all clamps, fittings etc. and clamping, fitting, fixing, plumbing, soldering, drilling, cutting, taping, preparation of cable end, crimping of lug, insulated sleeving over control cable lugs, heat shrinking (where applicable), connecting to cable terminal, shorting and grounding as required to complete the job to the satisfaction of the Project Manager.</p>		
4.05.03	<p>The equipment will be generally provided with undrilled gland plates for cables/conduit entry. The Contractor shall be responsible for punching of gland plates, painting and touching up. Holes shall not be made by gas cutting. The holes shall be true in shape. All cable entry points shall be sealed and made vermin and dust proof. Unused openings shall be effectively sealed by 2mm thick aluminium sheets.</p>		
4.05.04	<p>Control cable cores entering control panel/switchgear/MCC/miscellaneous panels shall be neatly bunched, clamped and tied with self locking type nylon cable ties with de interlocking facility to keep them in position.</p>		
4.05.05	<p>All the cores of the control cable to be terminated shall have identification by providing ferrules at either end of the core, each ferrule shall be indelible, printed single tube ferrule and shall include the complete wire number and TB number as per the drawings. The ferrule shall fit tightly on the core. Spare cores shall have similar ferrules with suffix sp1, sp2, ---etc along with cable numbers and coiled up after end sealing.</p>		
4.05.06	<p>All cable terminations shall be appropriately tightened to ensure secure and reliable connections.</p>		
<p>DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p>TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251</p>	<p>SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION</p>	<p>Page 12 of 23</p>


CLAUSE NO.	 TECHNICAL REQUIREMENTS																																			
5.00.00 5.01.00 5.02.00 5.03.00 5.04.00	<p>EARTHING SYSTEM</p> <p>Earthing system shall be in strict accordance with IS:3043 and Indian Electricity Rules/Acts.</p> <p>The earthing system shall be designed for a life expectancy of at least forty (40) years, for a system fault current of 50 kA for 1.0 sec. The minimum rate of corrosion of steel for selection of earthing conductor shall be 0.12mm per year.</p> <p>Earthing system network/earthmat shall be interconnected mesh of mild steel rods buried in ground in the plant. All areas under contractor scope of supply shall be interconnected together by minimum two parallel conductors. The Contractor shall furnish the detailed design and calculations for Employer's approval. Contractor shall obtain all necessary statutory approvals for the system. All the columns shall be earthed by nearby risers and earthmat grid spacing shall be minimum 10 mts. Minimum two nos of risers shall be provided for each equipment in SG area. Separate dedicated riser shall be provided for C&I earthing purpose and also for Lightning down conductor connection purpose. Sufficient nos of risers near the equipment shall be provided as per the system requirement.</p> <p>The earth conductors shall be free from pitting, laminations, rust, scale and other electrical, mechanical defects</p> <p>The material of the earthing conductors shall be as follows:</p> <table border="0" data-bbox="357 994 1299 1182"> <tr> <td>1)</td> <td>Conductors above ground level and in built up trenches.</td> <td>-</td> <td>Galvanized steel</td> </tr> <tr> <td>2)</td> <td>Conductors buried in earth</td> <td>-</td> <td>Mild steel</td> </tr> <tr> <td>3)</td> <td>Earth electrodes</td> <td>-</td> <td>Mild steel rod</td> </tr> </table> <p>The sizes of earthing conductors for various electrical equipments shall be as below:</p> <table border="0" data-bbox="357 1272 1372 1912"> <thead> <tr> <th>Equipment</th> <th>Earth conductor buried in earth</th> <th>Earth conductor above ground level & in built-up trenches</th> </tr> </thead> <tbody> <tr> <td>a) Main earth grid</td> <td>Min 40 mm dia. MS rod or as per actual calculation whichever is more</td> <td>65 x 8mm GS flat</td> </tr> <tr> <td>b) 33kV/11kV/6.6kV/3.3 kV/ switchgear equipment and 415V switchgear</td> <td>---</td> <td>65 x 8mm GS flat</td> </tr> <tr> <td>c) 415 V MCC/ Distribution boards / Transformers</td> <td>---</td> <td>50 x 6mm GS flat</td> </tr> <tr> <td>d) LT Motors above 125 KW</td> <td>---</td> <td>50 x 6mm GS flat</td> </tr> <tr> <td>25 KW to 125 KW</td> <td>---</td> <td>25 x 6mm GS flat</td> </tr> <tr> <td>1KW to 25 KW</td> <td>---</td> <td>25 x 3mm GS flat</td> </tr> </tbody> </table>			1)	Conductors above ground level and in built up trenches.	-	Galvanized steel	2)	Conductors buried in earth	-	Mild steel	3)	Earth electrodes	-	Mild steel rod	Equipment	Earth conductor buried in earth	Earth conductor above ground level & in built-up trenches	a) Main earth grid	Min 40 mm dia. MS rod or as per actual calculation whichever is more	65 x 8mm GS flat	b) 33kV/11kV/6.6kV/3.3 kV/ switchgear equipment and 415V switchgear	---	65 x 8mm GS flat	c) 415 V MCC/ Distribution boards / Transformers	---	50 x 6mm GS flat	d) LT Motors above 125 KW	---	50 x 6mm GS flat	25 KW to 125 KW	---	25 x 6mm GS flat	1KW to 25 KW	---	25 x 3mm GS flat
1)	Conductors above ground level and in built up trenches.	-	Galvanized steel																																	
2)	Conductors buried in earth	-	Mild steel																																	
3)	Earth electrodes	-	Mild steel rod																																	
Equipment	Earth conductor buried in earth	Earth conductor above ground level & in built-up trenches																																		
a) Main earth grid	Min 40 mm dia. MS rod or as per actual calculation whichever is more	65 x 8mm GS flat																																		
b) 33kV/11kV/6.6kV/3.3 kV/ switchgear equipment and 415V switchgear	---	65 x 8mm GS flat																																		
c) 415 V MCC/ Distribution boards / Transformers	---	50 x 6mm GS flat																																		
d) LT Motors above 125 KW	---	50 x 6mm GS flat																																		
25 KW to 125 KW	---	25 x 6mm GS flat																																		
1KW to 25 KW	---	25 x 3mm GS flat																																		
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION	Page 13 of 23																																	


CLAUSE NO.	 TECHNICAL REQUIREMENTS		
	Fractional House power motor e) Control panel & control desk f) Push button station / Junction Box g) Columns, structures, cable trays and bus ducts enclosures h) Crane, rails, rail tracks & other non-current carrying metal parts	--- --- --- --- ---	8 SWG GS wire 25 x 3 mm GS flat 8 SWG GI wire 50 x 6mm GS flat 25 x 6mm GS flat
5.05.00	<p>Metallic frame of all electrical equipment shall be earthed by two separate and distinct connections to earthing system, each of 100% capacity, Crane rails, tracks, metal pipes and conduits shall also be effectively earthed at two points. Steel RCC columns, metallic stairs, and rails etc. of the building housing electrical equipment shall be connected to the nearby earthing grid conductor by one earthing ensured by bonding the different sections of hand rails and metallic stairs. Metallic sheaths/screens, and armour of multi-core cables shall be earthed at both ends. Metallic Sheaths and armour of single core cables shall be earthed at switchgear end only unless otherwise approved. Every alternate post of the switchyard fence shall be connected to earthing grid by one GS flat and gates by flexible lead to the earthed post. Railway tracks within the plant area shall be bonded across fish plates and connected to earthing grid at several locations. Portable tools, appliances and welding equipment shall be earthed by flexible insulated cable.</p>		
5.06.00	<p>Each continuous laid lengths of cable tray shall be earthed at minimum two places by G.S. flats to earthing system, the distance between earthing points shall not exceed 30 meter. Wherever earth mat is not available, necessary connections shall be done by driving an earth electrode in the ground</p>		
5.07.00	<p>Neutral points of HT transformer shall be earthed through NG resistors. The Contractor shall connect the NGR earthing point to earth electrodes by suitable earth conductors.</p>		
5.08.00	<p>Neutral connections and metallic conduits/pipes shall not be used for the equipment earthing. Lightning protection system down conductors shall not be connected to other earthing conductors above the ground level.</p>		
5.09.00	<p>Connections between earth leads and equipment shall normally be of bolted type. Contact surfaces shall be thoroughly cleaned before connections. Equipment bolted connections after being tested and checked shall be painted with anti corrosive paint/compound.</p>		
5.10.00	<p>Suitable earth risers as approved shall be provided above finished floor/ground level, if the equipment is not available at the time of laying of main earth conductor.</p>		
5.11.00	<p>Connections between equipment earthing leads and between main earthing conductors shall be of welded type. For rust protection the welds should be treated with red lead compound and afterwards thickly coated with bitumen compound. All welded connections shall be made by electric arc welding.</p>		
5.12.00	<p>Resistance of the joint shall not be more than the resistance of the equivalent length of conductors.</p>		
5.13.00	<p>Earthing conductors buried in ground shall be laid minimum 600 mm below grade level unless otherwise indicated in the drawing. Back filling material to be placed over buried conductors shall be free from stones and harmful mixtures. Back filling shall be placed in layers of 150 mm.</p>		
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION	Page 14 of 23


CLAUSE NO.	 TECHNICAL REQUIREMENTS																								
5.14.00	Earthing conductors embedded in the concrete floor of the building shall have approximately 50 mm concrete cover.																								
5.15.00	A minimum earth coverage of 300 mm shall be provided between earth conductor and the bottom of trench/foundation/underground pipes at crossings. Earthing conductors crossing the road can be installed in pipes. Wherever earthing conductor crosses or runs at less than 300 mm distance along metallic structures such as gas, water, steam pipe lines, steel reinforcement in concrete, it shall be bonded to the same.																								
5.16.00	Earthing conductors along their run on columns, walls, etc. shall be supported by suitable welding / cleating at interval of 1000mm and 750mm respectively.																								
5.17.00	Earth pit shall be of treated type & shall be constructed as per IS:3043. Electrodes shall be embedded below permanent moisture level. Minimum spacing between electrodes shall be 600mm. Earth pits shall be treated with salt and charcoal as per IS:3043. Test links shall be provided with bolted arrangement alongwith each earth pit, in order to facilitate measurement of earth resistance as & when required.																								
5.18.00	On completion of installation continuity of earth conductors and efficiency of all bonds and joints shall be checked. Earth resistance at earth terminations shall be measured and recorded. All equipment required for testing shall be furnished by contractor.																								
5.19.00	Earthing conductor shall be buried at least 2000mm outside the fence of electrical installations. Every alternate post of the fences and all gates shall be connected to earthing grid by one lead.																								
5.20.00	<p>Other Requirements of Earthing System:</p> <table border="0" data-bbox="357 1093 1463 1883"> <tr> <td>Standard/Code</td> <td>IEEE 80, IS 3043</td> </tr> <tr> <td>Earthing System</td> <td></td> </tr> <tr> <td>Life expectancy</td> <td>40 Years</td> </tr> <tr> <td>System Fault Level</td> <td>System Fault Level 50 KA for 1 sec</td> </tr> <tr> <td>Soil resistivity</td> <td>Actual as per site conditions.</td> </tr> <tr> <td>Min. Steel corrosion</td> <td>0.12mm/year</td> </tr> <tr> <td>Depth of burial of main earth conductor</td> <td>600mm below grade level; where it crosses trenches, pipes, ducts, tunnels, rail tracks, etc., it shall be at least 300mm below them.</td> </tr> <tr> <td>Conductor joints</td> <td>By electric arc welding, with resistance of joint not more than that of the conductor.</td> </tr> <tr> <td colspan="2">Welds to be treated with red lead for rust protection and then coated with bitumen compound for corrosion protection.</td> </tr> <tr> <td>Surface resistivity</td> <td>- Gravel 3000 ohm-meter</td> </tr> <tr> <td></td> <td>- Concrete 500 ohm-meter</td> </tr> </table>			Standard/Code	IEEE 80, IS 3043	Earthing System		Life expectancy	40 Years	System Fault Level	System Fault Level 50 KA for 1 sec	Soil resistivity	Actual as per site conditions.	Min. Steel corrosion	0.12mm/year	Depth of burial of main earth conductor	600mm below grade level; where it crosses trenches, pipes, ducts, tunnels, rail tracks, etc., it shall be at least 300mm below them.	Conductor joints	By electric arc welding, with resistance of joint not more than that of the conductor.	Welds to be treated with red lead for rust protection and then coated with bitumen compound for corrosion protection.		Surface resistivity	- Gravel 3000 ohm-meter		- Concrete 500 ohm-meter
Standard/Code	IEEE 80, IS 3043																								
Earthing System																									
Life expectancy	40 Years																								
System Fault Level	System Fault Level 50 KA for 1 sec																								
Soil resistivity	Actual as per site conditions.																								
Min. Steel corrosion	0.12mm/year																								
Depth of burial of main earth conductor	600mm below grade level; where it crosses trenches, pipes, ducts, tunnels, rail tracks, etc., it shall be at least 300mm below them.																								
Conductor joints	By electric arc welding, with resistance of joint not more than that of the conductor.																								
Welds to be treated with red lead for rust protection and then coated with bitumen compound for corrosion protection.																									
Surface resistivity	- Gravel 3000 ohm-meter																								
	- Concrete 500 ohm-meter																								
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION	Page 15 of 23																						


CLAUSE NO.	 TECHNICAL REQUIREMENTS			
<p>6.00.00</p> <p>6.01.01</p> <p>6.01.02</p> <p>6.01.03</p> <p>6.02.00</p> <p>7.00.00</p> <p>7.01.01</p> <p>7.01.02</p> <p>7.01.03</p>	<p>LIGHTNING PROTECTION SYSTEM</p> <p>Lightning protection system shall be in strict accordance with IEC: 62305 and latest IS standards.</p> <p>Lightning conductor shall be of 25x6mm GS strip when used above ground level and shall be connected through test link with earth electrode/earthing system</p> <p>Lightning system shall comprise of air terminations, down conductors, test links, earth electrode etc. as per approved drawings.</p> <p>Down Conductors</p> <ol style="list-style-type: none"> 1. Down conductors shall be as short and straight as practicable and shall follow a direct path to earth electrode. 2. Each down conductor shall be provided with a test link at 1000 mm above ground level for testing but it shall be in accessible to interference. No connections other than the one direct to an earth electrode shall be made below a test point. 3. All joints in the down conductors shall be welded type. 4. Down conductors shall be cleated on outer side of building wall, at 750 mm interval or welded to outside building columns at 1000 mm interval. 5. Lightning conductor on roof shall not be directly cleated on surface of roof. Supporting blocks of PCC/insulating compound shall be used for conductor fixing at an interval of 1500 mm. 6. All metallic structures within a vicinity of two meters of the conductors shall be bonded to conductors of lightning protection system. 7. Lightning conductors shall not pass through or run inside GI Conduits. 8. Testing link shall be made of galvanized steel of size 25x 6mm. 9. Pulser system for lightning shall not be accepted. 10. Hazardous areas handling inflammable/explosive materials and associated storage areas shall be protected by a system of aerial earths. <p>TESTS</p> <p>All equipment to be supplied shall be of type tested design. During detail engineering, the contractor shall submit for Employer's approval the reports of all the type tests as listed in this specification and carried out within last ten years from the date of bid opening. These reports should be for the test conducted on the equipment similar to those proposed to be supplied under this contract and the test(s) should have been either conducted at an independent laboratory or should have been witnessed by a client.</p> <p>However if the contractor is not able to submit report of the type test(s) conducted within last ten years from the date of bid opening, or in the case of type test report(s) are not found to be meeting the specification requirements, the contractor shall conduct all such tests under this contract at no additional cost to the Employer either at third party lab or in presence of client/Employers representative and submit the reports for approval.</p> <p>All acceptance and routine tests as per the specification and relevant standards shall be carried out. Charges for these shall be deemed to be included in the equipment price.</p>	<p>TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251</p>	<p>SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION</p>	<p>Page 16 of 23</p>


CLAUSE NO.	 TECHNICAL REQUIREMENTS		
7.02.00 7.02.01	<p>Type Test reports shall be furnished for the following</p> <p>Type tests on Cable Trays support system</p> <p>a) Test 1A:</p> <p>On main support channel type-C2 for cantilever arms fixed on one side only. A 3.5 meter length of main support channel shall be fixed vertically at each end to a rigid structure as per the fixing arrangement as shown in the enclosed drawing. Eight (8) nos. 750 mm cantilever arms shall be fixed to the main channel and each arm shall be loaded over the outboard 600 mm with a uniform working load of 100 kg. Subsequently a point load of 100 kg shall be applied on arm 2. A uniform proof load on all the arms equal to twice the working load shall be then be applied. Deflections shall be measured at the points shown in the enclosed drawings and at the following load intervals:</p> <ul style="list-style-type: none"> i) Working load ii) Working load + point load iii) Off load iv) Proof load + point load v) Off load <p>The deflection measured at working loads shall not exceed 16mm. The permanent deflection after removing the combination of working load and point load shall not exceed 10 mm at the arm tips and 6 mm on the channel. No collapse of the structure shall occur with a combination of proof load and point load applied.</p> <p>B) Test 1B:</p> <p>Test 1A shall be repeated with Eight Cantilever arms uniformly loaded and with the same point load on arm 2</p> <p>Test 2: On Main support channel type -C2 for cantilever arms fixed on both sides</p> <p>a) Test 2A: A 3.5 m length of main support channel C2 for cantilever arms fixing on both sides shall be fixed at each end to rigid structure as per the fixing arrangement as shown in the enclosed drawing. Six (6), 750 mm cantilever arms shall be attached to each sides and each arm uniformly loaded to a working load of 100 kg over the out board 600 mm. A point load of 100 kg shall than be applied to arm 2, followed by a uniform proof load of twice the working load on all the arms; deflection shall be measured at points shown in the enclosed drawings at the following load intervals.</p> <ul style="list-style-type: none"> i) Working load ii) Working load + Point load iii) Off load iv) Proof load + Point load 		
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION	Page 17 of 23


<p>CLAUSE NO.</p>	 <p style="text-align: center;">TECHNICAL REQUIREMENTS</p>		
	<p style="text-align: center;">v) Off load</p> <p>The deflection measured at working loads shall not exceed 16mm. The permanent deflection after removing the combination of working load and point load shall not exceed 10 mm at the arm tips and 6 mm on the channel. No collapse of the structure shall occur with a combination of proof load and point load applied</p> <p>b) Test 2 B: The test 2 A shall be repeated with the assembly but with an asymmetrical load on the C2 column and point load applied to arm 8. The 100 kg and 200 kg uniformly distributed loads shall be applied to the upper three arms on one side and the lower three arms on the opposite side.</p> <p>Test 3: Tests on Channel Fixed on Beam/Floor</p> <p>A length of main support channel section shall be fixed to steel structure/floor and have loads applied as shown in the drawing enclosed and as detailed below</p> <p>a) Test 3A : A length of steel structure shall be rigidly supported. It should be fitted on a meter length of channel section using beam clamps welded/bolted. A point load of 1200 kg shall be applied to the centre point via two brackets. No distortion or pulling of the components shall take place.</p> <p>b) Test 3B: With the components assembled as in Test 3A, two perpendicular point loads of 600 kg shall be simultaneously applied at positions 150 mm either side of the centre line, no distortion or pulling of the components shall take place.</p> <p>c) Test 3C: With the components assembled as in Test 3A, a perpendicular point load shall be applied at a point 150 mm on one side of the centre line.</p> <p>The load shall be gradually increased to the maximum value that can be applied without causing distortion or pulling of the components. This value shall be recorded.</p> <p>Test 4 : Channel Insert Test</p> <p>A 2.5 m length of C1 channel fixed to the concrete wall/ steel structure as per actual site installation conditions. 6 nos. of 750 mm cantilever arms shall be attached to C1 channel as shown in enclosed drawing. Each arm uniformly loaded to a working load of 100 kg over the out board 600 mm. A point load of 100 kg shall than be applied to arm 2, followed by a uniform proof load of twice the working load on all the arms; deflection shall be measured at points shown in the enclosed drawings at the following load intervals.</p> <p style="margin-left: 40px;">i) Working Load</p> <p style="margin-left: 40px;">ii) Working Load + Point Load</p> <p style="margin-left: 40px;">iii) Off Load</p> <p style="margin-left: 40px;">iv) Proof Load + Point Load</p> <p style="margin-left: 40px;">v) Off load</p> <p>The deflection measured at working loads shall not exceed 16mm. The permanent deflection after removing the combination of working load and point load shall not exceed 10</p>		
<p>DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE</p>	<p style="text-align: center;">TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251</p>	<p style="text-align: center;">SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION</p>	<p style="text-align: center;">Page 18 of 23</p>

CLAUSE NO.	 TECHNICAL REQUIREMENTS		
	<p>mm at the arm tips and 6 mm on the channel. No collapse of the structure shall occur with a combination of proof load and point load applied</p> <p>Test 5 : Channel nut slip characteristics (what ever applicable)</p> <p>Tests 5A1,5A2,5A3 : A length of channel C1 section 200mm long shall have fitted bracket with the two bolt fixing as shown in drawing enclosed. With loads applied at the position shown in drawing enclosed nut slip shall be determined with bolt torque of 30NM, 50 NM and 65 NM No fewer than three measurements shall be made for each torque setting.</p> <p>A minimum loading of 720 kg shall be obtained before nut slip with bolt torque of 65 NM.</p> <p>Tests 5B1,5B2, 5B3: The length of channel C1 section 200 mm long shall have fitted bracket with the one bolt fixing as shown in drawing enclosed. With loads applied at the position shown in drawing, nut slip shall be determined with bolt torques of 30 NM, 50 NM and 65 NM. No fewer than three measurements shall be made for each torque setting.</p> <p>A minimum loading of 350 kg shall be obtained before nut slip with a bolt torque of 65 NM.</p> <p>Test 6 Weld Integrity Test</p> <p>After deflection test as per test 1A, 1B, 2, 3 & 4 weld integrity shall be checked by magnetic particle inspection to detect sub-surface cracks developed, if any.</p> <p>7.02.02 Cable termination kit and straight through joints should have been tested as per IS:13573 for 3.3kV grade & above.</p> <p>7.03.00 Routine/ Acceptance Tests</p> <p>7.03.01 Routine Tests</p> <p>a) Routine tests as per specification and applicable standards shall be carried out on all requirements/items covered in the specification.</p> <p>b) Physical & dimensional check on all equipments as per approved drawings/standards</p> <p>c) HV/IR as applicable.</p> <p>d) Check/measurement of thickness of paint/zinc coating/nickel-chrome plating as per specification & applicable standard.</p> <p>7.03.02 Acceptance Test</p> <p>a) Galvanising Tests as per applicable standards</p> <p>b) Welding checks</p> <p>c) Deflection tests on cable trays:</p>		
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION	Page 19 of 23


CLAUSE NO.	 TECHNICAL REQUIREMENTS		
	<p>d) One piece each of 2.5m length of cable tray of 300mm & above shall be taken as sample from each offered lot. It shall be supported at both end & loaded with uniform load of 76 kg/meter along the length of cable tray. The maximum deflection at the mid-span of each size shall not exceed 7mm.</p> <p>d) Proof load tests on cable tray support system</p> <p>i) Tests on Main Support Channel shall be done if only C1 Channel are in scope of supply and cantilever arms shall be fitted on one side. This test shall be same as test 4 of type test.</p> <p>ii) Test on Main Support Channel shall be done with C2 channel and cantilever arms fitted on both sides, if C2 channels are in scope of supply. This test shall be same as test 2A of type test. Then test (i) above shall not be done.</p> <p>iii) Nut slip characteristic test (it shall support minimum load of 350kg before nut slips with a bolt torque of 65 NM). This test shall be same as test 5B3 of type test. The procedure for carrying out tests at “d” above shall be as per details given in Type Tests in specification thereafter Die-Penetration test shall be carried out to check weld integrity.</p> <p>e) The above acceptance tests shall be done only on one sample from each offered lot.</p>		
8.00.00	COMMISSIONING		
8.01.01	The Contractor shall carry out the following commissioning tests and checks after installation at site. In addition the Contractor shall carry out all other checks and tests as recommended by the Manufacturers or else required for satisfactory performance.		
8.01.02	<p>Cables</p> <p>a) Check for physical damage</p> <p>b) Check for insulation resistance before and after termination/jointing.</p> <p>c) HT cables shall be pressure tested (test voltage as per IS:7098) before commissioning.</p> <p>d) Check of continuity of all cores of the cables.</p> <p>e) Check for correctness of all connections as per relevant wiring diagrams. Any minor modification to the panel wiring like removing/inserting, shorting, change in terminal connections, etc., shall be carried out by the Contractor.</p> <p>f) Check for correct polarity and phasing of cable connections.</p> <p>g) Check for proper earth connections for cable glands, cable boxes, cable armour, screens, etc.</p> <p>h) Check for provision of correct cable tags, core ferrules and tightness of connections.</p>		
8.02.00	Cable trays / supports and accessories		
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION	Page 20 of 23

CLAUSE NO.	 TECHNICAL REQUIREMENTS												
8.03.00	<p>1) Check for proper galvanizing/painting and identification number of the cable trays/supports and accessories.</p> <p>2) Check for continuity of cable trays over the entire route.</p> <p>3) Check that all sharp corners, burrs, and waste materials have been removed from the trays supports.</p> <p>4) Check for earth continuity and earth connection of cable trays.</p> <p>Earthing and Lightning protection system</p> <p>1) Earth continuity checks.</p> <p>2) Earth resistance of the complete system as well as sub-system.</p>												
9.00.00	<p>ELECTRICAL LAYOUT PHILOSOPHY:</p> <p>While developing the layout the bidder must give due consideration to the following requirements:</p> <p>a) Adequate distance shall be maintained between the transformers. As basic guidelines following norms will be adhered to:</p> <p>1) Transformers shall be separated from the adjacent building/structures and from each other by a minimum distance as defined below or by a fire wall of two hours of fire resisting of height at least 600 mm above bushing / pressure relief vent whichever is higher.</p> <table border="0" data-bbox="550 1176 1348 1444"> <thead> <tr> <th style="text-align: center;">Oil capacity of individual transformer (in liters)</th> <th style="text-align: center;">Clear separating distance (in meters)</th> </tr> </thead> <tbody> <tr> <td style="text-align: center;">5,000 to 10,000</td> <td style="text-align: center;">8.0</td> </tr> <tr> <td style="text-align: center;">10,001 to 20,000</td> <td style="text-align: center;">10.0</td> </tr> <tr> <td style="text-align: center;">20,001 to 30,000</td> <td style="text-align: center;">12.5</td> </tr> <tr> <td style="text-align: center;">Over 30,001</td> <td style="text-align: center;">15.0</td> </tr> </tbody> </table> <p>2) In case of auxiliary transformers having an aggregate oil capacity in excess of 2300 liters but individual oil capacity of less than 5000 liters, the maximum separating distance between transformers and surrounding building shall be at least 6M unless they are separated by fire separating walls or are protected by high velocity spray system.</p> <p>3.) Rail track shall be provided in Transformer yard for movement of each transformer. The rail track in Transformer yard shall be connected with TG area rail track The Foundation top of transformer & rail top shall be at EL +/- 0.0M. Bus duct support or Transformer body shall be at least 8.0M from A-Row of TG building to clear the movement of GT/ Stator/UT/ST/UAT on rail line. Jacking pads shall be provided where the rail track changes the direction. Mooring post shall be provided on rail track for handling the transformers.</p>	Oil capacity of individual transformer (in liters)	Clear separating distance (in meters)	5,000 to 10,000	8.0	10,001 to 20,000	10.0	20,001 to 30,000	12.5	Over 30,001	15.0		
Oil capacity of individual transformer (in liters)	Clear separating distance (in meters)												
5,000 to 10,000	8.0												
10,001 to 20,000	10.0												
20,001 to 30,000	12.5												
Over 30,001	15.0												
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION	Page 21 of 23										

CLAUSE NO.	 TECHNICAL REQUIREMENTS		
	<p>4) For each transformer a pit shall be provided all around at a distance of 1.5 m (minimum) from transformer outer edge. A sump pit shall be provided for each pit. A common oil retention pit per unit shall be provided to hold oil quantity of the largest transformer (by volume) & 10 minutes of water quantity of HWV spray system for the largest transformer. Sump pit of individual transformer shall be connected to common oil retention pit of that unit.</p> <p>5) Rail track shall be provided for all outdoor transformers up to road for movement of each transformer of size more than or equal to 7.5MVA Transformer. Jacking pads shall be provided where the rail track changes the direction. Jacking pad shall also be provided at the location of installation of transformer and mooring post shall be provided on rail track for handling the transformers.</p> <p>6.) The Transformer fencing shall be at 1.0 M (minimum) distance from the pit wall. The Height of fencing shall be 2.5 M (minimum) and fencing shall have personal entry gate and removable type fencing/gate for transformer withdrawal.</p> <p>7) The transformer firewall, pit sizing and clearances from adjacent building/structures etc. shall be as per IS 1646/CBIP manual on Transformer</p> <p>8) However, for all outdoor transformers of oil capacity less than 2000 litre, a trench of suitable size shall be provided all around at a distance of 1.0 m (minimum) from transformer outer edge. A sump pit shall be provided for each trench.</p> <p>b) Layout requirements for Electrical MCC/switchgear rooms</p> <p>1. Separate Switchgear Rooms shall be provided for each unit. For TG building, all HT boards shall be provided in HT switchgear room at only one floor and all LT boards shall be provided in LT switchgear room at only one floor</p> <p>2. The following clearances shall be maintained for HT Switchboard.</p> <p>a.) Front Clearance</p> <p>i) For one Row of Swgr. - 2.0 M (Min)</p> <p>ii) For two Rows of Swgr. - 2.5 M (Min)</p> <p>b.) Back Clearance - 1.5 M (Min.)</p> <p>c.) Side Clearance</p> <p>Min. 800 mm, however provision to be made for any additional panel in future at both ends. Therefore end clearance shall be 800+width of panel (including spare panels/dummy panels etc.)</p> <p>3. The following clearances shall be maintained for LT Switchboard.</p> <p>a.) Front Clearance</p> <p>i) For one Row of Swgr - 1.5M (Min)</p> <p>ii) For two Rows of Swgr - 1.5/1.75M depending upon the depth of panels etc</p> <p>b.) Back Clearance</p> <p>i) For single front - 1.0M (Min)</p>		
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION	Page 22 of 23

CLAUSE NO.	 TECHNICAL REQUIREMENTS		
	<p>ii) For double front - 1.5M (Min)</p> <p>c.) Side Clearance</p> <p>Min. 800 mm, however provision to be made for any additional panel in future at both ends. Therefore end clearance shall be 800 mm + width of panel.</p> <p>For offsite areas, HT Switchboard clearances shall be followed wherever both LT & HT switch boards are in the same MCC room.</p> <p>4. Height of HT/LT Switchgear Room and Boiler MCC room</p> <p>i) With Bus Duct – 4.5 m (min) ii) Without Bus Duct – 4.0 m (min)</p> <p>Further no vertical bracings shall be envisaged in HT/LT switchgear room and associated cable vault area.</p> <p>5. Cable trench/Cable vault</p> <p>For LT switchgear/MCC room at EL 0.0M, minimum 1400 wide x 1400 deep cable trench shall be provided to route the cables. Horizontal cable trays shall be routed in cable trenches.</p> <p>c) Minimum clear working space around the equipment 1200mm</p> <p>d) In buildings having MCC, minimum 2 fire door along with one rolling shutter of adequate size/capacity shall be provided.</p> <p>e) The cable entry and exit from switchgear room shall be from 1.5 mtr (minimum) above FGL.</p>		
DCRTPP YAMUNA NAGAR (2X300MW) FLUE GAS DESULPHURISATION (FGD) SYSTEM PACKAGE	TECHNICAL SPECIFICATION SECTION-VI, PART-B BID DOC. NO.: 32/CE/PLG/DCRTPP/FGD-251	SUB SECTION-II-E6 CABLING, EARTHING & LIGHTNING PROTECTION	Page 23 of 23

This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.



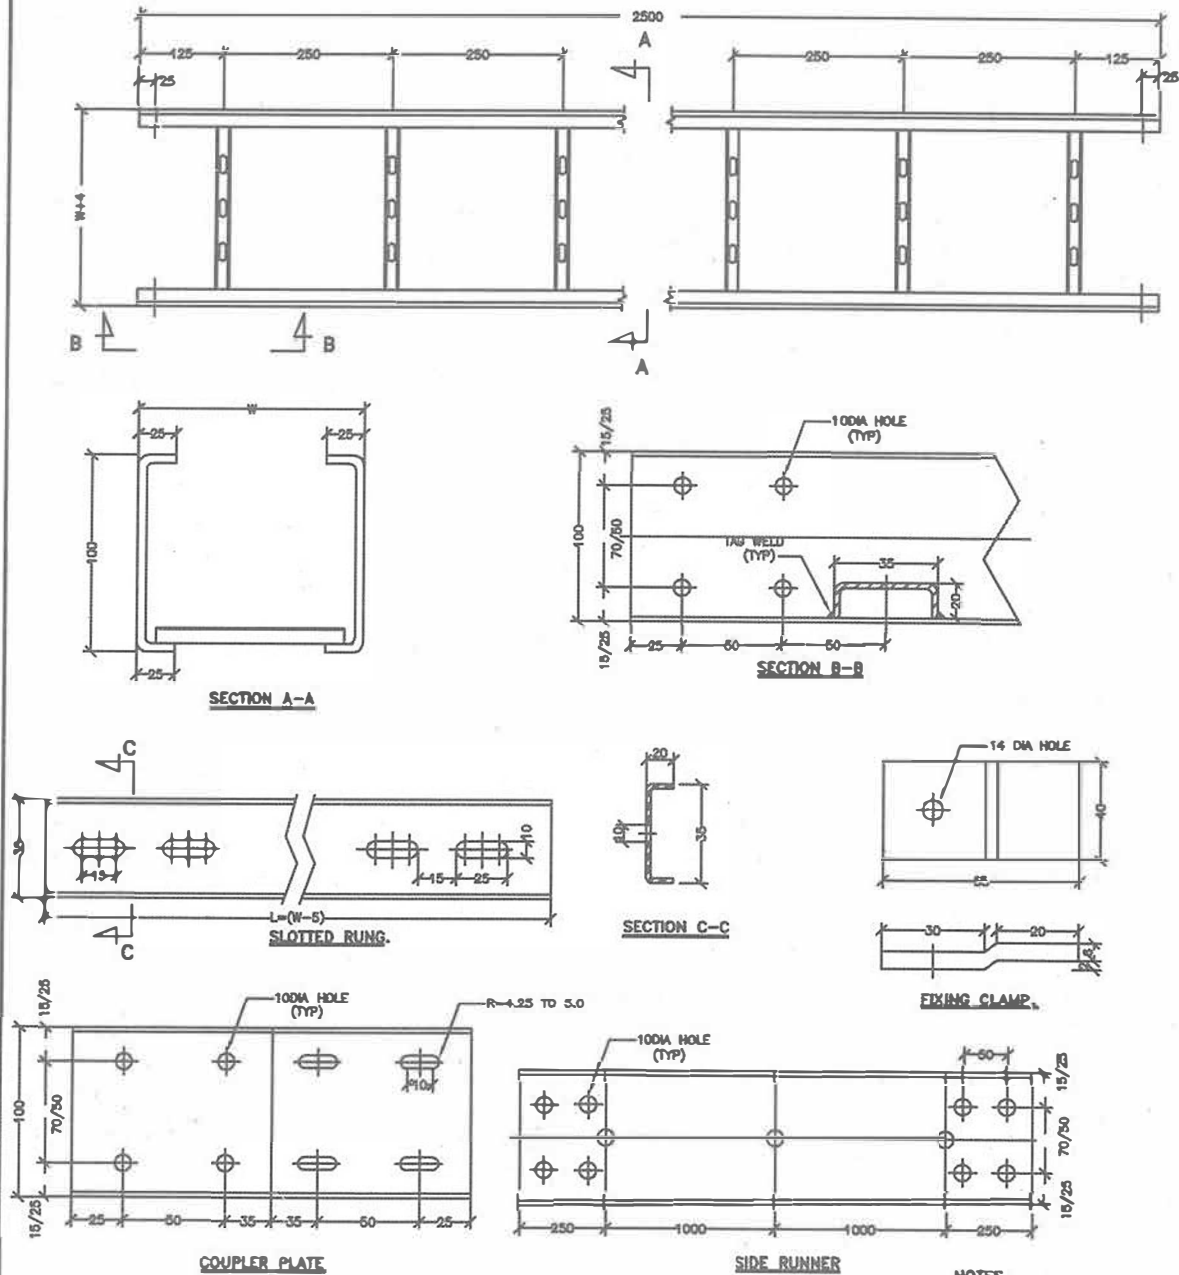


NOTES.

1. ALL DIMENSIONS ARE IN mm.
2. MATERIAL--2mm THICK MS SHEET.
3. FINISH --HOT DIP GALVANISED
4. THICKNESS:--3mm COUPLER PLATE
2mm TRAY.
5. TOLERANCE:--AS PER RELEVANT I.S.

RD	FOR TENDER PURPOSE	M3	M3	REL	-	N	-	-	-	AS	05-07-17	
RC	FOR TENDER PURPOSE	DL	DL	SS	-	RA	-	-	-	AS	05.07.2000	
RB	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	07.04.2000	
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	17.05.2000	
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE	
		CLEARED BY										
PROJECT		STANDARD										
TITLE		LADDER TYPE CABLE TRAY.										
SIZE	SCALE	DRG. NO.							REV. NO.			
A4	NTS	0000-211-PDE-A-001							RD			


This drawing and the design it covers are the property of NIPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

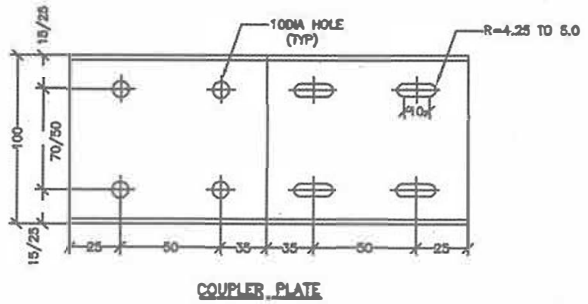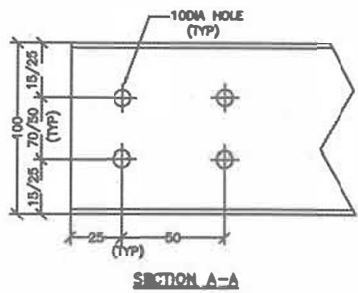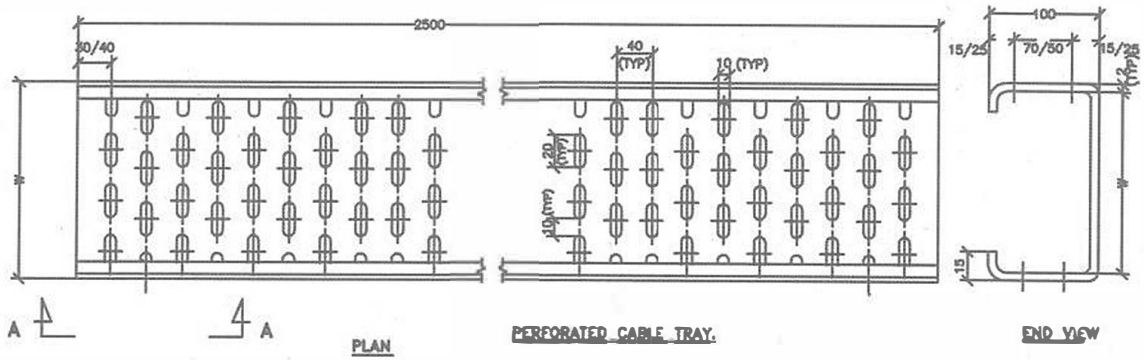


- NOTES.**
1. ALL DIMENSIONS ARE IN mm.
 2. MATERIAL:-2mm THICK MS SHEET.
 3. FINISH :-HOT DIP GALVANISED
 4. THICKNESS:-3mm COUPLER PLATE
2mm TRAY.
 5. TOLERANCE:-AS PER RELEVANT I.S.
 6. INNER WIDTH (W) :- 150, 300 & 600mm.

RD	FOR TENDER PURPOSE	h2	h3	RKP	-	WV	-	-	-	AS	05.07.2000
RC	FOR TENDER PURPOSE	DL	DL	SS	-	RA	-	-	-	AS	05.07.2000
RB	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	17.04.2000
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	17.04.2000
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE
					CLEARED BY						
PROJECT		STANDARD									
TITLE		PERFORATED TYPE CABLE TRAY.									
SIZE	SCALE	DRG. NO.							REV. NO.		
A4	NTS	0000-211-PDE-A-002							RD		

This drawing and the design it covers are the property of NTPC LTD. It must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

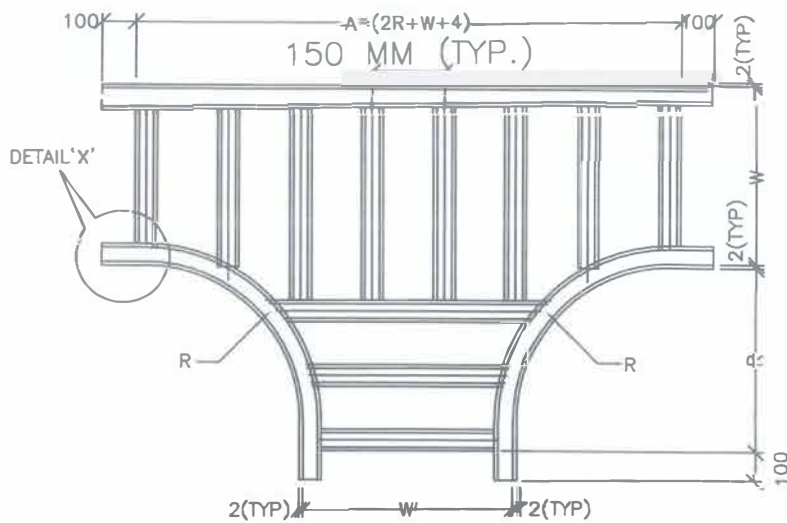

HORIZONTAL TEE

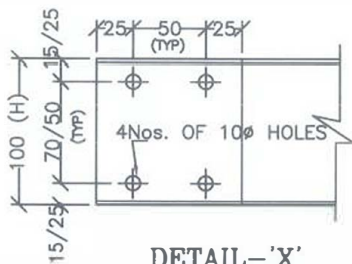

DETAIL - 'X'

INNER WIDTH OF TRAY (W)	DEPTH OF TRAY (H)	BENDING RADIUS (R)	A		
			150	300	600
150, 300 & 600	100	1200	2554	2704	3004

NOTES.

1. ALL DIMENSIONS ARE IN mm.
2. INNER WIDTH (W) :- 150, 300 & 600mm.
3. MATERIAL :- 2mm. THICK MS SHEET.
4. TOLERANCE :- AS PER RELEVANT I.S.
5. FINISH :- HOT DIP GALVANISED
6. ALL HARDWARE SHALL BE GALVANISED AS PER STANDARD.

RD	FOR TENDER PURPOSE	✓C	✓K	✓R	✓W					15/06/17
RC	FOR TENDER PURPOSE	AB	AB	RKF	-	VV	-	-	-	DT 15/07/2016
RB	FOR TENDER PURPOSE	DL	DL	SS	-	RA	-	-	-	AS 15/07/2016
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	17/08/2016

REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE	
					CLEARED BY							

(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION





PROJECT: **STANDARD**

TITLE: **CABLE TRAY DETAILS
HORIZONTAL TEE**

SIZE: A4	SCALE: NTS	DRG. NO.: 0000-211-PDE-A-004	REV. NO.: RD
----------	------------	------------------------------	--------------

This drawing and the design covers are the property of NTPC LTD. and must not be copied, loaned

or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

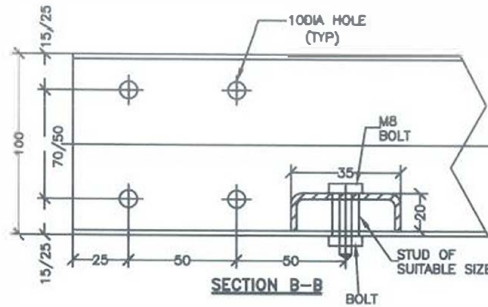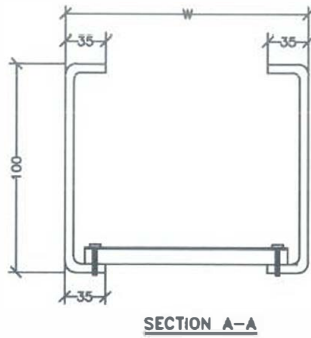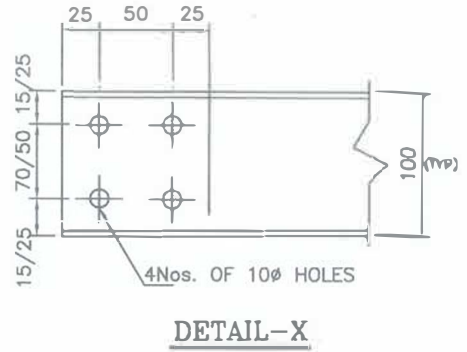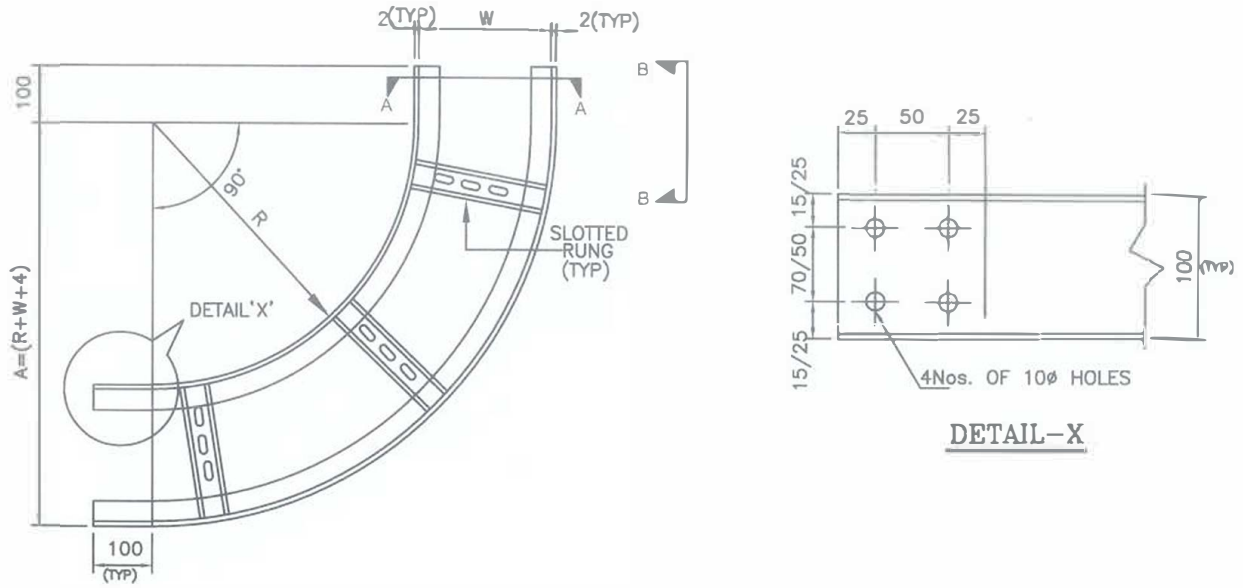

HORIZONTAL BEND 90° (BOTH LEFT & RIGHT)

INSIDE WIDTH OF TRAY(W)	DEPTH OF TRAY (H)	BENDING RADIUS(R)	A		
			150	300	600
150, 300 & 600	100	1200	1354	1504	1804


NOTES.

1. ALL DIMENSIONS ARE IN mm.
2. INNER WIDTH (W) :- 150, 300 & 600mm.
3. MATERIAL :- 2mm. THICK MS SHEET.
4. TOLERANCE :- AS PER RELEVANT I.S.
5. FINISH :- HOT DIP GALVANISED
6. ALL HARDWARE SHALL BE GALVANISED AS PER STANDARD.


RD	FOR TENDER PURPOSE	VC	VC	RKP	W						
RC	FOR TENDER PURPOSE	AB	AB	RKP	VV					DT	
RB	FOR TENDER PURPOSE	DL	DL	SS	-	RA	-	-	-	AS	25.07.2010
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	17.01.2000
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE

PROJECT											
STANDARD											
TITLE											
CABLE TRAY 90° BENDS (CTB 90°)											
SIZE	SCALE	DRG. NO.								REV. NO.	
A4	NTS	0000-211-PDE-A-005								R6	


This drawing and the design covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

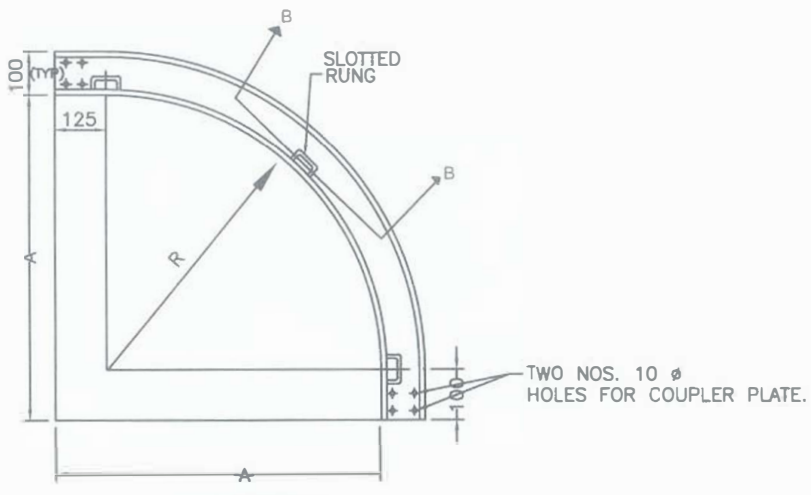


ELEVATION
90° VERTICAL ELBOW
(UPSIDE)

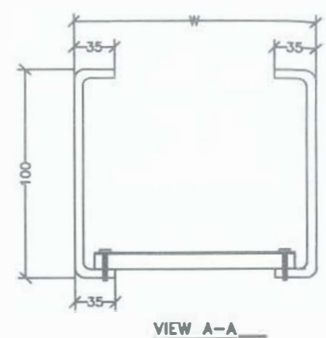

VIEW A-A

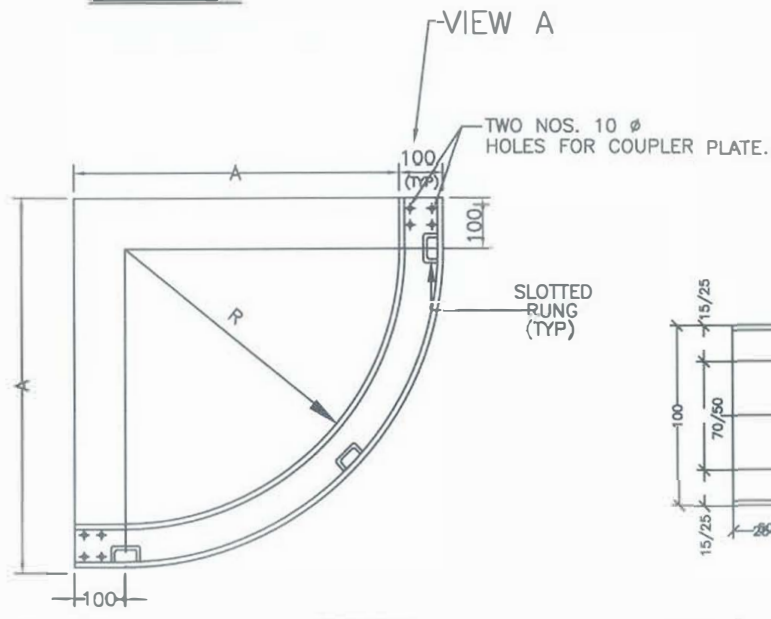

90° VERTICAL BEND
(DOWNSIDE)

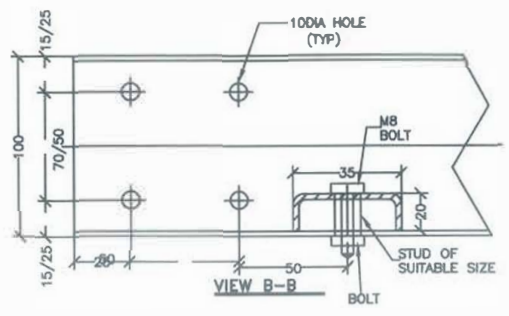

VIEW B-B

INSIDE WIDTH OF TRAY (W)	BENDING RADIUS (R)	A
150, 300 & 600	1050	1150

- NOTES.**
1. ALL DIMENSIONS ARE IN mm.
 2. INNER WIDTH (W) :- 150, 300 & 600mm.
 3. MATERIAL :- 2mm. THICK MS SHEET.
 4. TOLERANCE :- AS PER RELEVANT I.S.
 5. FINISH :- HOT DIP GALVANISED
 6. ALL HARDWARE SHALL BE GALVANISED AS PER STANDARD.


RD	FOR TENDER PURPOSE	NC	NC	RK	W					15/12/20	
RC	FOR TENDER PURPOSE	AB	AB	RKP	VV					DT	
RB	FOR TENDER PURPOSE	DL	DL	SS	-	RA	-	-	-	AS 25.07.2000	
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	17.01.2000	
REV NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE
					CLEARED BY						



NTPC LTD.
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION

PROJECT		STANDARD	
TITLE			
CABLE TRAY 90° VERTICAL ELBOW (OUTSIDE)			
90° VERTICAL ELBOW (INSIDE)			
SIZE	SCALE	DRG. NO.	REV. NO.
A4	NTS	0000-211-PDE-A-006	RD

This drawing and the design covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

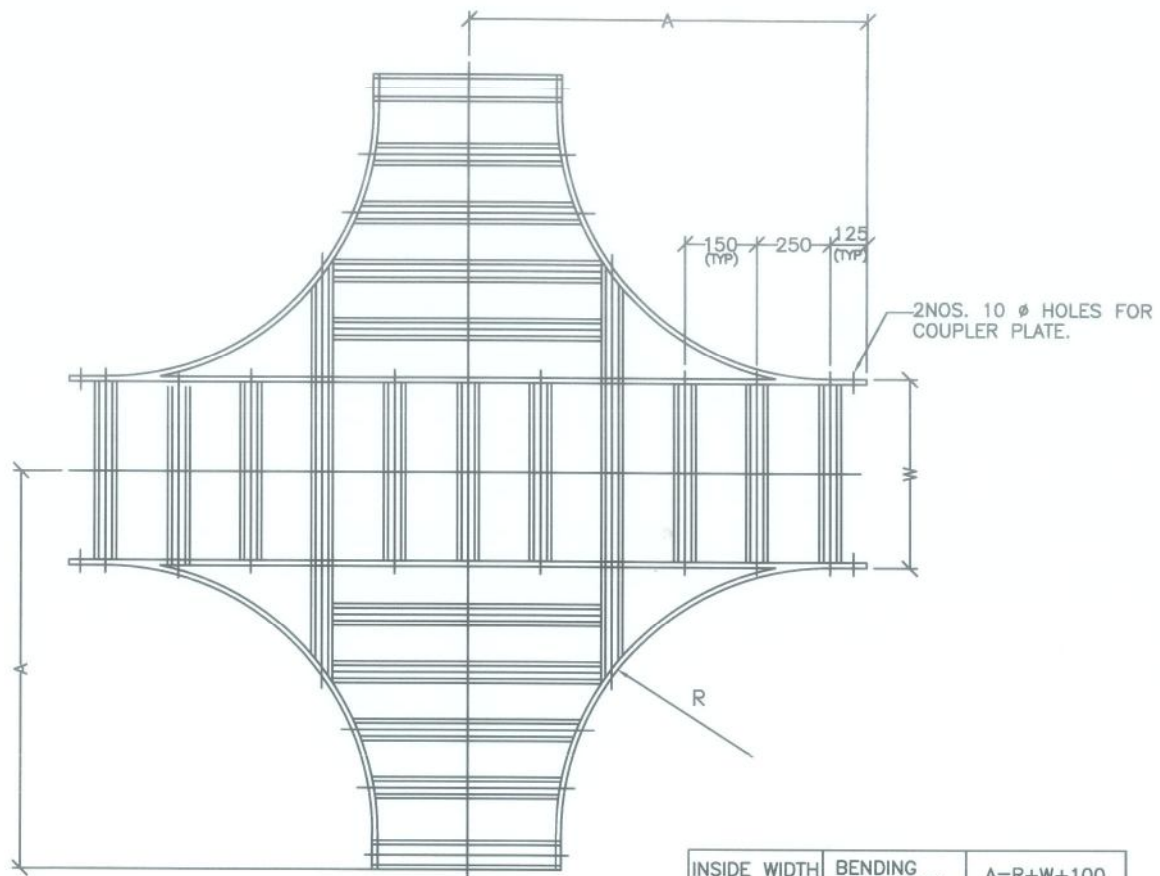

PLAN

INSIDE WIDTH OF TRAY (W)	BENDING RADIUS (R)	$A=R+W+100$ $\frac{2}$
600	1050	1450
300	1050	1300

NOTES.

1. ALL DIMENSIONS ARE IN mm.
2. INNER WIDTH (W) :- 150, 300 & 600mm.
3. MATERIAL :- 2mm. THICK MS SHEET.
4. TOLERANCE :-AS PER RELEVANT I.S.
5. FINISH :-HOT DIP GALVANISED
6. ALL HARDWARE SHALL BE GALVANISED AS PER STANDARD.


RD	FOR TENDER PURPOSE	vc	vc	kd		vv								
RC	FOR TENDER PURPOSE	AB	AB	RKP		VV							DT	
RB	FOR TENDER PURPOSE	DL	DL	SS	-	RA	-	-	-	-	-	-	AS	25.07.2000
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	-	-	-	27.01.2000
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE			
CLEARED BY														




NTPC LTD.
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION

PROJECT		STANDARD		
TITLE		CABLE TRAY DETAILS CROSS		
SIZE	SCALE	DRG. NO.		REV. NO.
A4	NTS	0000-211-POE-A-008		RD

This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

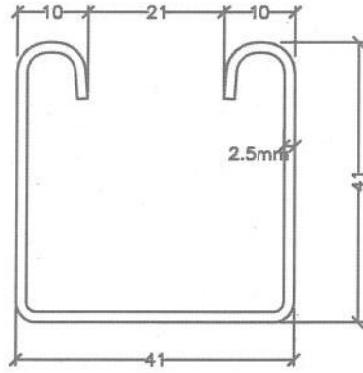

SINGLE CHANNEL-TYPE C1

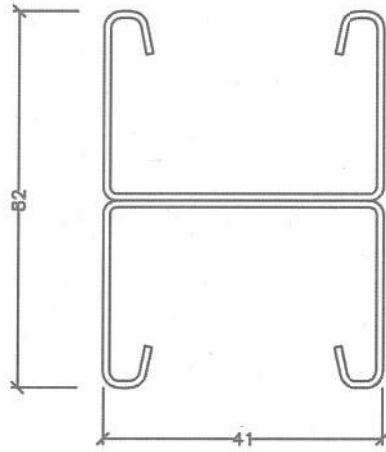

TWO LENGTHS OF C1 WELDED BACK TO BACK

DOUBLE CHANNEL-TYPE C2

NOTES.

1. ALL DIMENSIONS ARE IN mm.
2. MATERIAL :- 2.5mm. THICK MS SHEET.
3. TOLERANCE :-AS PER RELEVANT I.S.
4. FINISH :-HOT DIP GALVANISED

RC	FOR TENDER PURPOSE	M3	M3	DR	-	VV	-	-	-	-	AS	05.07.12
RB	FOR TENDER PURPOSE	DL	DL	SS	-	RA	-	-	-	-	AS	05.07.12
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	-	07.08.08
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE	
CLEARED BY												



NTPC LTD.
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION

PROJECT

STANDARD

TITLE

C1 & C2 CHANNEL, CABLE TRAY
SUPPORT SYSTEM

SIZE
A4


SCALE
NTS

DRG. NO.

0000-211-PDE-A-013


REV. NO.
RC

This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

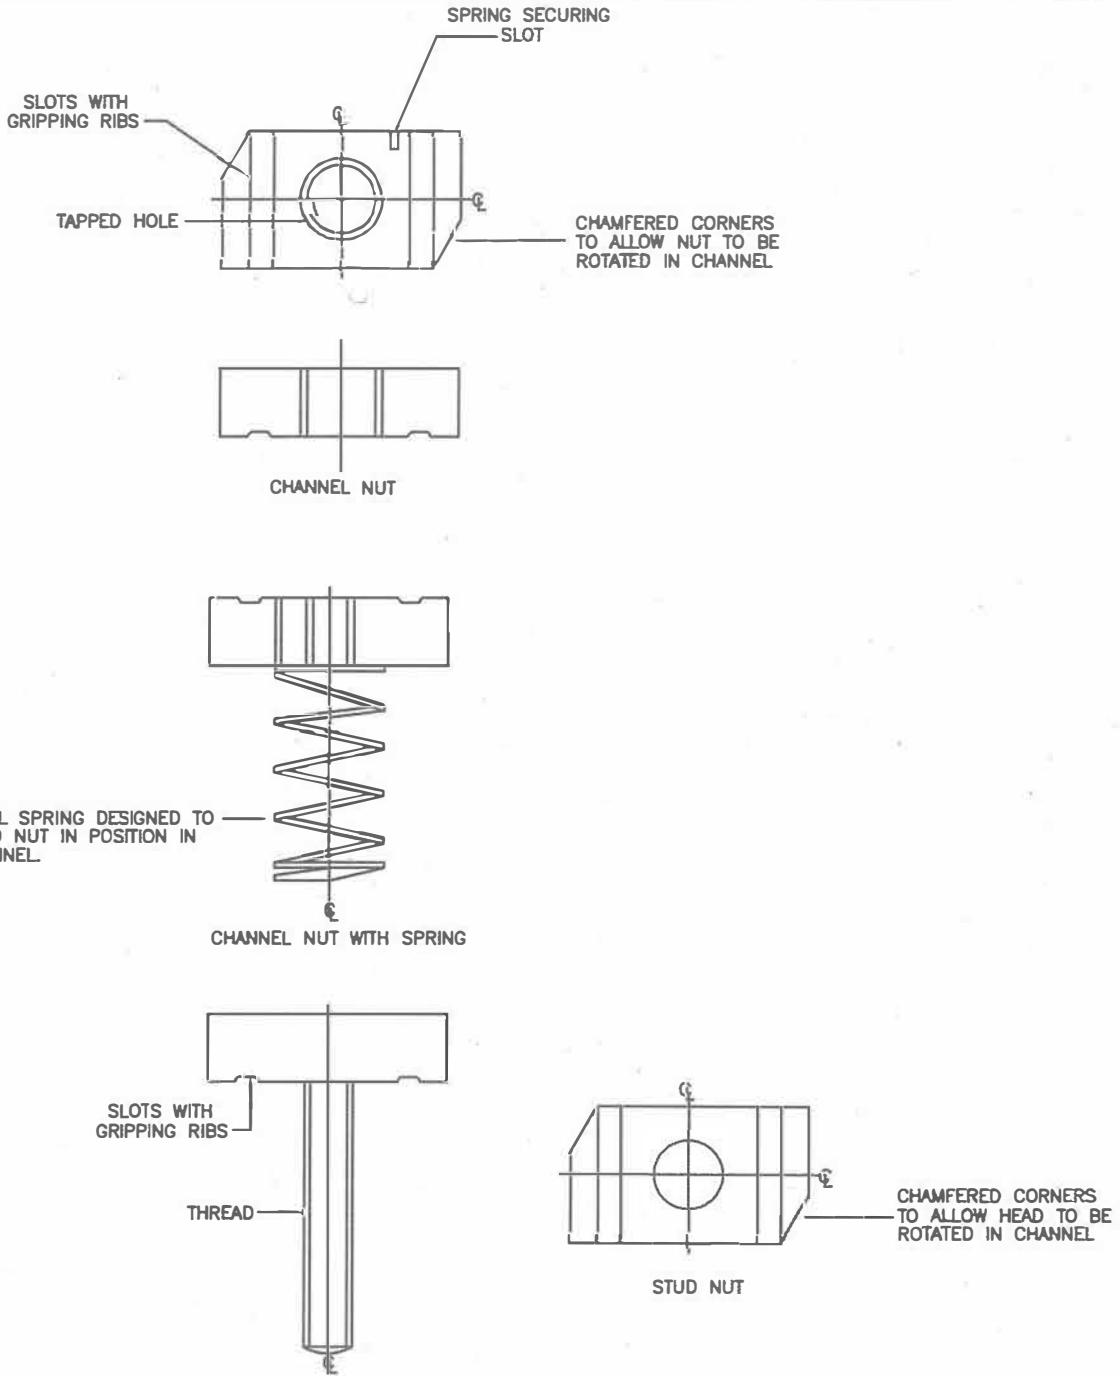


TYPICAL DETAILS OF FIXING ACCESSORIES

- NOTES.
 1. MATERIAL :- MILD STEEL
 2. FINISH :- HOT DIP GALVANISED


RC	FOR TENDER PURPOSE	M3	M3	EXL	-	✓	-	-	-	AS	25.02.10
RB	FOR TENDER PURPOSE	DL	DL	SS	-	RA	-	-	-	AS	25.02.10
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	25.02.10
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE
CLEARED BY											
		NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION									
PROJECT		STANDARD									
TITLE		TYPICAL DETAILS OF CABLE TRAY SUPPORT SYSTEM									
SIZE A4	SCALE NTS	DRG. NO. 0000-211-PDE-A-014						REV. NO. RC			

This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.





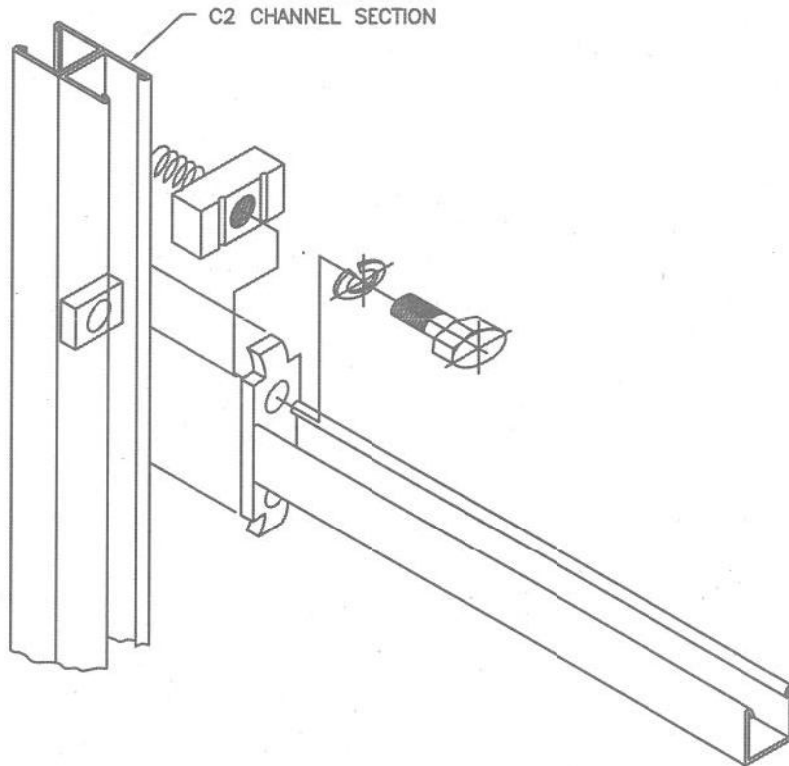


NOTE.

1. FINISH :-HOT DIP GALVANISED


RC	FOR TENDER PURPOSE	M3	M3	EXP	-	VV	-	-	-	AS	05/07/2000
RB	FOR TENDER PURPOSE	DL	DL	SS	-	RA	-	-	-	AS	05/07/2000
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	17.06.0000
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE
CLEARED BY											
		NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION									
PROJECT											
STANDARD											
TITLE											
TYPICAL DETAIL OF CABLE TRAY SUPPORT SYSTEM											
SIZE	SCALE	DRG. NO.							REV. NO.		
A4	NTS	0000-211-POE-A-015							RC		

This drawing and the design it covers are the property of NTPC L.TD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

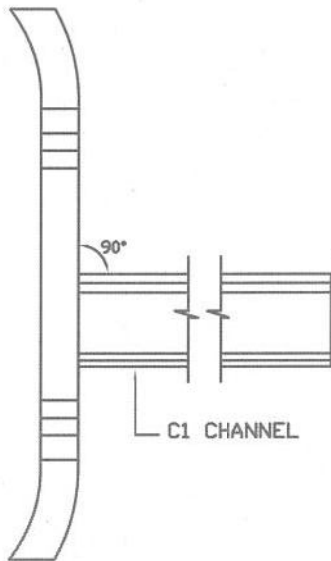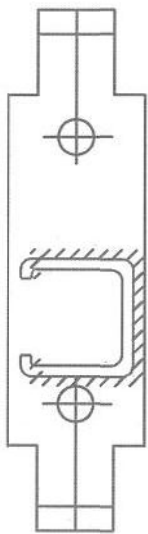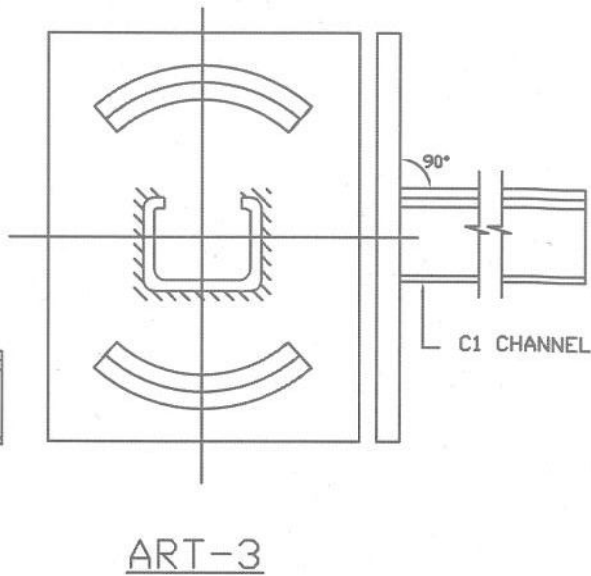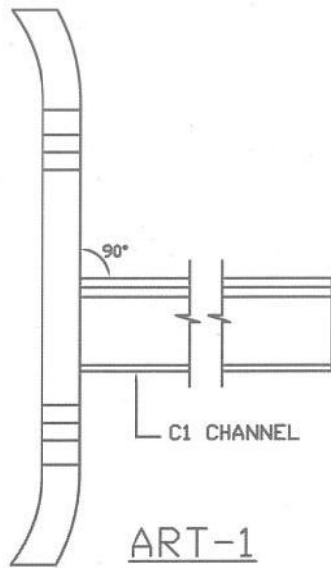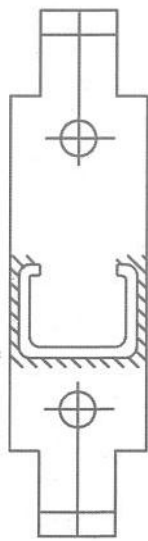


ART-2


- NOTES.
 1. MATERIAL : MS SHEET.
 2. FINISH : HOT DIP GALVANIZED

RC	FOR TENDER PURPOSE	M3	M3	REV	-	✓	-	-	-	AS	05.02.78
RB	FOR TENDER PURPOSE	DL	DL	SS	-	RA	-	-	-	AS	05.02.78
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	07.08.80
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&d	ARCH	APPD	DATE
CLEARED BY											
 NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION											
PROJECT STANDARD											
TITLE CANTILEVER ARMS											
SIZE A4	SCALE NTS	DRG. NO. 0000-211-POE-A-016							REV. NO. RC		


This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

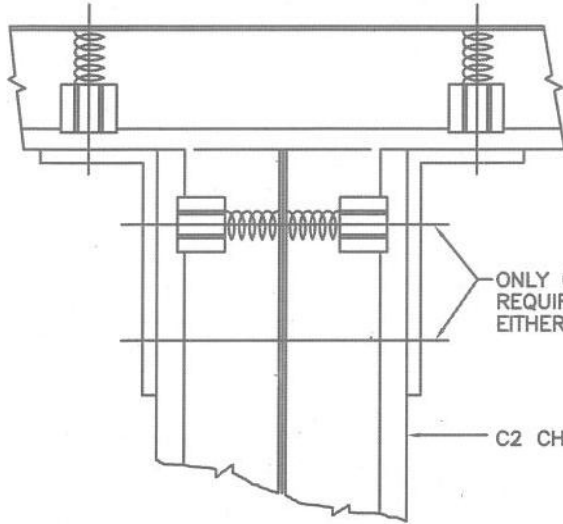

ASSEMBLY-1

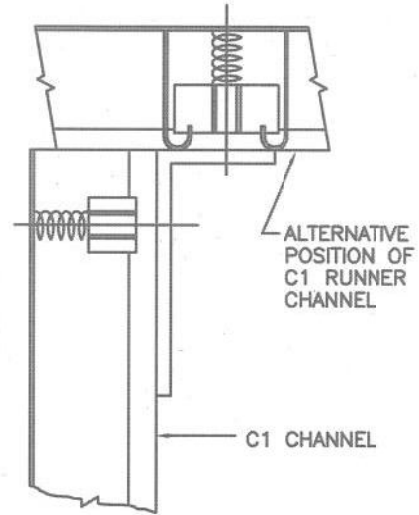


ASSEMBLY-2

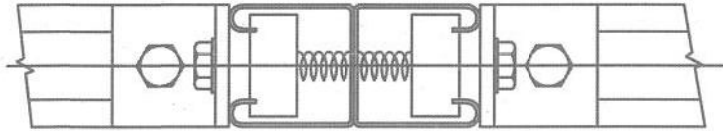

ASSEMBLY-1
UPPER FIXING C2 CHANNEL

ASSEMBLY-2
UPPER FIXING C1 CHANNEL




UPPER FIXING FOR CHANNEL VERTICAL SUPPORTS

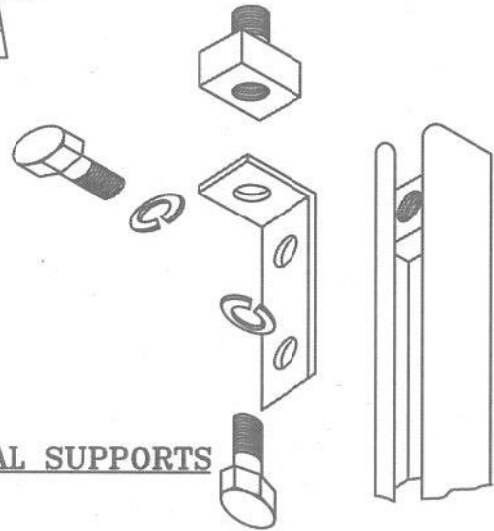

- NOTES.
1. MATERIAL : MS SHEET.
2. FINISH : HOT DIP GALVANIZED


RC	FOR TENDER PURPOSE	M3	M3	RXL	-	VV	-	-	-	-	05/07/16
RB	FOR TENDER PURPOSE	DL	DL	SS	-	RA	-	-	-	-	AS
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	07/06/00
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE
CLEARED BY											
		NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION									
PROJECT											
STANDARD											
TITLE											
TYPICAL DETAILS OF CABLE TRAY SUPPORT SYSTEM											
SIZE	SCALE	DRG. NO.								REV. NO.	
A4	NTS	0000-211-POE-A-017								RC	

This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

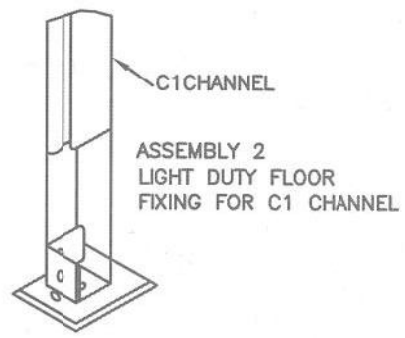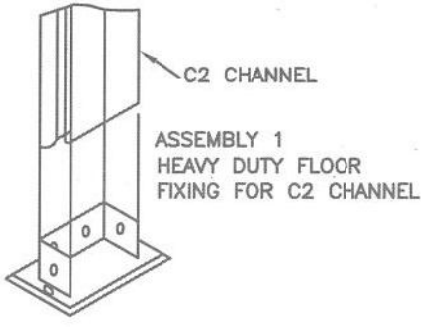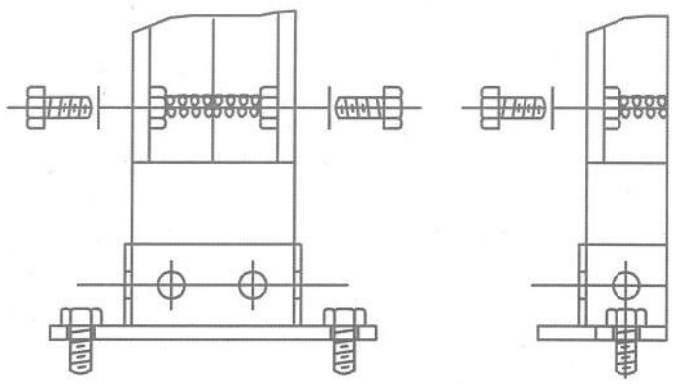


FLOOR FIXING FOR CHANNEL VERTICAL SUPPORTS


- NOTES.
1. MATERIAL : MS SHEET.
 2. FINISH : HOT DIP GALVANIZED

RC	FOR TENDER PURPOSE	M3	M3	RA	-	✓	-	-	-	AS	05/07/20
RB	FOR TENDER PURPOSE	DL	DL	SS	-	RA	-	-	-	AS	05/07/20
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	07/01/2000
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE
CLEARED BY											
		NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION									
PROJECT											
STANDARD											
TITLE											
TYPICAL DETAILS OF CABLE TRAY SUPPORT SYSTEM											
SIZE	SCALE	DRG. NO.							REV. NO.		
A4	NTS	0000-211-POE-A-018							RC		




This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

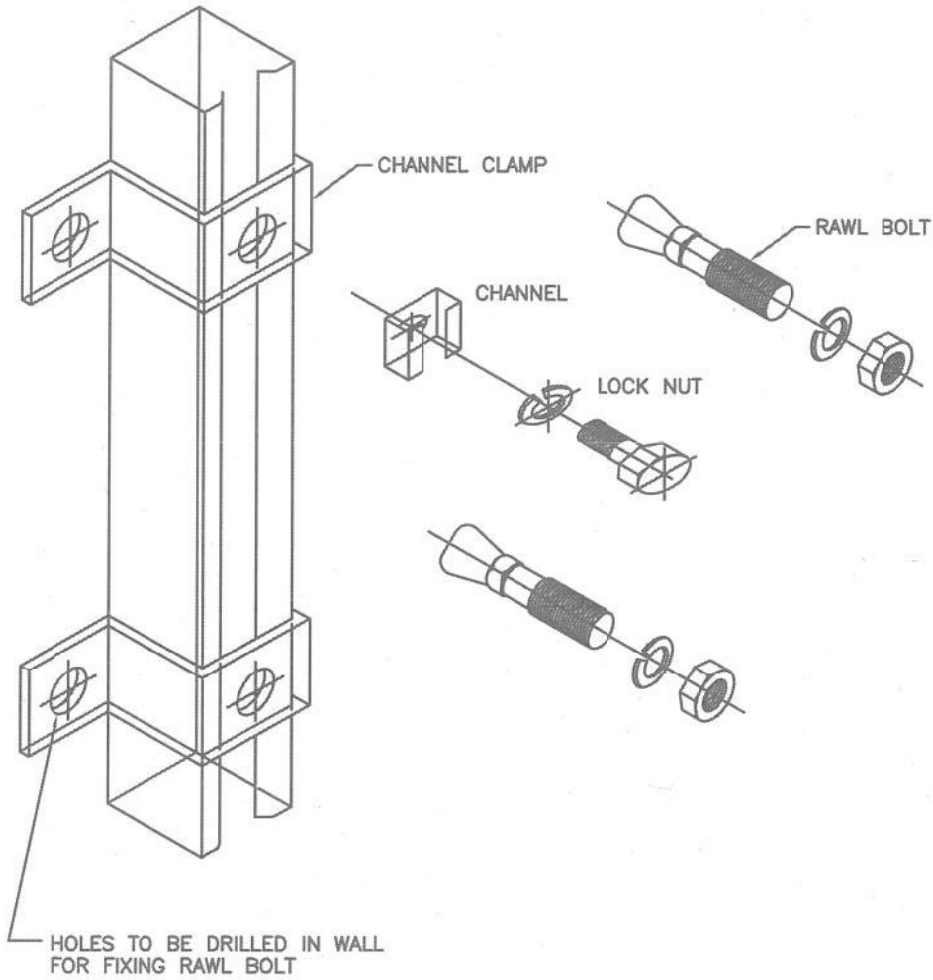

- NOTES.
 1. MATERIAL : MS SHEET.
 2. FINISH : HOT DIP GALVANIZED


RC	FOR TENDER PURPOSE	B3	B3	EXP	-	W	-	-	-	AS	05/07/18
RB	FOR TENDER PURPOSE	DL	DL	SS	-	RA	-	-	-	AS	05/07/18
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	07/08/2000
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE
CLEARED BY											
		NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION									
PROJECT											
STANDARD											
TITLE											
FIXING OF CHANNEL IN TRENCH WALL											
SIZE	SCALE	DRG. NO.								REV. NO.	
A4	NTS	0000-211-POE-A-019								RC	

This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

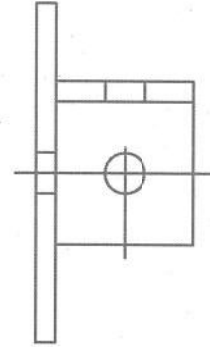
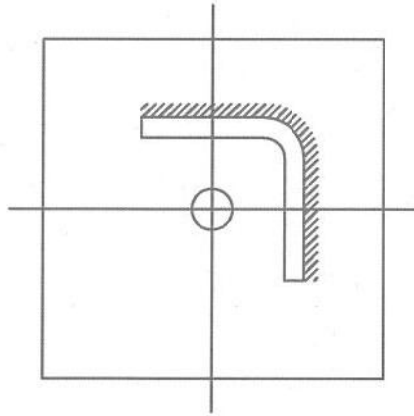
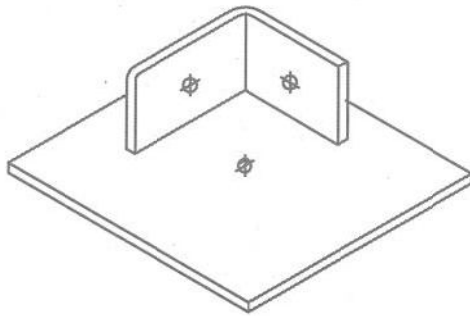


NOTES.

1. MATERIAL : MS SHEET.
2. FINISH : HOT DIP GALVANIZED


RC	FOR TENDER PURPOSE	M3	M3	RAI	-	VV	-	-	-	AS	05-02-10
RB	FOR TENDER PURPOSE	DL	DL	SS	-	RA	-	-	-	AS	05-02-10
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	07-08-09
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE
CLEARED BY											
		NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION									
PROJECT											
STANDARD											
TITLE											
BRACKET FLOOR PLATE LIGHT DUTY.											
SIZE	SCALE	DRG. NO.							REV. NO.		
A4	NTS	0000-211-PDE-A-020							RC		

This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.




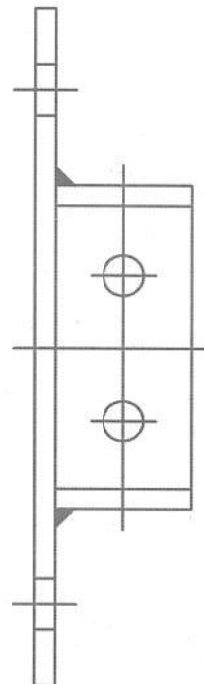
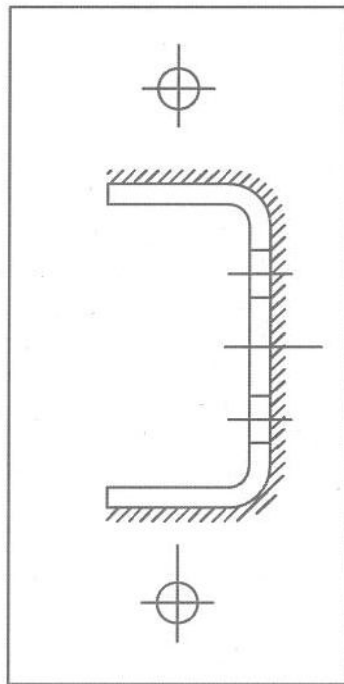
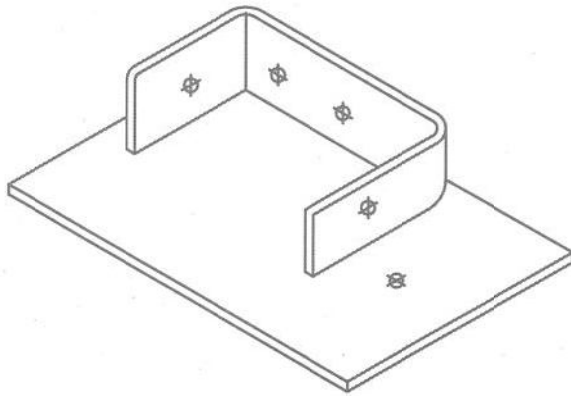


NOTES.

1. MATERIAL : MS SHEET.
2. FINISH : HOT DIP GALVANIZED

RC	FOR TENDER PURPOSE	A3	A3	CVL	-	VV	-	-	-	AS	08-07-78
RB	FOR TENDER PURPOSE	DL	DL	SS	-	RA	-	-	-	AS	08-07-78
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	07-08-88
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE
					CLEARED BY						
		<p align="center">NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION</p>									
PROJECT		STANDARD									
TITLE		BRACKET FLOOR PLATE HEAVY DUTY.									
SIZE	SCALE	DRG. NO.							REV. NO.		
A4	NTS	0000-211-PDE-A-021							RC		

This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

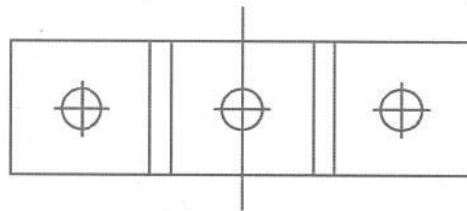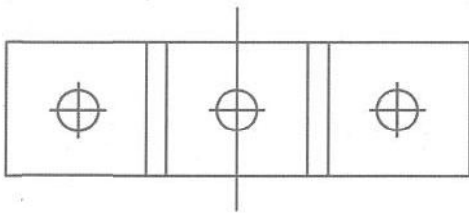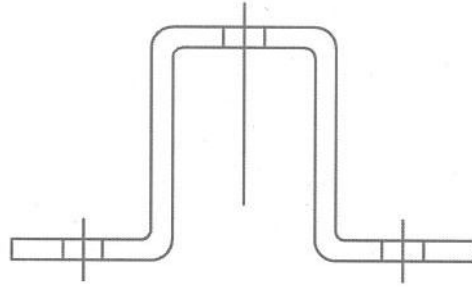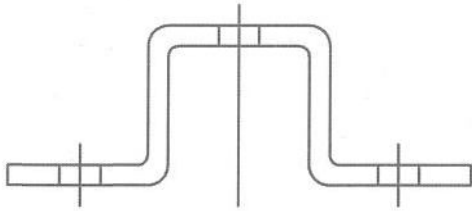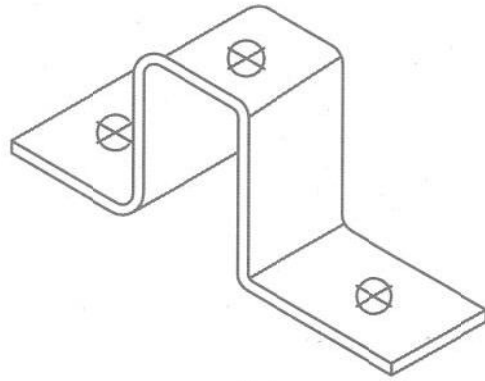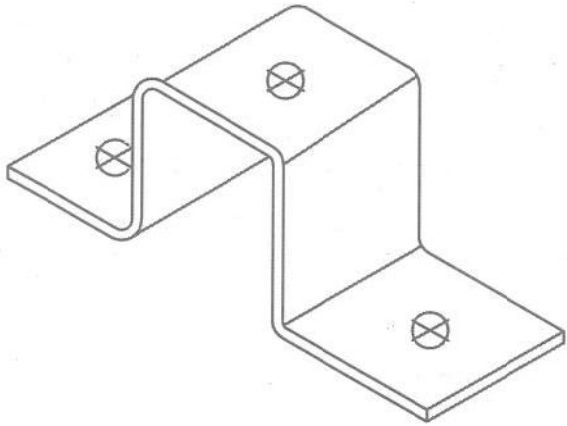


BRACKET-C1 CHANNEL CLAMP HEAVY DUTY.


BRACKET-C2 CHANNEL CLAMP.

- NOTES.**
 1. MATERIAL : MS SHEET.
 2. FINISH : HOT DIP GALVANIZED

RC	FOR TENDER PURPOSE	M3	M3	OK	-	✓	-	-	-	AS	05/02/10
RB	FOR TENDER PURPOSE	DL	DL	SS	-	RA	-	-	-	AS	05/02/10
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	07/06/08
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&d	ARCH	APPD	DATE
CLEARED BY											
एन टी पी सी NTPC		NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION									
PROJECT		STANDARD									
TITLE		BRACKET C1 CHANNEL CLAMP HEAVY DUTY. AND BRACKET C2 CHANNEL.									
SIZE A4	SCALE NTS	DRG. NO. 0000-211-PDE-A-022							REV. NO. RC		

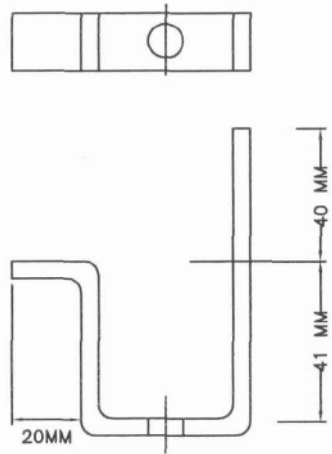


TRESTLE BRACKET.

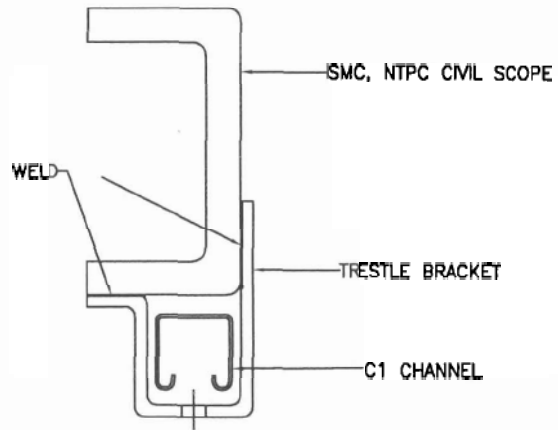







FIXING ARRANGEMENT OF TRESTLE BRACKET.

NOTES

- 1) MATERIAL : MILD STEEL.
- 2) FINISH : HOT DIP GALVANISED.

RA	FOR TENDER PURPOSE	MV	RKP	VKM	-	SS	-	-	-	DT	08.10.2005
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE
CLEARED BY											
 NTPC		NTPC LIMITED (A GOVERNMENT OF INDIA ENTERPRISE) (FORMERLY NATIONAL THERMAL POWER CORPORATION LTD.) ENGINEERING DIVISION									
PROJECT		STANDARD									
TITLE		FIXING OF CHANNEL FOR TRESTLE AND TRESTLE BRACKET.									
SIZE	SCALE	DRG. NO.								REV. NO.	
A4	NTS	0000-211-PDE-A-022A								RA	


This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

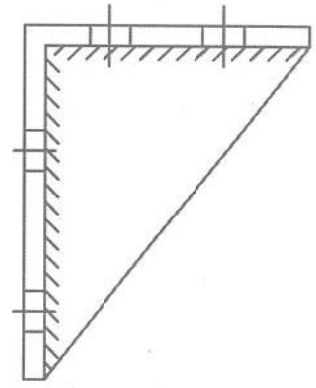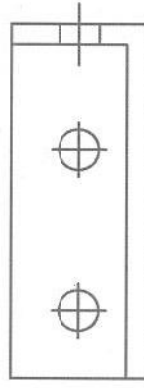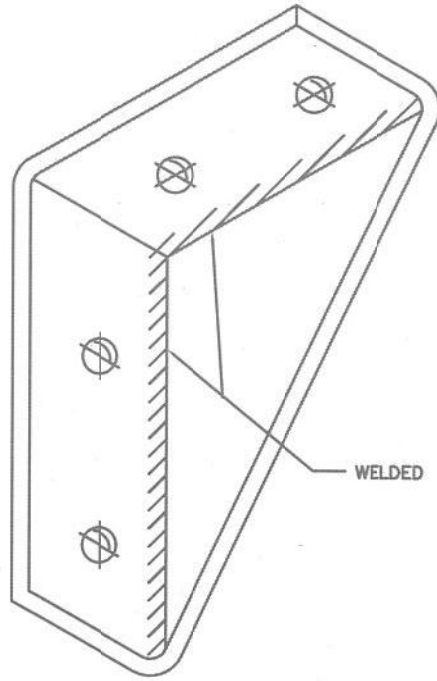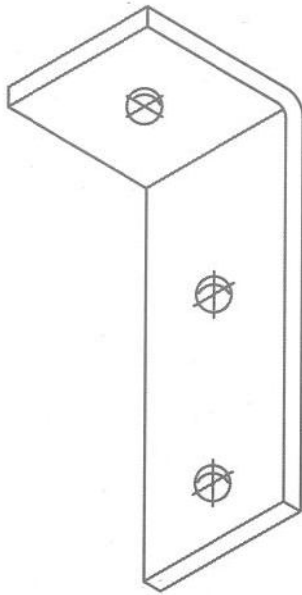






BRACKET RIGHT ANGLE.

BRACKET RIGHT ANGLE HEAVY DUTY.

- NOTES.**
 1. MATERIAL : MS SHEET.
 2. FINISH : HOT DIP GALVANIZED


RC	FOR TENDER PURPOSE	M ₂	M ₃	RA	-	W ₁	-	-	-	AS	05/07/2000
RB	FOR TENDER PURPOSE	DL	DL	SS	-	RA	-	-	-	AS	05/07/2000
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	07/08/2000
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE
					CLEARED BY						
		NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION									
PROJECT		STANDARD									
TITLE		BRACKET RIGHT ANGLE & BRACKET RIGHT ANGLE HEAVY DUTY.									
SIZE	SCALE	DRG. NO.							REV. NO.		
A4	NTS	0000-211-PQE-A-023							RC		

This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

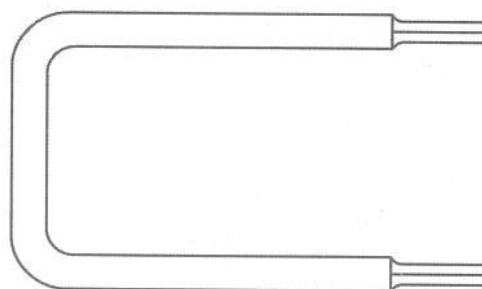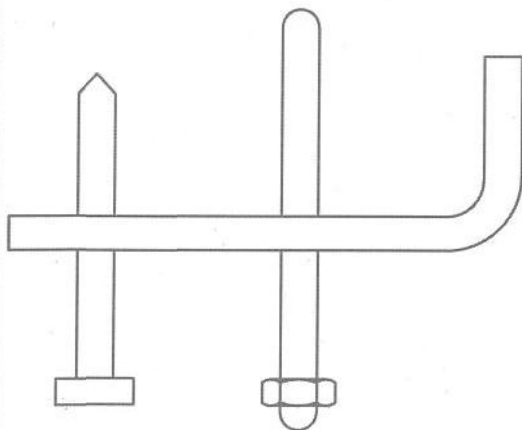
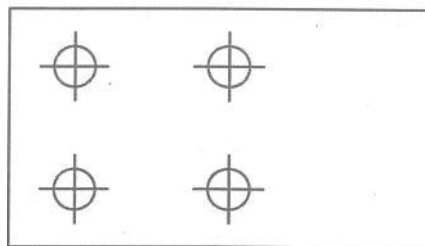
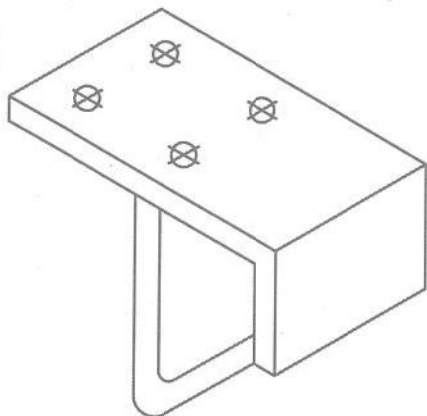


NOTES.

1. MATERIAL : MILD STEEL
2. FINISH : HOT DIP GALVANIZED


RC	FOR TENDER PURPOSE	A3	A3	PP	-	✓	-	-	-	AS	05/07/2010
RB	FOR TENDER PURPOSE	DL	DL	SS	-	RA	-	-	-	AS	05/07/2010
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	17.01.2000
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&d	ARCH	APPD	DATE
CLEARED BY											
		NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION									
PROJECT		STANDARD									
TITLE		BEAM CLAMP.									
SIZE	SCALE	DRG. NO.							REV. NO.		
A4	NTS	0000-211-PDE-A-024							RC		

This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

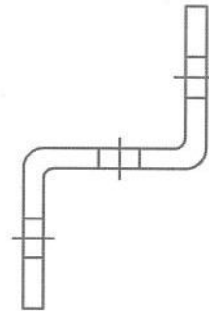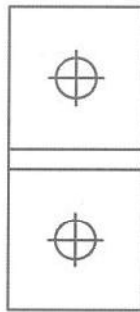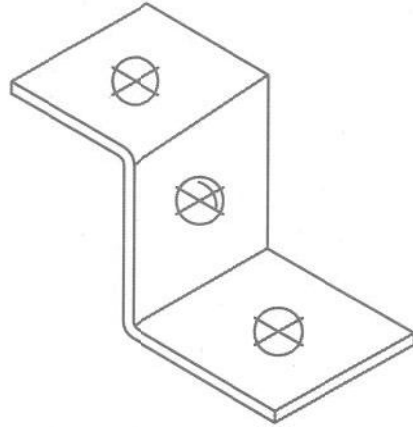


BRACKET-C1 CHANNEL CLAMP.


- NOTES.
 1. MATERIAL : MILD STEEL
 2. FINISH : HOT DIP GALVANIZED

RC	FOR TENDER PURPOSE	M3	M3	PR	-	W	-	-	-	AS	05/07/10
RB	FOR TENDER PURPOSE	DL	DL	SS	-	RA	-	-	-	AS	05/07/10
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	07/06/09
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE
					CLEARED BY						
		NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION									
PROJECT		STANDARD									
TITLE		BRACKET C1 CHANNEL CLAMP.									
SIZE	SCALE	DRG. NO.							REV. NO.		
A4	NTS	0000-211-PDE-A-025							RC		


This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

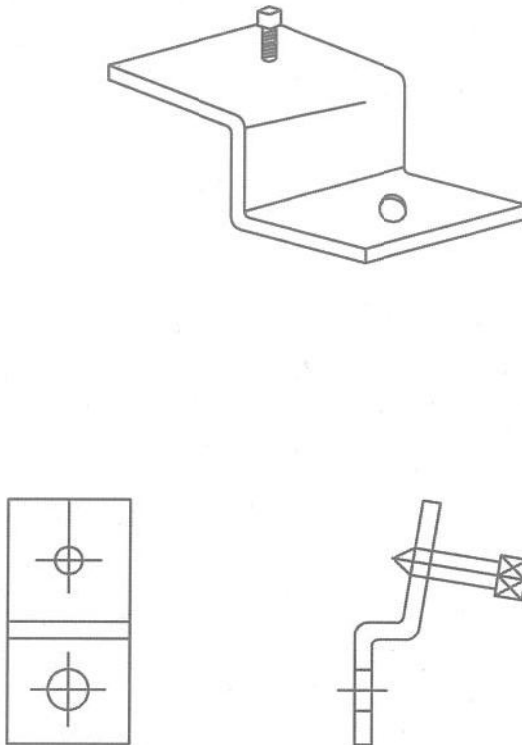

- NOTES.**
 1. MATERIAL : MILD STEEL
 2. FINISH : HOT DIP GALVANIZED

RC	FOR TENDER PURPOSE	M3	M3	DEL	-	✓	-	-	-	AS	05-02-10
RB	FOR TENDER PURPOSE	DL	DL	SS	-	RA	-	-	-	AS	05.07.2000
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	17.01.2000
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE
CLEARED BY											
		NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION									
PROJECT		STANDARD									
TITLE		BRACKET BEAM CLAMP									
SIZE A4	SCALE NTS	DRG. NO. 0000-211-PDE-A-026							REV. NO. RC		


This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

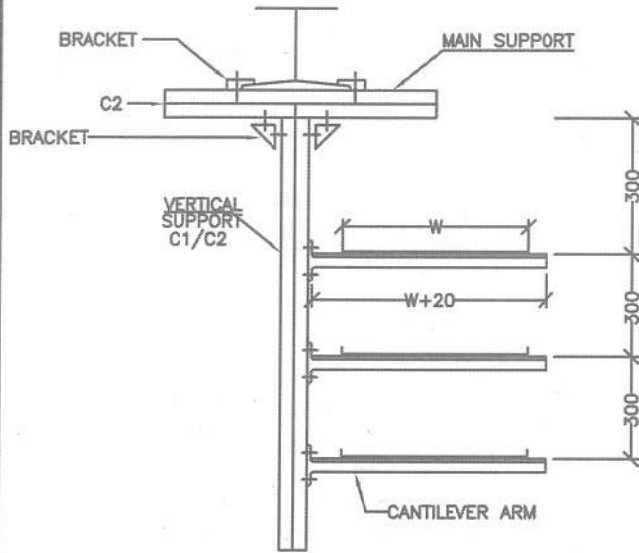

ARRANGEMENT TYPE-B1

VERTICAL SUPPORT


- 1) FOR 1 TO 6 TIER OF 600mm TRAY - C2 CHANNEL
- 2) FOR 1 TO 3 TIER OF 300mm TRAY - C1 CHANNEL
- 3) FOR 4 TO 6 TIER OF 300mm TRAY - C2 CHANNEL
- 4) FOR 1 TO 6 TIER OF 150mm TRAY - C1 CHANNEL

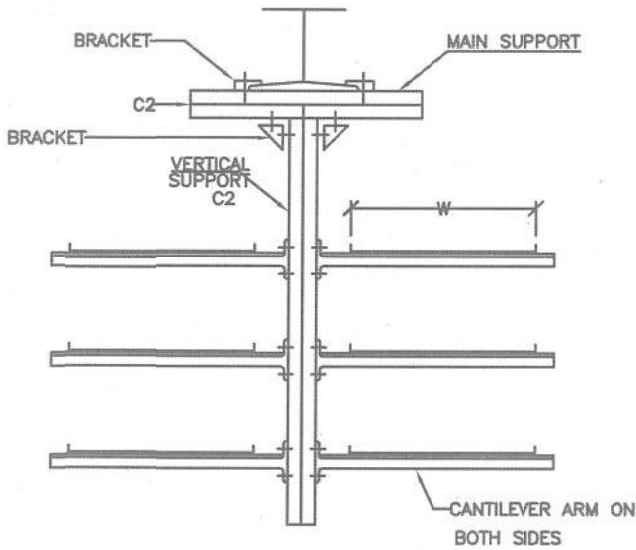


ARRANGEMENT TYPE-B2

NOTES.


1. ALL DIMENSIONS ARE IN mm.
2. MATERIAL : MS SHEET.
3. FINISH : HOT DIP GALVANIZED
4. IN CASE OF HANGING SUPPORT C2 CHANNEL TO BE USED FOR MAIN SUPPORT

RC	FOR TENDER PURPOSE	M3	M3	EXL	-	W	-	-	-	-	AS	05/07/20
RB	FOR TENDER PURPOSE	DL	DL	SS	-	RA	-	-	-	-	AS	05/07/20
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	-	07/08/20
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE	
CLEARED BY												
		NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION										
PROJECT		STANDARD										
TITLE		STANDARD CABLE SUPPORT ASSEMBLY										
SIZE	SCALE	DRG. NO.						REV. NO.				
A4	NTS	0000-211-PDE-A-030						RC				


This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

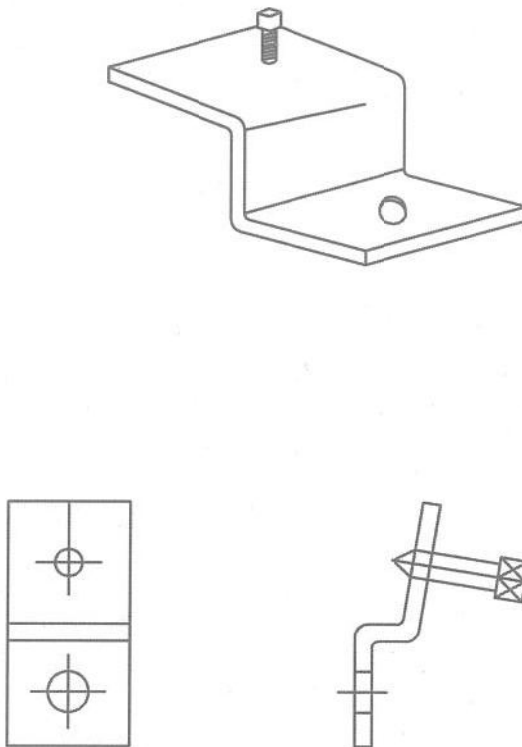

NOTES.
 1. MATERIAL : MILD STEEL
 2. FINISH : HOT DIP GALVANIZED

RC	FOR TENDER PURPOSE	M3	M3	DEL	-	✓	-	-	-	AS	05-02-10
RB	FOR TENDER PURPOSE	DL	DL	SS	-	RA	-	-	-	AS	05.07.2000
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	17.01.2000
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE
CLEARED BY											
		NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION									
PROJECT		STANDARD									
TITLE		BRACKET BEAM CLAMP									
SIZE	SCALE	DRG. NO.							REV. NO.		
A4	NTS	0000-211-PDE-A-026							RC		


This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

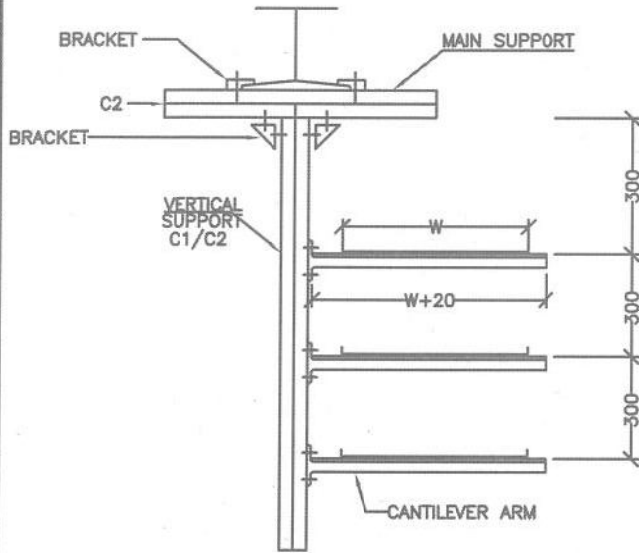

ARRANGEMENT TYPE-B1

VERTICAL SUPPORT


- 1) FOR 1 TO 6 TIER OF 600mm TRAY - C2 CHANNEL
- 2) FOR 1 TO 3 TIER OF 300mm TRAY - C1 CHANNEL
- 3) FOR 4 TO 6 TIER OF 300mm TRAY - C2 CHANNEL
- 4) FOR 1 TO 6 TIER OF 150mm TRAY - C1 CHANNEL

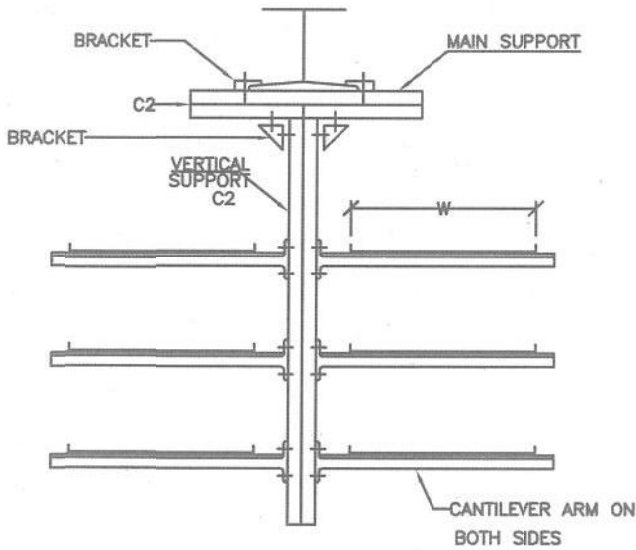


ARRANGEMENT TYPE-B2

NOTES.

1. ALL DIMENSIONS ARE IN mm.
2. MATERIAL : MS SHEET.
3. FINISH : HOT DIP GALVANIZED
4. IN CASE OF HANGING SUPPORT C2 CHANNEL TO BE USED FOR MAIN SUPPORT


RC	FOR TENDER PURPOSE	M3	M3	EXL	-	W	-	-	-	-	AS	05/07/20
RB	FOR TENDER PURPOSE	DL	DL	SS	-	RA	-	-	-	-	AS	05/07/20
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	-	07/08/20
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE	
CLEARED BY												
		NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION										
PROJECT		STANDARD										
TITLE		STANDARD CABLE SUPPORT ASSEMBLY										
SIZE	SCALE	DRG. NO.						REV. NO.				
A4	NTS	0000-211-PDE-A-030						RC				

This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

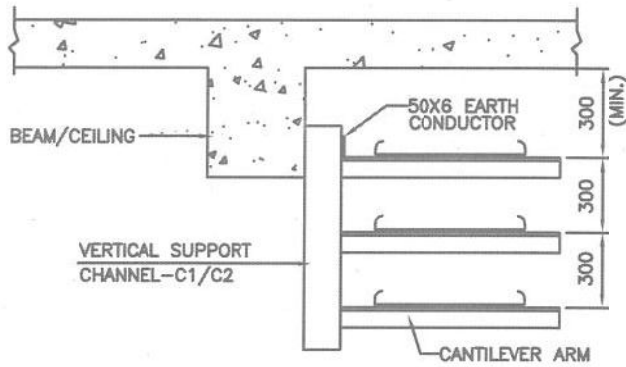

VERTICAL SUPPORT


- 1) FOR 1 TO 6 TIER OF 600mm TRAY - C2 CHANNEL
- 2) FOR 1 TO 3 TIER OF 300mm TRAY - C1 CHANNEL
- 3) FOR 4 TO 6 TIER OF 300mm TRAY - C2 CHANNEL
- 4) FOR 1 TO 6 TIER OF 150mm TRAY - C1 CHANNEL

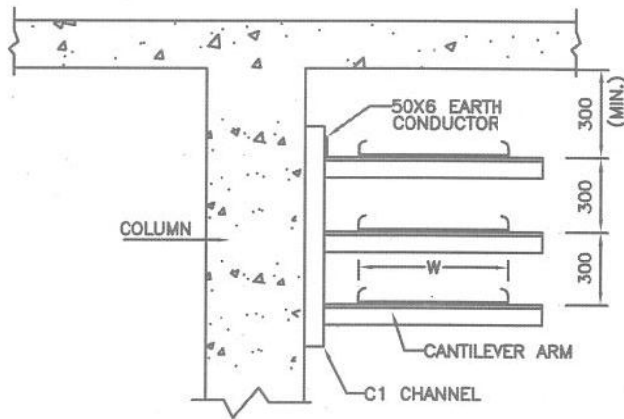


ARRANGEMENT TYPE-C1

NOTES.


1. ALL DIMENSIONS ARE IN mm.
2. MATERIAL : MS SHEET.
3. FINISH : HOT DIP GALVANIZED
4. BRACKETS USED FOR FIXING OF C1/C2 CHANNEL SHALL BE ANCHOR BOLTED/WELDED.

RC	FOR TENDER PURPOSE	M	M	R/R	-	W	-	-	-	AS	02.02.12
RB	FOR TENDER PURPOSE	DL	DL	SS	-	RA	-	-	-	AS	02.02.12
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	02.02.12
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE
CLEARED BY											
		NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION									
PROJECT		STANDARD									
TITLE		STANDARD CABLE SUPPORT ASSEMBLY									
SIZE	SCALE	DRG. NO.							REV. NO.		
A4	NTS	0000-211-PDE-A-031							RC		

This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

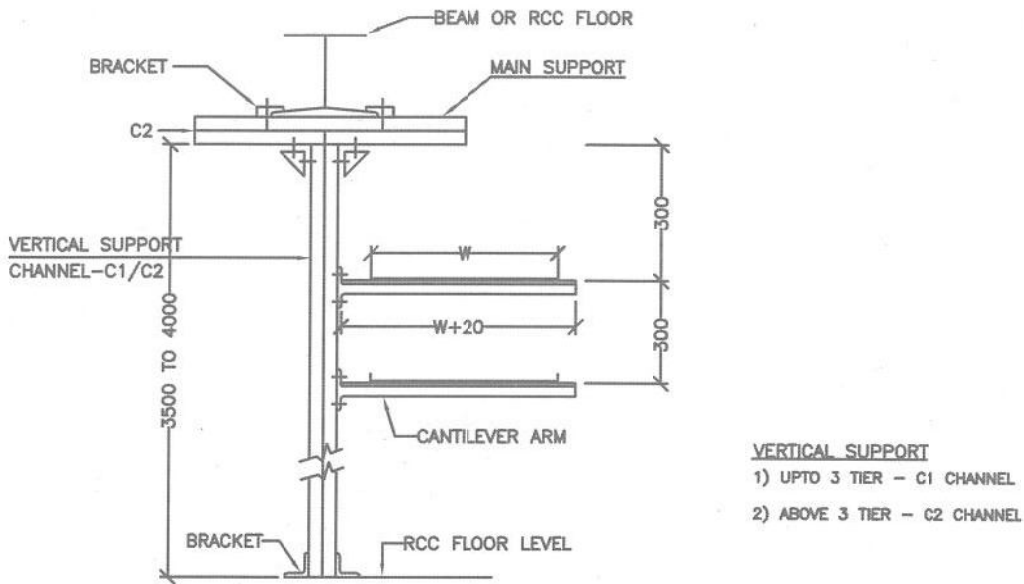


ARRANGEMENT TYPE-D1


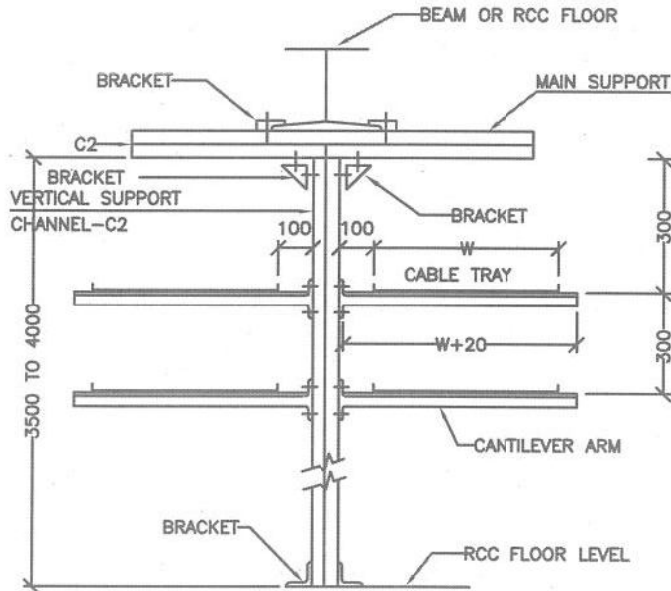


ARRANGEMENT TYPE-D2

- NOTES.**
1. ALL DIMENSIONS ARE IN mm.
 2. MATERIAL : MS SHEET.
 3. FINISH : HOT DIP GALVANIZED
 4. BRACKETS USED FOR FIXING OF C1/C2 CHANNEL SHALL BE ANCHOR BOLTED/WELDED.

RC	FOR TENDER PURPOSE	M3	M3	R4	-	W	-	-	-	-	AS	05/07/10
RB	FOR TENDER PURPOSE	DL	DL	SS	-	RA	-	-	-	-	AS	05/07/10
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	-	07/08/00
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE	
		CLEARED BY										
		<p style="text-align: center;">NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION</p>										
PROJECT		STANDARD										
TITLE		STANDARD CABLE SUPPORT ASSEMBLY										
SIZE	SCALE	DRG. NO.							REV. NO.			
A4	NTS	0000-211-POE-A-032							RC			

This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

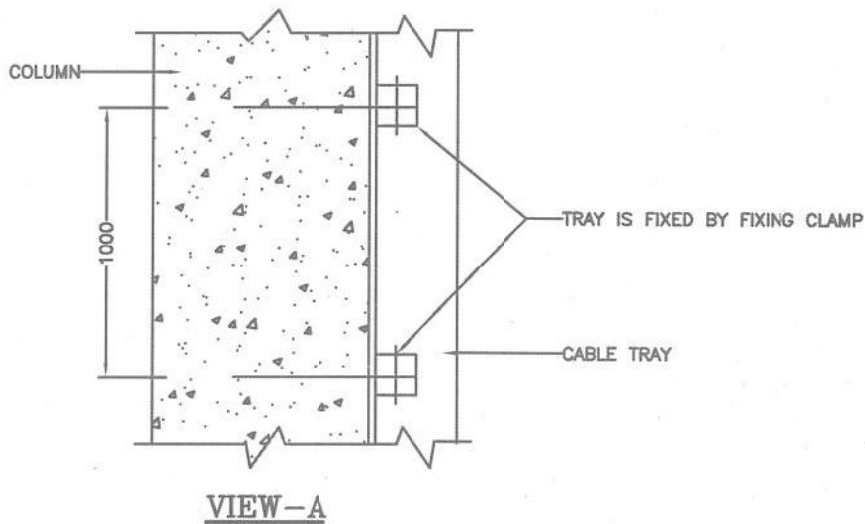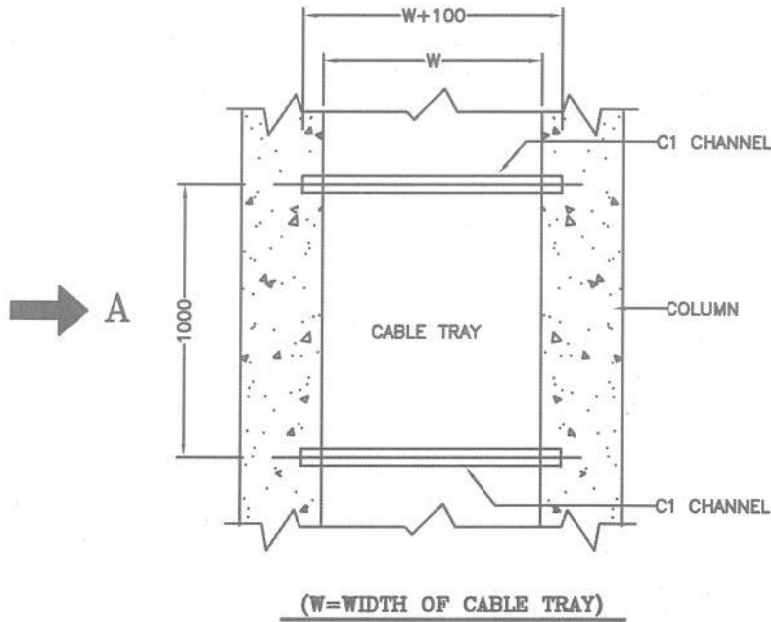

ARRANGEMENT TYPE-S1

NOTES.


1. ALL DIMENSIONS ARE IN mm.
2. MATERIAL : MS SHEET.
3. FINISH : HOT DIP GALVANIZED
4. BRACKETS USED FOR FIXING OF C1/C2 CHANNEL SHALL BE ANCHOR BOLTED/WELDED.

RC	FOR TENDER PURPOSE	M3	M3	RXP	-	NV	-	-	-	AS	05-07-20
RB	FOR TENDER PURPOSE	DL	DL	SS	-	RA	-	-	-	AS	05.07.2000
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	07.06.2000
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&d	ARCH	APPD	DATE
CLEARED BY											
		NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION									
PROJECT		STANDARD									
TITLE		STANDARD CABLE SUPPORT ASSEMBLY									
SIZE	SCALE	DRG. NO.							REV. NO.		
A4	NTS	0000-211-PDE-A-033							RC		

This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

MAIN SUPPORT


- 1) FOR 1 TO 6 TIER OF 600mm TRAY - C2 CHANNEL
- 2) FOR 1 TO 3 TIER OF 300mm TRAY - C1 CHANNEL
- 3) FOR 4 TO 6 TIER OF 300mm TRAY - C2 CHANNEL
- 4) FOR 1 TO 6 TIER OF 150mm TRAY - C1 CHANNEL

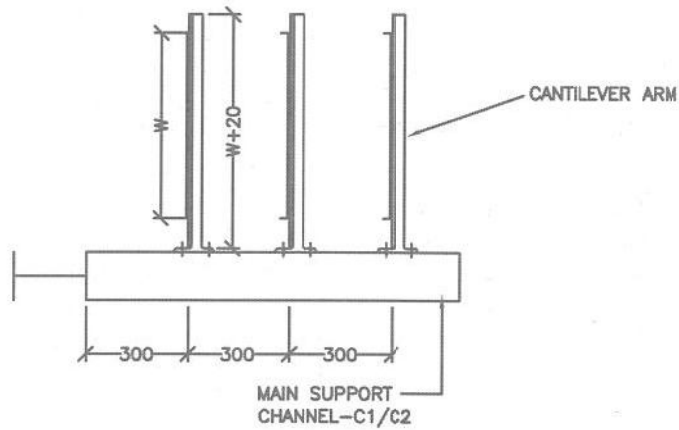

ARRANGEMENT TYPE-S2


NOTES.

1. ALL DIMENSIONS ARE IN mm.
2. MATERIAL : MS SHEET.
3. FINISH : HOT DIP GALVANIZED
4. BRACKETS USED FOR FIXING OF C1/C2 CHANNEL SHALL BE ANCHOR BOLTED/WELDED.

RC	FOR TENDER PURPOSE	M3	M3	RAJ	-	VN	-	-	-	AS	05/02/16
RB	FOR TENDER PURPOSE	DL	DL	SS	-	RA	-	-	-	AS	05/02/16
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	07/01/2016
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&d	ARCH	APPD	DATE
CLEARED BY											
		NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION									
PROJECT		STANDARD									
TITLE		STANDARD CABLE SUPPORT ASSEMBLY									
SIZE	SCALE	DRG. NO.							REV. NO.		
A4	NTS	0000-211-PDE-A-034							RC		

This drawing and the design it covers are the property of NTPC L.TD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.


CHANNELS SUPPORTED BY FLOOR BEAM

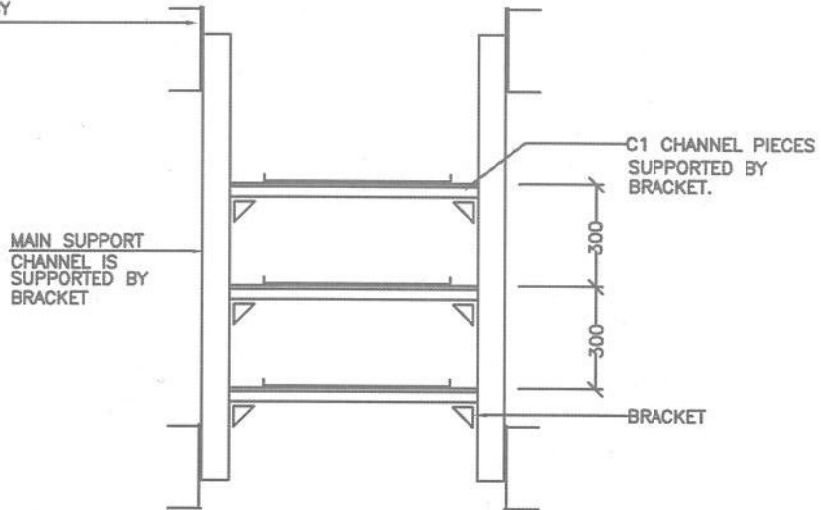

MAIN SUPPORT

- 1) UPTO 3 TIER - C1 CHANNEL
- 2) ABOVE 3 TIER - C2 CHANNEL

ARRANGEMENT TYPE-S3

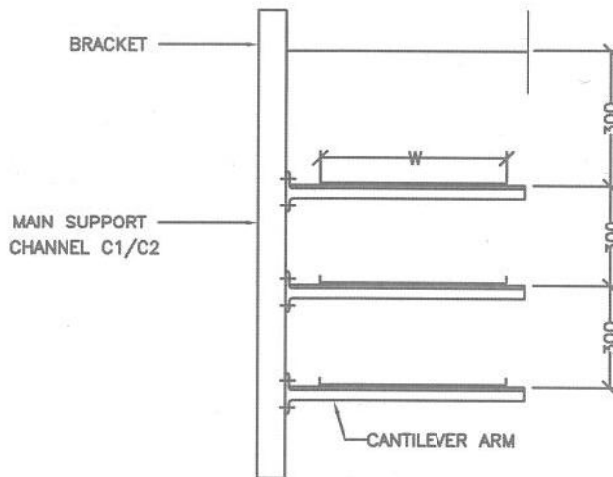



ARRANGEMENT TYPE-S4

NOTES.


- 1. ALL DIMENSIONS ARE IN mm.
- 2. MATERIAL : MS SHEET.
- 3. FINISH : HOT DIP GALVANIZED
- 4. BRACKETS USED FOR FIXING OF C1/C2 CHANNEL SHALL BE ANCHOR BOLTED/WELDED.

RC	FOR TENDER PURPOSE	M3	M3	RA	-	W	-	-	-	AS	05-07-10
RB	FOR TENDER PURPOSE	DL	DL	SS	-	RA	-	-	-	AS	05-07-10
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	07-08-09
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE
CLEARED BY											
		NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION									
PROJECT		STANDARD									
TITLE		STANDARD CABLE SUPPORT ASSEMBLY									
SIZE	SCALE	DRG. NO.							REV. NO.		
A4	NTS	0000-211-PDE-A-035							RC		


This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

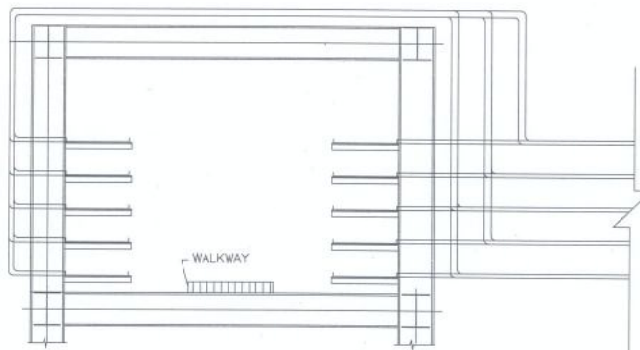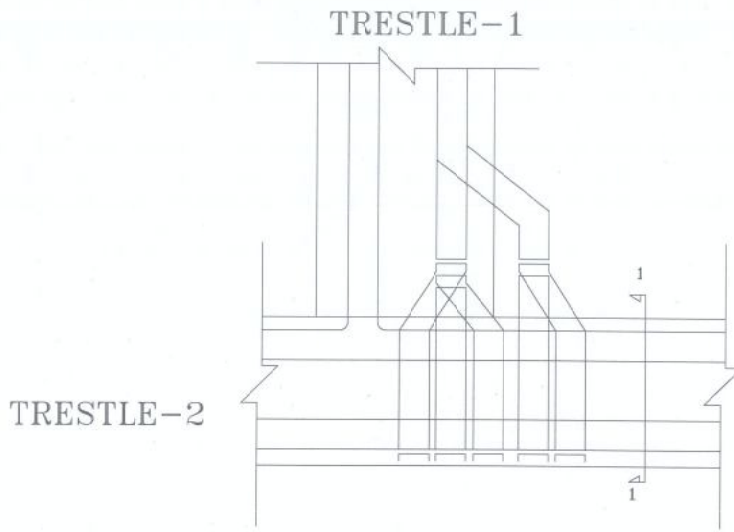


SECTION 1-1

RA.	FOR TENDER PURPOSE	13	13	248	-	⊗	-	-	-	-	10/11
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD.	M	E	C	C&I	ARCH.	APPD.	DATE
		CLEARED BY									
		NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION									
PROJECT		STANDARD									
TITLE		TYPICAL INTERCONNECTION DETAILS BETWEEN TWO PERPENDICULAR TRESTLES									
SIZE	SCALE	DRG. NO.								REV. NO.	
A4	NTS	0000-211-POE-A-035A								RA	


This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

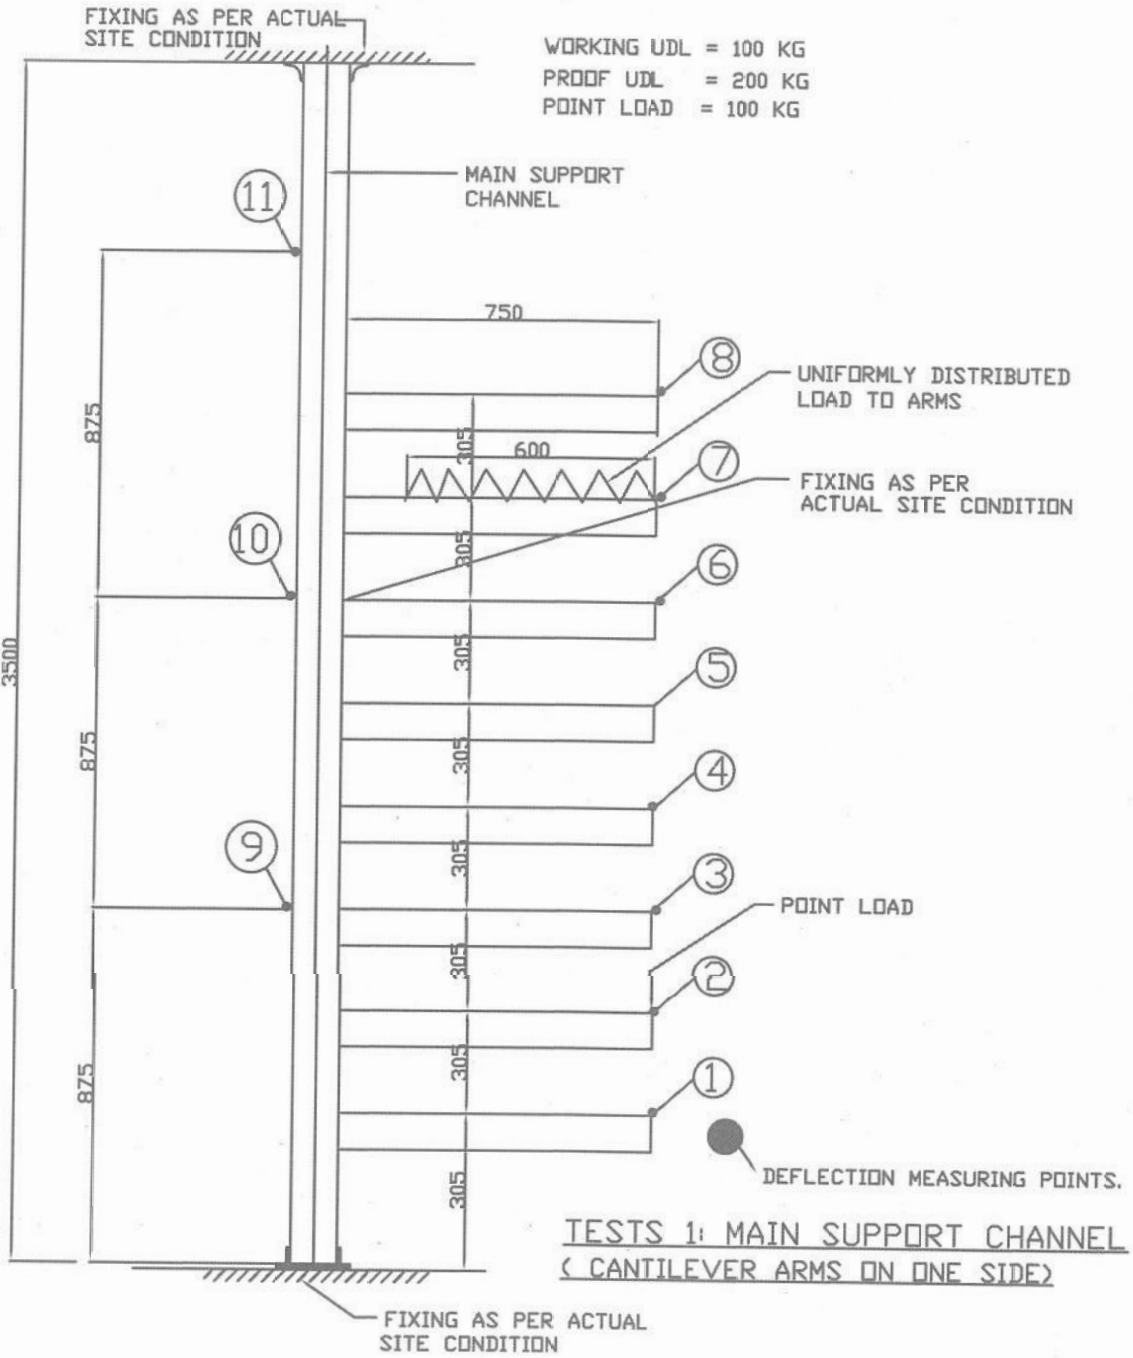

- NOTES.
1. ALL DIMENSIONS ARE IN mm.
 2. BRACKETS USED FOR FIXING OF C1/C2 CHANNEL SHALL BE ANCHOR BOLTED/WELDED.

RC	FOR TENDER PURPOSE	M3	M3	REL	-	W	-	-	-	AS	05/07/10
RB	FOR TENDER PURPOSE	RKG	RKG	VKM	-	SS	-	-	-	AS	05/07/10
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	07/08/09
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE
CLEARED BY											
 NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION											
PROJECT											
STANDARD											
TITLE											
TYPICAL DETAILS OF STRUCTURE FOR TESTING											
SIZE	SCALE	DRG. NO.							REV. NO.		
A4	NTS	0000-211-POE-A-036							RC		

This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

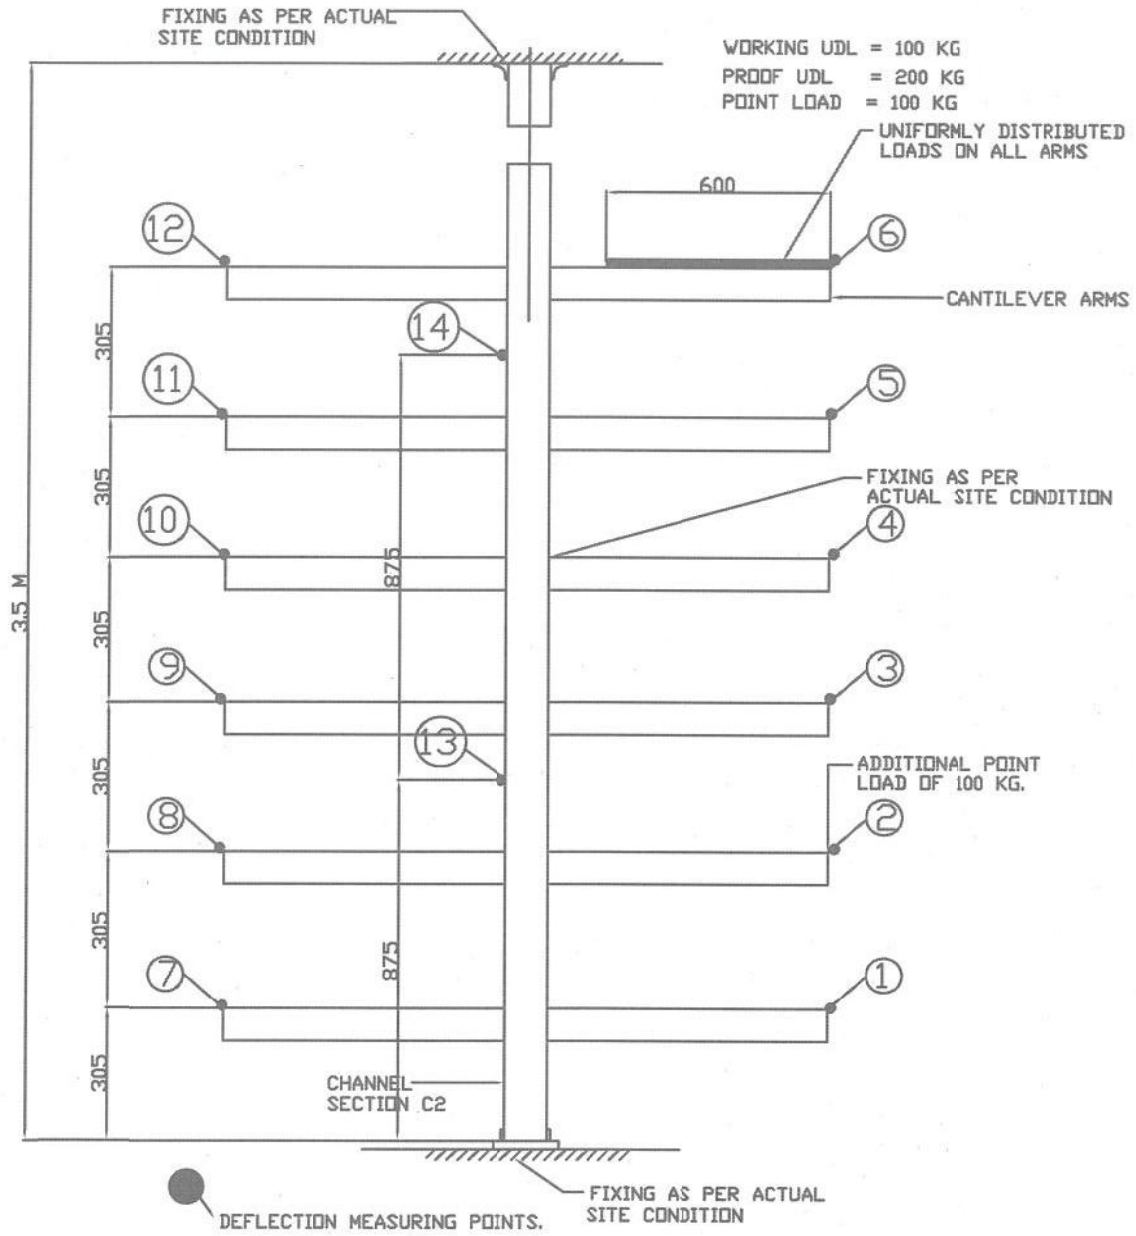


WORKING UDL = 100 KG
 PROOF UDL = 200 KG
 POINT LOAD = 100 KG

TEST 2A : MAIN SUPPORT CHANNEL
 (CANTILEVER ARMS ON BOTH SIDES)


- NOTES.**
 1. ALL DIMENSIONS ARE IN mm.
 2. BRACKETS USED FOR FIXING OF C1/C2 CHANNEL SHALL BE ANCHOR BOLTED/WELDED.

RC	FOR TENDER PURPOSE	M3	M3	R49	-	V4	-	-	-	-	AS	05-07-10
RB	FOR TENDER PURPOSE	RKG	RKG	VKM	-	SS	-	-	-	-	AS	05-11-2006
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	-	17-06-2000
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE	
CLEARED BY												
		NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION										
PROJECT STANDARD												
TITLE TYPICAL DETAILS OF STRUCTURE FOR TESTING												
SIZE A4	SCALE NTS	DRG. NO. 0000-211-POE-A-037							REV. NO. RC			

This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

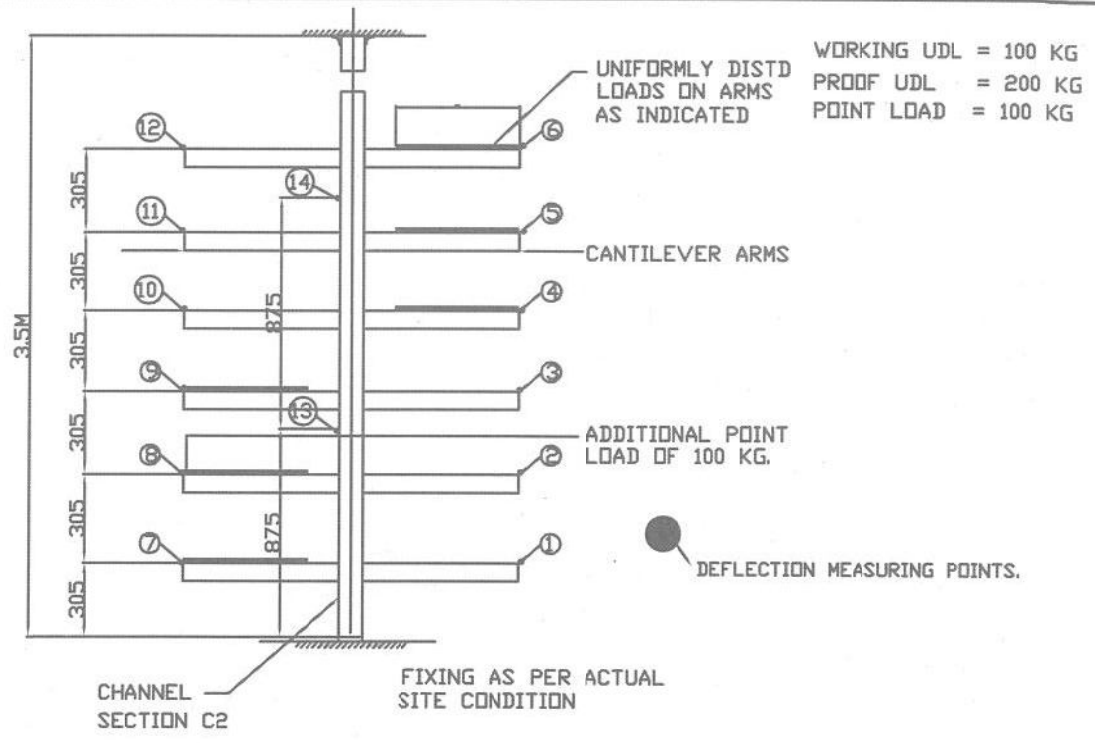


TEST 2B MAIN SUPPORT CHANNEL
(ASYMMETRIC LOADING)

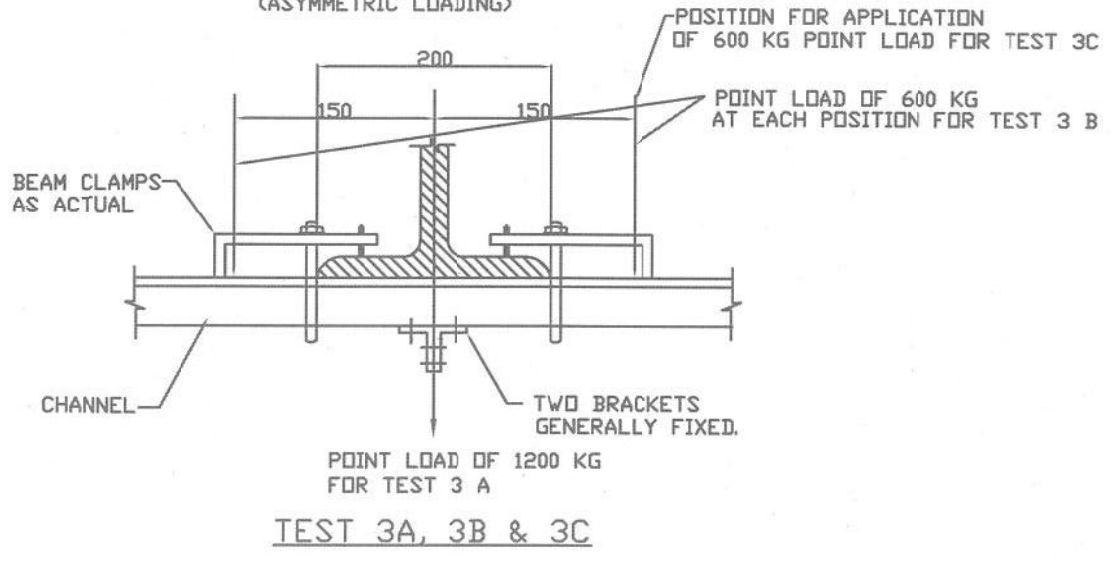


TEST 3A, 3B & 3C


- NOTES.**
 1. ALL DIMENSIONS ARE IN mm.
 2. BRACKETS USED FOR FIXING OF C1/C2 CHANNEL SHALL BE ANCHOR BOLTED/WELDED.

RC	FOR TENDER PURPOSE	B	B	RVA	-	NY	-	-	-	-	AS	05/07/20
RB	FOR TENDER PURPOSE	RKG	RKG	VKM	-	SS	-	-	-	-	AS	04/11/2004
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	-	07/01/2000
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE	
CLEARED BY												
		NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION										
PROJECT		STANDARD										
TITLE		TYPICAL DETAILS STRUCTURE FOR TESTING										
SIZE	SCALE	DRG. NO.							REV. NO.			
A4	NTS	0000-211-POE-A-038							RC			

WORKING UDL = 100 KG
 PROOF UDL = 200 KG
 POINT LOAD = 100 KG

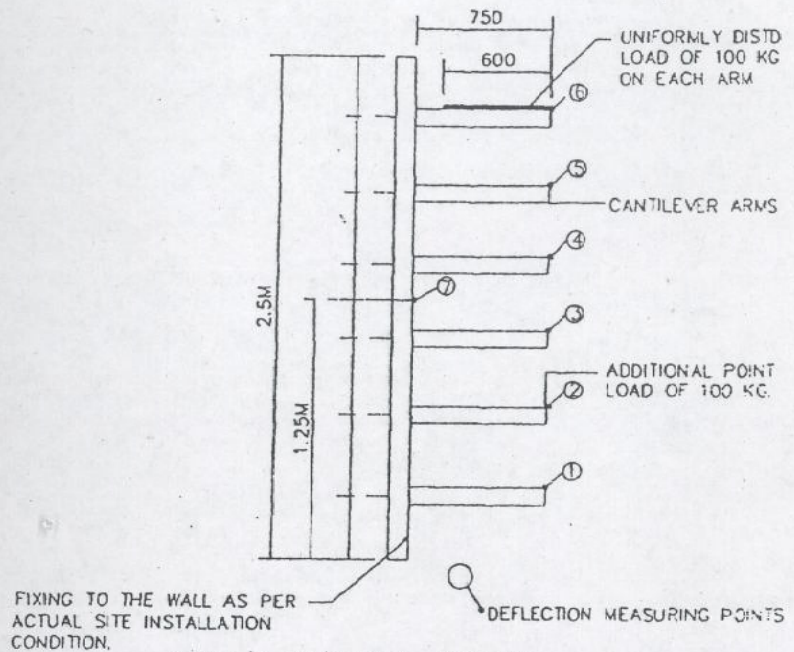

TEST 4 CHANNEL INSERT

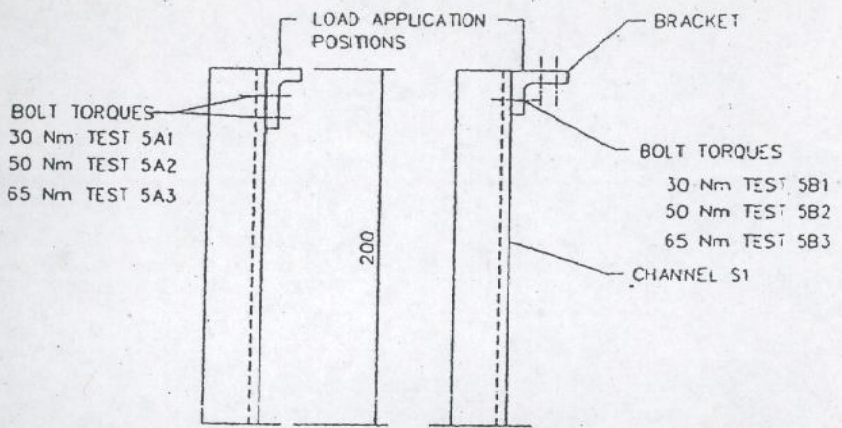


TESTS 5A TESTS 5B
 ASSEMBLY USING M12 x 25 MM LONG
 HEX. HD. SCREWS LOCK WASHERS AND
 M12 CHANNEL NUT WITH SPRING


TESTS 5A 1,2,3 & 5B 1,2,3 CHANNEL NUT SLIP CHARACTERISTIC.

NOTES

ALL DIMENSIONS ARE IN MM
 (SCALE-NTS)


RB	FOR TENDER PURPOSE	REC	PKL	AKH	-	POI	-	-	-	
RA	FOR TENDER PURPOSE ONLY	R	PKS	AKA	-	PK	-	-	-	AKA 20.11
REV. NO.	DESCRIPTION	DRAM	DESIGN	CHKD	M	E	C	C&I	ARCH	APPO DATE
CLEARED BY										
		NTPC Limited (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION								
PROJECT STANDARD										
TITLE TYPICAL DETAILS OF STRUCTURE FOR TESTING										
SIZE	SCALE	DRG. NO.							REV. NO.	
A4	NTS	0000-211-POE-A-03B							RB	

This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

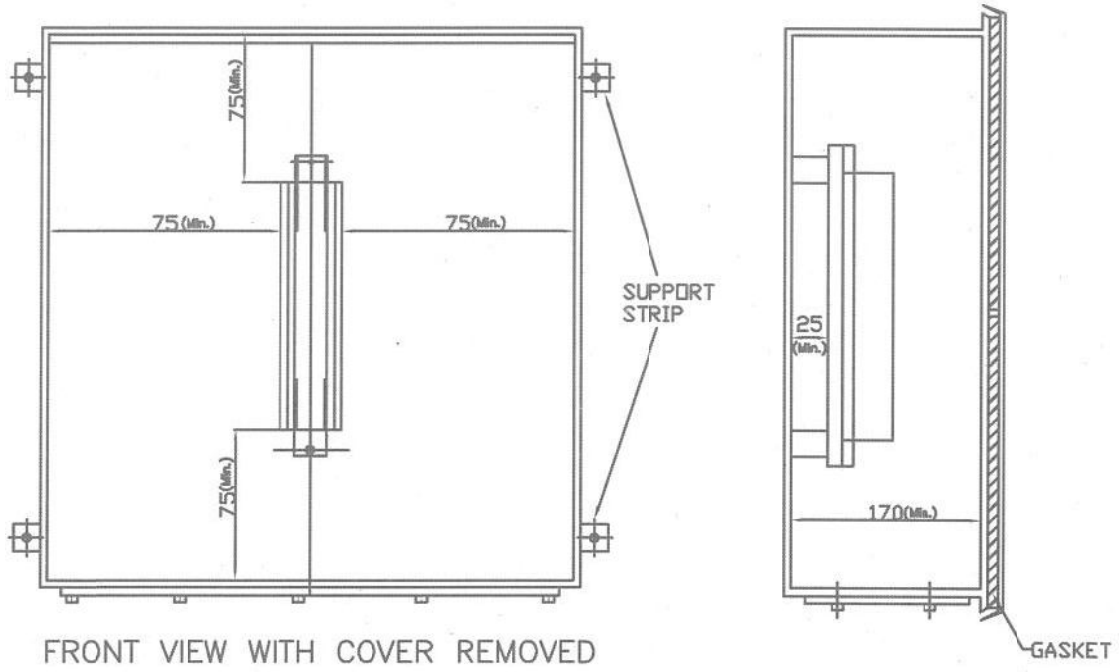


FRONT VIEW WITH COVER REMOVED

NOTE.
1. ALL DIMENSIONS ARE IN mm.


RC	FOR TENDER PURPOSE	M3	M3	exp	-	JY	-	-	-	AS	05-02-16
RB	FOR TENDER PURPOSE	RKG	RKG	VKM	-	SS	-	-	-	AS	05.11.2016
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	17.06.2009
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE
					CLEARED BY						
		NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION									
PROJECT		STANDARD									
TITLE		TYPICAL DRAWING FOR JUNCTION BOX									
SIZE	SCALE	DRG. NO.							REV. NO.		
A4	NTS	0000-211-POE-A-040							RC		

This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

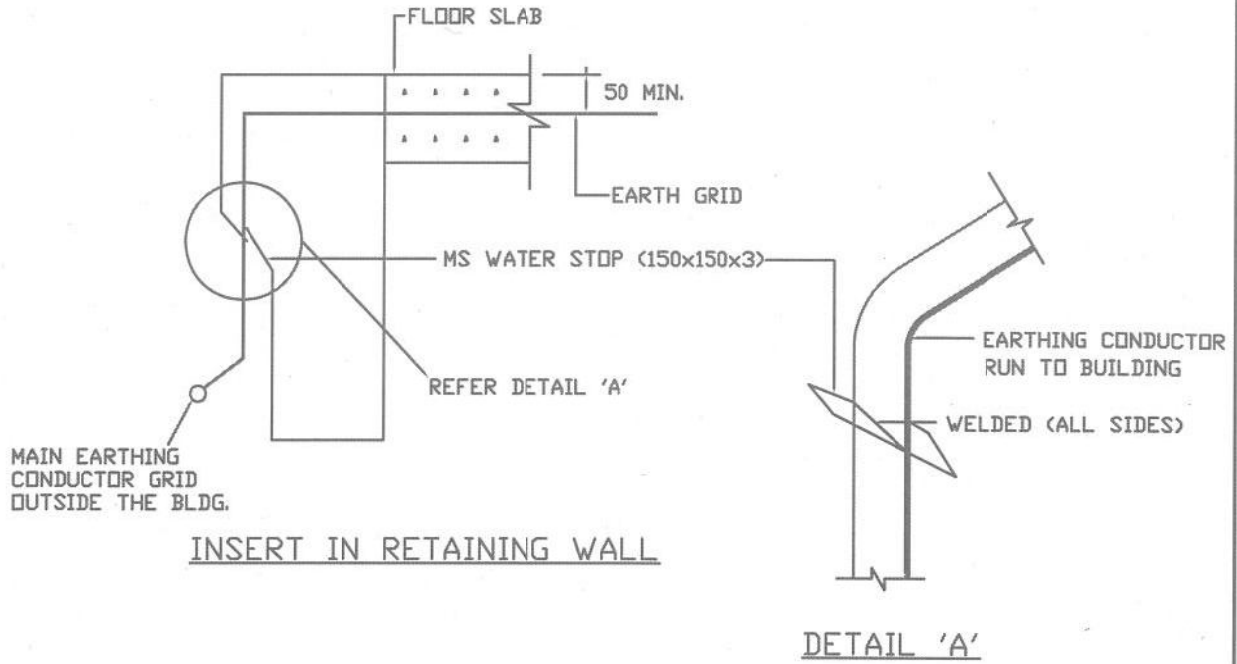

INSERT IN RETAINING WALL

DETAIL 'A'

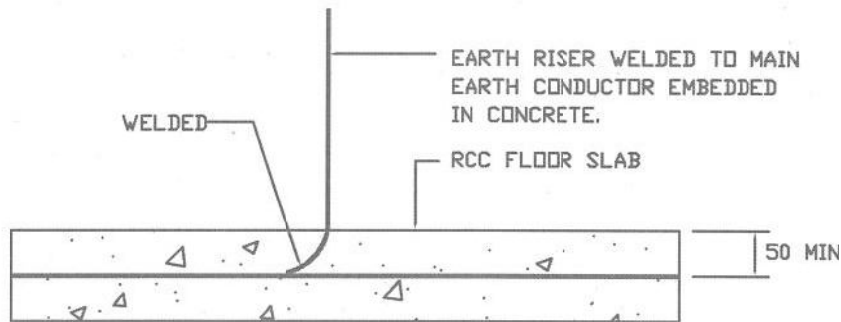

EARTH RISER

NOTE.
1. ALL DIMENSIONS ARE IN mm.

RC	FOR TENDER PURPOSE	M3	M3	RUB	-	WV	-	-	-	AS	05.07.10
RB	FOR TENDER PURPOSE	RKG	RKG	VKM	-	SS	-	-	-	AS	05.07.10
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	07.08.09
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE
CLEARED BY											

एन टी पी सी
NTPC

NTPC LTD.
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION

PROJECT

STANDARD

TITLE

EARTHING DETAILS

SIZE
A4


SCALE
NTS

DRG. NO.


0000-211-POE-A-041

REV. NO.
RC


This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

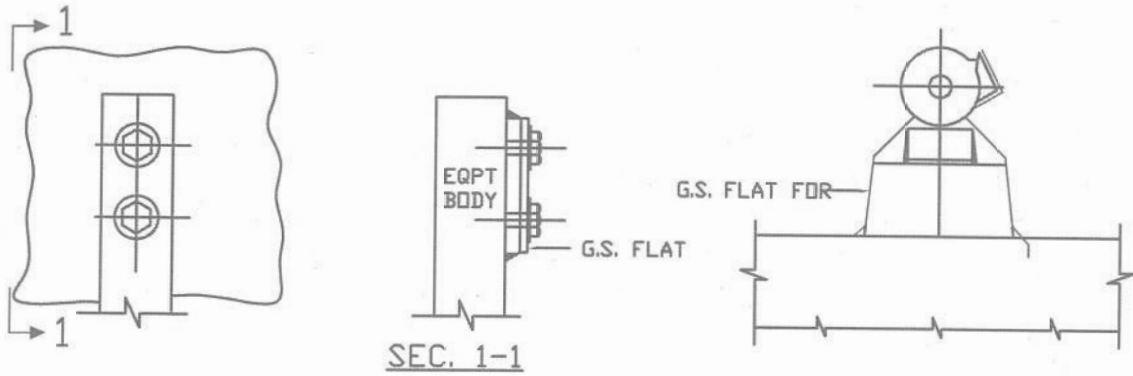


EQUIPMENT GROUNDING WITH G.S. FLAT

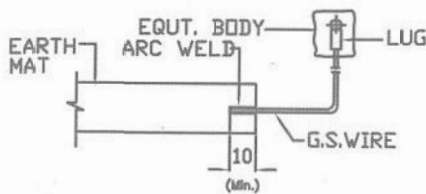


EQUIPMENT GROUNDING WITH G.S. WIRE

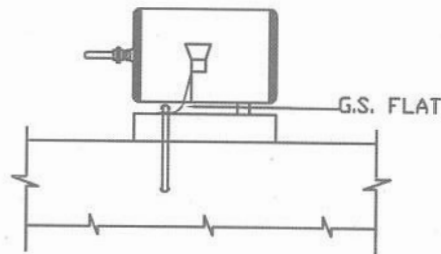

MOTOR TERMINAL BOX GROUNDING DETAIL

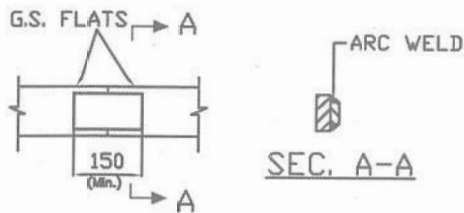

LAP JOINTS BETWEEN G.S. FLATS

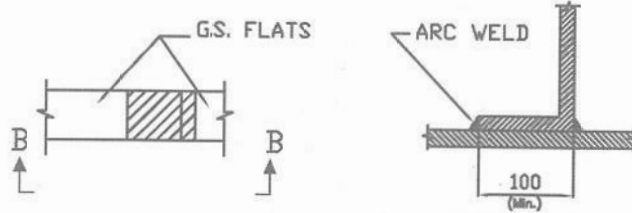


ANGULAR JOINTS BETWEEN G.S. FLATS


NOTE.
1. ALL DIMENSIONS ARE IN mm.

RC	FOR TENDER PURPOSE	A3	A3	PVL	-	NV	-	-	-	AS	05/02/20
RB	FOR TENDER PURPOSE	RKG	RKG	VKM	-	SS	-	-	-	-	05/02/20
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	05/02/20
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE
CLEARED BY											
		NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION									
PROJECT		STANDARD									
TITLE		EARTHING DETAILS									
SIZE	SCALE	DRG. NO.								REV. NO.	
A4	NTS	0000-211-POE-A-042								RC	



This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

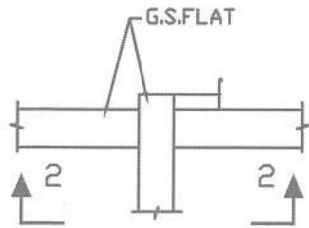

CROSS JOINTS BETWEEN FLATS




SEC. 2-2

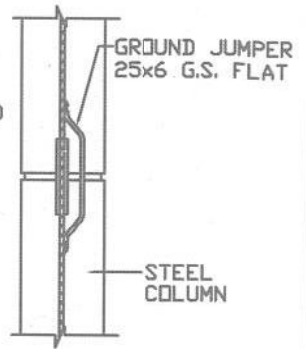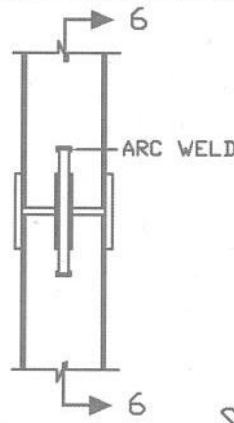


SEC. 6-6

BONDING OF STEEL COLUMN

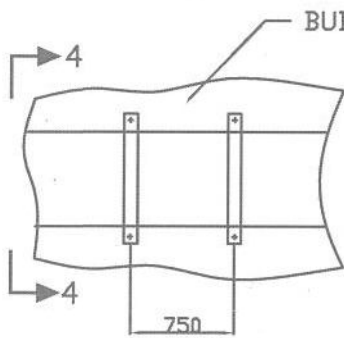


BUILDING WALL

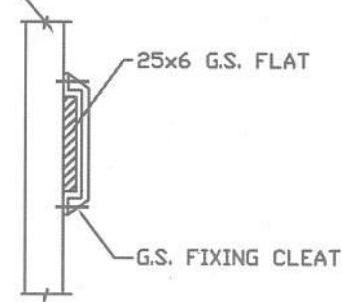

SEC. 4-4

GROUND CONDUCTOR ALONG BUILDING WALL

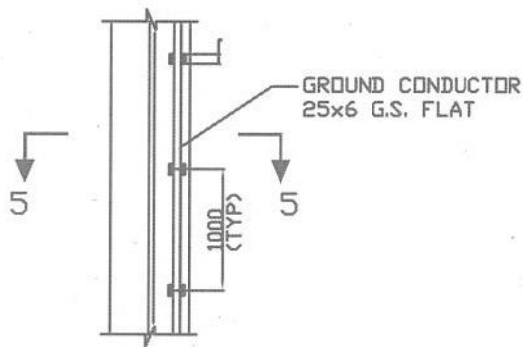


GROUND CONDUCTOR 25x6 G.S. FLAT




SEC. 5-5

GROUND CONDUCTOR ALONG STEEL COLUMN STRUCTURE


NOTE.
1. ALL DIMENSIONS ARE IN mm.

RC	FOR TENDER PURPOSE	M3	M3	PXL	-	NY	-	-	-	AS	05/07/10	
RB	FOR TENDER PURPOSE	RKG	RKG	VKM	-	SS	-	-	-	AS	05/07/10	
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	07/01/2006	
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE	
					CLEARED BY							
		<p style="text-align: center;">NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION</p>										
PROJECT		STANDARD										
TITLE		EARTHING DETAILS										
SIZE A4	SCALE NTS	DRG. NO. 0000-211-POE-A-043								REV. NO. RC		

This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

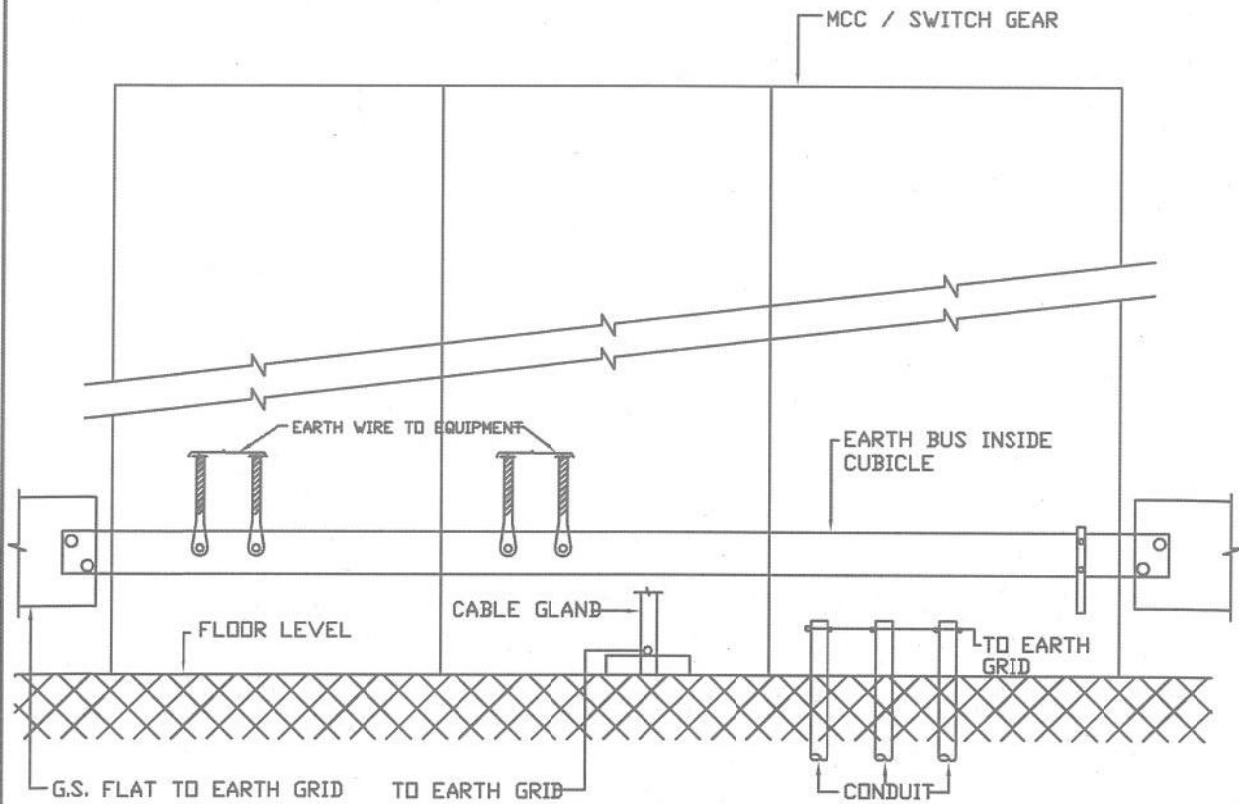

EARTHING DETAILS MCC AND SWITCHGEAR

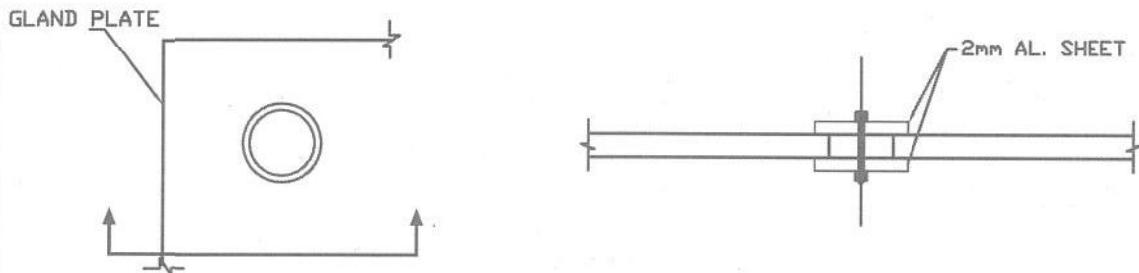

SEALING OF UNUSED CABLE OPENING

NOTE.
1. ALL DIMENSIONS ARE IN mm.

RC	FOR TENDER PURPOSE	A3	A3	REV	-	VV	-	-	-	-	AS	05-03-12
RB	FOR TENDER PURPOSE	RKG	RKG	VKM	-	SS	-	-	-	-	AS	03.11.2006
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	-	17.01.2000
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE	
CLEARED BY												

एन टी सी
NTPC

NTPC LTD.
(A GOVERNMENT OF INDIA ENTERPRISE)
ENGINEERING DIVISION

PROJECT

STANDARD

TITLE

EARTHING DETAILS

SIZE

A4

SCALE

NTS


DRG. NO.

0000-211-POE-A-044

REV. NO.

RC

This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

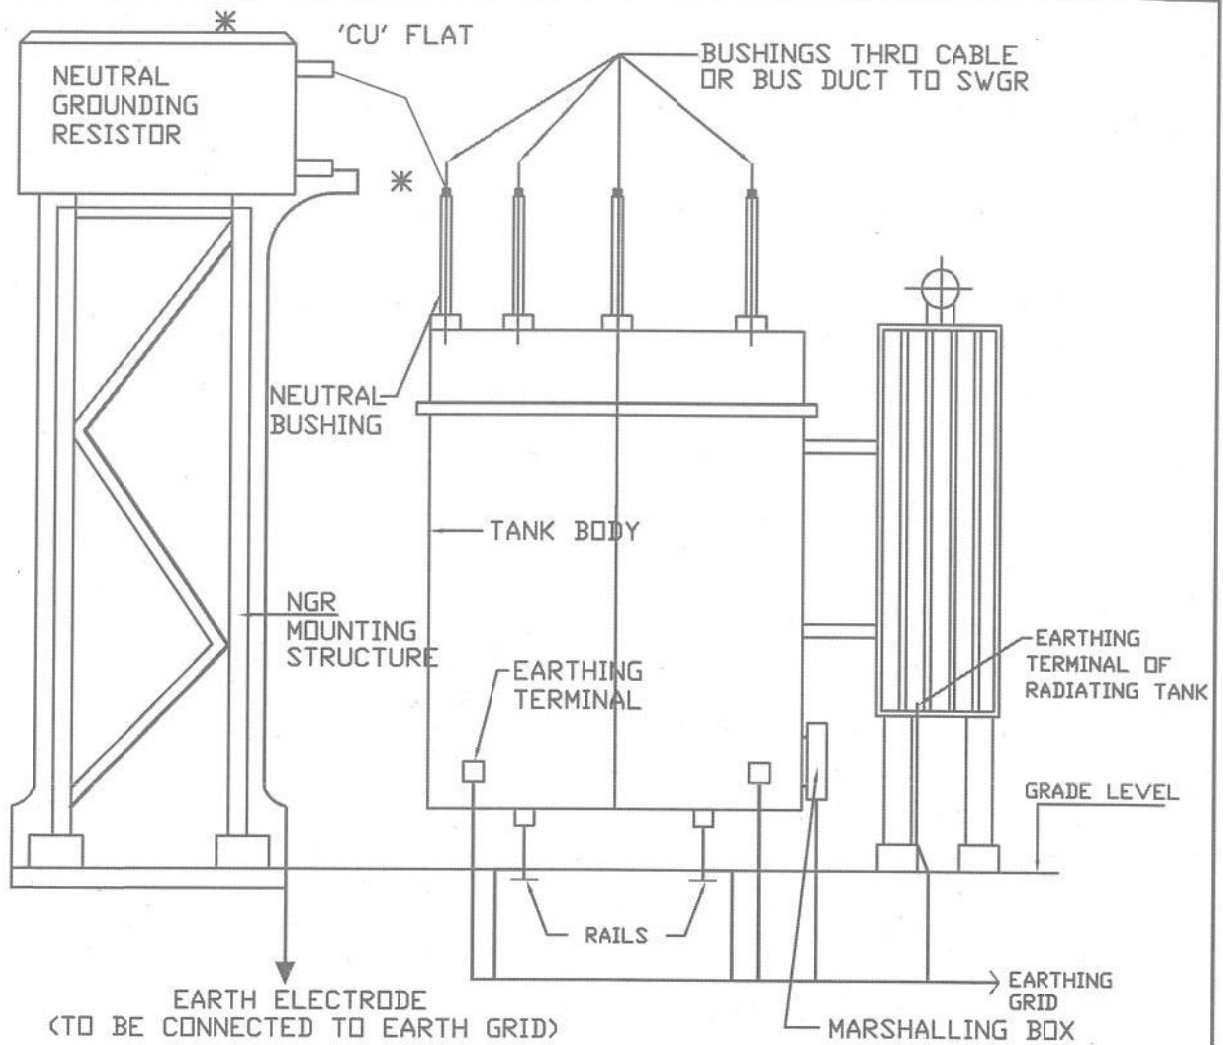


EARTHING DETAILS TRANSFORMER

NOTE.

1. ALL DIMENSIONS ARE IN mm.
2. THE TRANSFORMER NEUTRAL FOR HT TRANSFORMER SHALL BE EARTHED THROUGH FLATS AS SHOWN (SUPPLIED BY TRANSFORMER SUPPLIER)

RC	FOR TENDER PURPOSE	M	M	RKH	-	VV	-	-	-	AS 05-27/10
RB	FOR TENDER PURPOSE	RKG	RKG	VKM	-	SS	-	-	-	AS 05.11.0000
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	17.01.0000
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD DATE
					CLEARED BY					
		NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION								
PROJECT		STANDARD								
TITLE		EARTHING DETAILS								
SIZE	SCALE	DRG. NO.							REV. NO.	
A4	NTS	0000-211-POE-A-045							RC	

This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

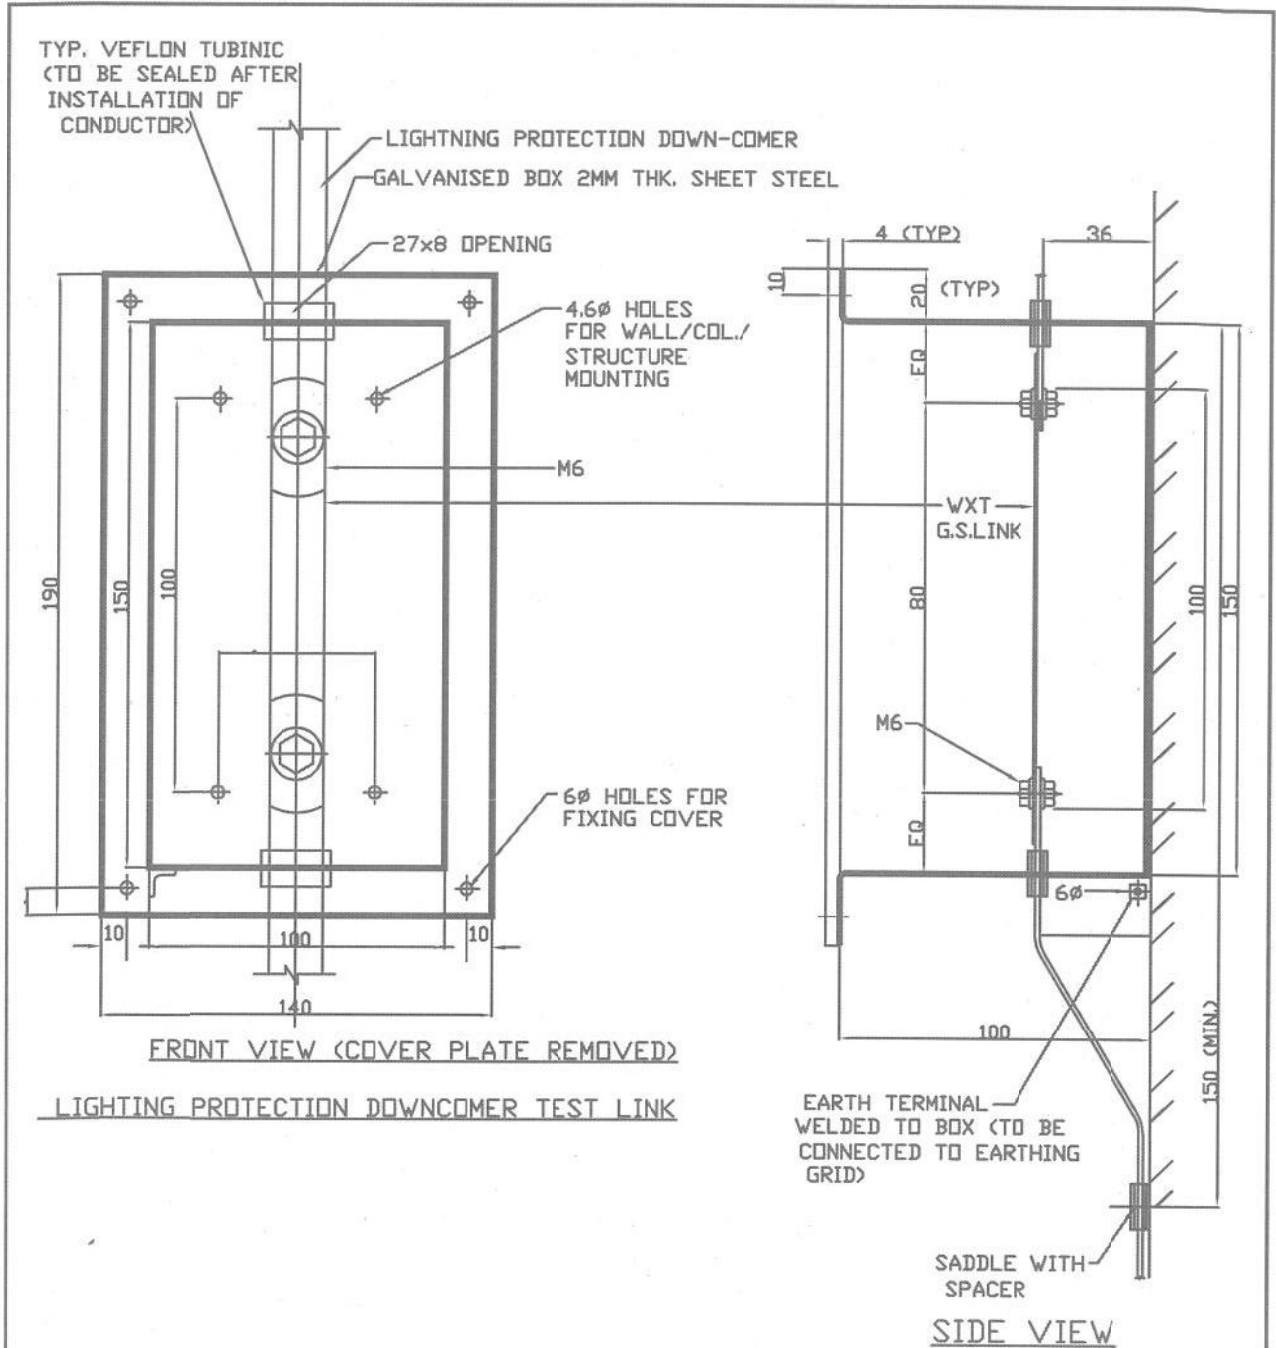


- NOTE.
1. ALL DIMENSIONS ARE IN mm.
 2. THE TEST LINK SHALL BE OF SAME WIDTH AND THICKNESS AS THE DOWNCOMER. THE NUTS BOLTS AND WASHER TO BE OF GS.
 3. THE DOWN COMER ENTRY AND EXIT POINTS IN TO BOX BE MADE WATER-TIGHT AFTER LAYING OF CONDUCTOR.

RC	FOR TENDER PURPOSE	M3	M3	rel	-	W	-	-	-	-	-	AS	05/07/10
RB	FOR TENDER PURPOSE	RKG	RKG	VKM	-	SS	-	-	-	-	-	AS	05/07/10
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	-	-	07/01/2000
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE	CLEARED BY	

		NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION	
PROJECT		STANDARD	
TITLE		LIGHTNING PROTECTION DETAILS.	
SIZE	SCALE	DRG. NO.	REV. NO.
A4	NTS	0000-211-POE-A-047	RC


This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

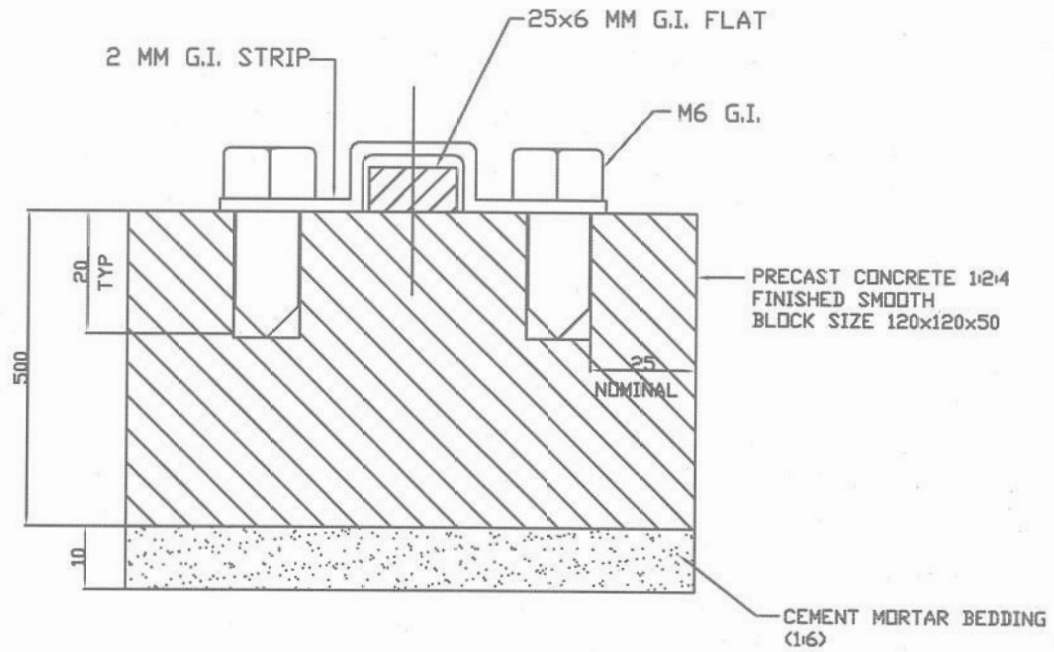


BLOCK SPACING 1000MM CENTRE TO CENTRE

TYPICAL DETAILS OF CLEATING HORIZONTAL CONDUCTOR OVER WATER PROOFING

NOTE.
1. ALL DIMENSIONS ARE IN mm.


RC	FOR TENDER PURPOSE	A2	A3	R29	-	VV	-	-	-	AS	05/02/00
RB	FOR TENDER PURPOSE	RKG	RKG	VKM	-	SS	-	-	-	AS	05/02/00
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	05/02/00
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE
CLEARED BY											
		NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION									
PROJECT		STANDARD									
TITLE		LIGHTNING PROTECTION DETAILS									
SIZE	SCALE	DRG. NO.							REV. NO.		
A4	NTS	0000-211-POE-A-048							RC		

This drawing is the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.


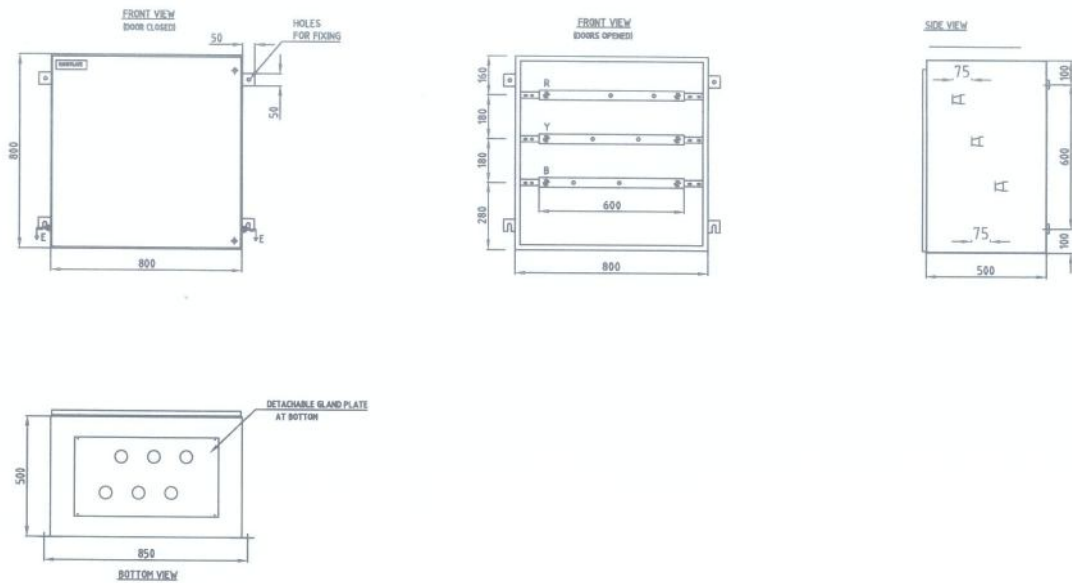


GENERAL TECHNICAL PARTICULARS

1. ALL DIMENSIONS ARE IN MM.
2. TYPE: WALL/COLUMN/PEDESTAL MOUNTING TYPE.
3. SHEET: CRCA SHEET min. 2mm THK.
4. GLAND PLATE SHOULD BE OF 3MM THK ALUMINIUM, REMOVABLE TYPE WITH KNOCKOUT HOLE FOR I/C CABLE-1Cx300SQ.MM AL.-6NOS.
HOLE FOR O/G CABLE-1Cx185SQ.MM AL.-6NOS.
5. PAINT: PRETREATMENT POWDER COATING
6. SHADE: GREY RAL-9002
7. CABLE ENTRY: BOTTOM
8. BUSBAR: ELECTROLYTIC GRADE TINNED CU. OF Min. 40x10MM
9. IP-55
10. BUS BAR INSULATOR-SMC TYPE
11. BUS BAR ARRANGEMENT: HORIZONTAL
12. BUS BAR SHALL HAVE ONE HOLE DRILLED FOR CABLE CONNECTION OF EACH SIZE MENTIONED AT SL.NO 4 AND SUPPLIED WITH CORRESPONDING SIZE HIGH TENSILE STRENGTH ZINC COATED STEEL BOLTS.

RA	FOR TENDER PURPOSE ONLY	ne	ve	AK	M	E	C	C&I	ARCH	APPD	DATE
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	CLEARED BY						15/06/19
		NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION									
PROJECT		STANDARD									
TITLE		ADAPTOR BOX FOR LT CABLES									
SIZE	SCALE	DRG. NO.							REV. NO.		
A4	NTS	0000-211-POE-A-048A							RA		

This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

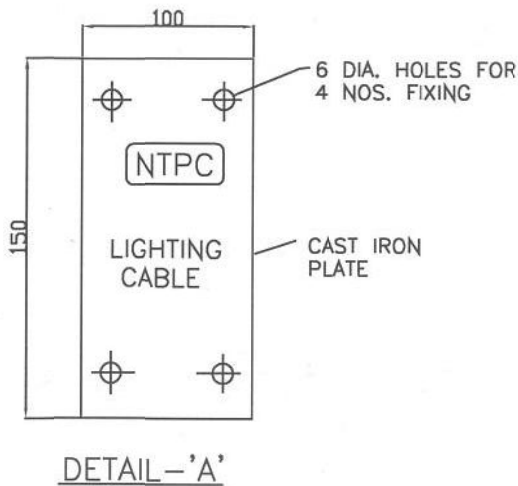
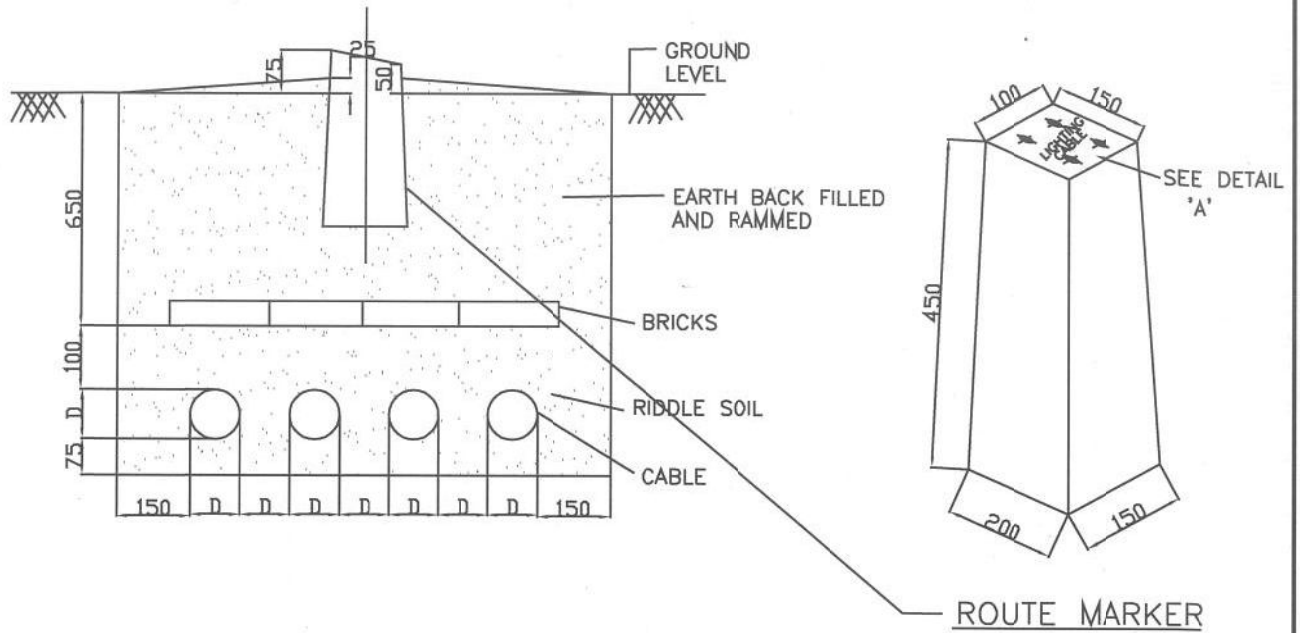


NOTES:

1. ALL DIMENSIONS ARE IN mm.
2. ROUTE MARKERS SHALL BE CONSTRUCTED OF CONCRETE WITH CAST IRON PLATE, WITH THE ROUTE INFORMATION ENGRAVED ON IT, BOLTED ON TOP OF THE CONCRETE BLOCK AS SHOWN.
3. CAST IRON PLATE SHALL BE OF Min. 6.0mm THICKNESS.

RC	FOR TENDER PURPOSE	13	13	RKG	-	N/S	-	-	-	AS	05.07.10
RB	FOR TENDER PURPOSE	RKG	RKG	VKM	-	SS	-	-	-	AS	20.11.2006
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	17.01.2000
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE
					CLEARED BY						
		NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION									
PROJECT		STANDARD									
TITLE		BURIED CABLE TRENCH DETAILS FOR LIGHTING									
SIZE	SCALE	DRG. NO.								REV. NO.	
A4	NTS	0000-211-POE-A-049								RC	

This drawing and the design it covers are the property of NTPC LTD. and must not be copied, loaned or exhibited either in part or in whole without written permission. Any contravention is liable for prosecution.

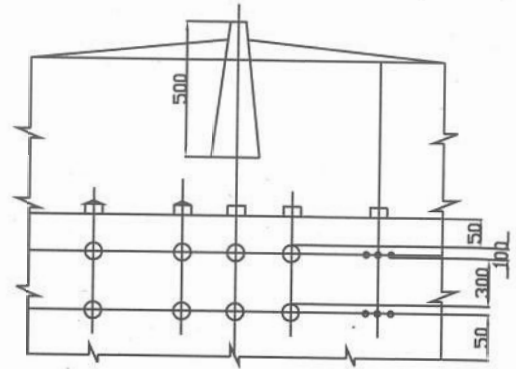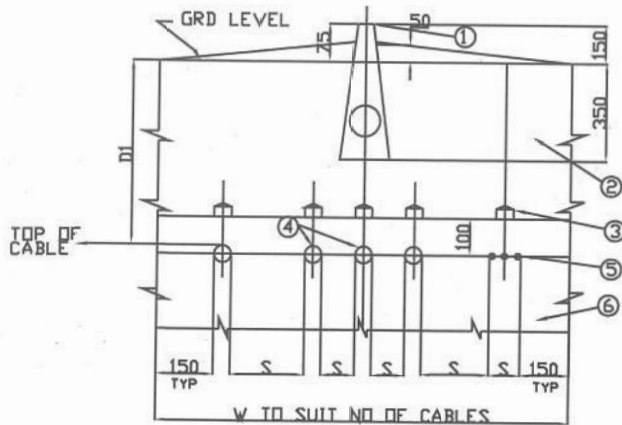

DIRECTLY BURIED CABLES
IN SINGLE LAYER

DIRECTLY BURIED CABLES
IN TWO LAYER

LEGEND

- ① — CABLE ROUTE MARKER
- ② — EARTH BACK FILLED & RAMMED
- ③ — PROTECTIVE COVERS
 - a) BRICKS FOR LOW VOLTAGE CABLES
 - b) RCC FOR HIGH VOLTAGE CABLES WITH HOLE AT EACH END TO TIE EACH OTHER WITH G.S. WIRE
- ④ — ARMoured POWER CABLE
- ⑤ — ARMoured CONTROL CABLE
- ⑥ — FINE SAND/RIDDED SOIL COMPACTED

DIMENSION MIN.	1100V GRADE CABLES	FOR 3.3 KV TO 11KV	ABOVE 11KV & UPTO 33KV
D1	750	900	1050
S	= d BETWEEN CABLES OF SAME CLASS = 300MM BETWEEN CABLES OF DEFT CLASS = 400MM BETWEEN 1/C POWER CABLE AND COMMUNICATION CABLE. = 300MM BETWEEN MULTICORE POWER CABLE & COMMUNICATION CABLE.		

d - OVERALL DIAMETER OF THE BIGGER OF THE TWO CABLES.
D1 - MINIMUM DEPTH OF LAYING FROM GROUND SURFACE TO TOP OF CABLES.

NOTE

1. SINGLE CORE CABLES SHALL BE RUN IN TREFOIL FORMATION AND SHALL BE BOUND BY SELFLOCKING CABLE TIES AT EVERY 750 MM.
2. CABLE IDENTIFICATION TAG SHALL BE TIED AT BOTH ENDS OF THE CABLE.
3. IF THE MINIMUM CLEARANCE AS INDICATED THE ABOVE TABLE FOR CABLES OF DIFFERENT CLASSES ARE NOT FEASIBLE BRICK BARRIERS SHALL BE USED BETWEEN ADJACENT CABLES.
4. G.I/HUME/HDPE. PIPES SHALL BE PROVIDED FOR ROAD CROSSING AT A MINIMUM DEPTH OF 600 FROM THE GRADE LEVEL AS DECIDED BY NTPC.
5. ALL DIMENSIONS ARE IN mm

RC	FOR TENDER PURPOSE	N3	N3	RKP	-	W	-	-	-	AS	05.07.10
RB	FOR TENDER PURPOSE	RKG	RKG	SG	-	SS	-	-	-	AS	08.11.2006
RA	FOR TENDER PURPOSE	-	-	-	-	-	-	-	-	-	17.01.2000
REV. NO.	DESCRIPTION	DRAWN	DESIGN	CHKD	M	E	C	C&I	ARCH	APPD	DATE
CLEARED BY											

NTPC LTD. (A GOVERNMENT OF INDIA ENTERPRISE) ENGINEERING DIVISION					
PROJECT		STANDARD			
TITLE				BURIED CABLES TRENCH FOR HT & LT CABLES	
SIZE	SCALE	DRG. NO.		REV. NO.	
A4	NTS	0000-211-POE-A-060		RC	

